

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	01/07/2026
Start of Curtailment (G1 - non Priority)	10:00
End of Curtailment (G1 - non Priority)	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2881 MWh
Total Estimated Curtailed Energy:	704.3 MWh
Percentage of Curtailed Energy:	24.45%

Scada PVs Generation on 01/07/2026 (curtailment time: 10:00 - 15:30)

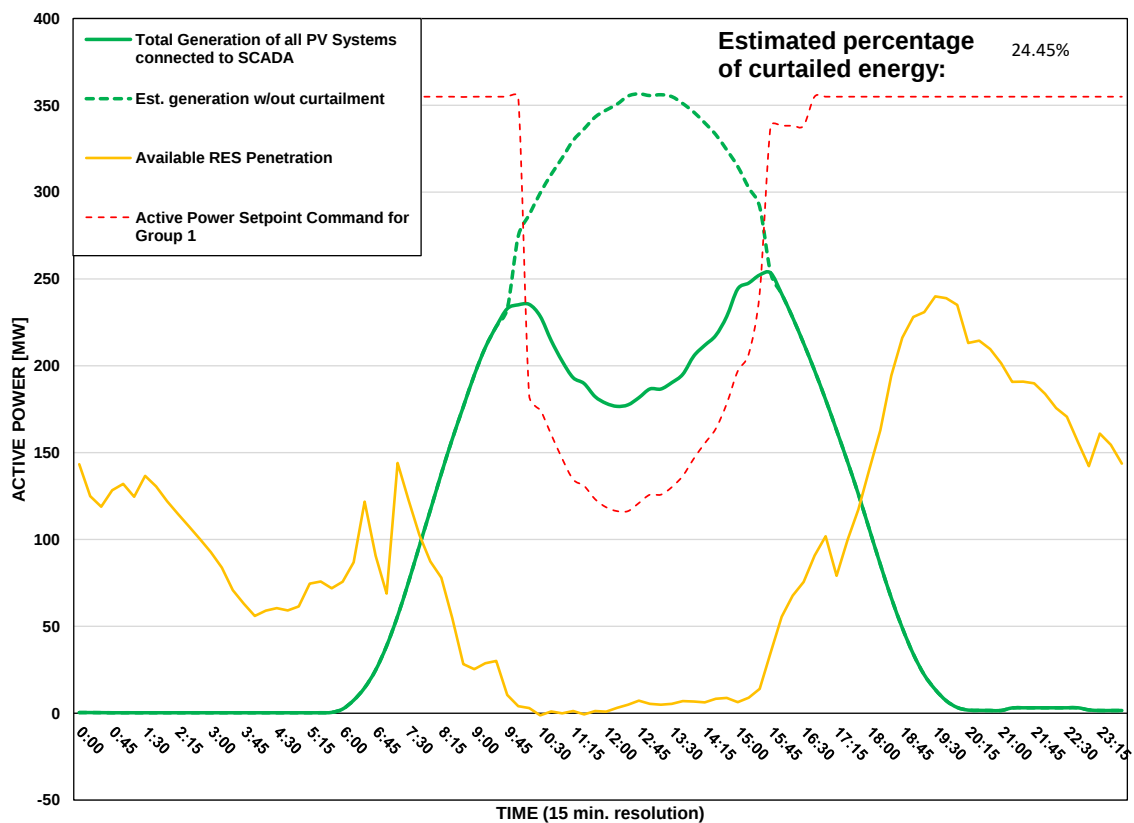

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	02/07/2026
Start of Curtailment (G1 - non Priority)	8:30
End of Curtailment (G1 - non Priority)	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2911.1 MWh
Total Estimated Curtailed Energy:	925.1 MWh
Percentage of Curtailed Energy:	31.79%

Scada PVs Generation on 02/07/2026 (curtailment time: 08:30 - 16:00)

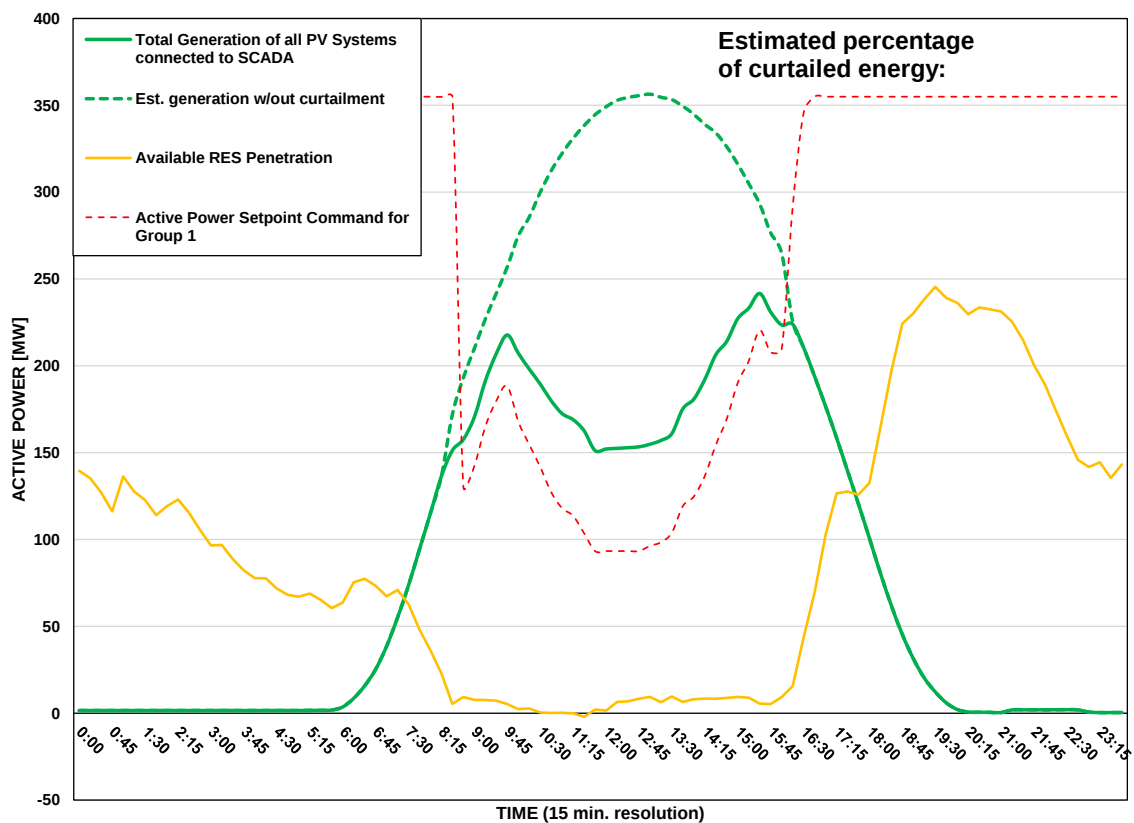

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	03/07/2026
Start of Curtailment (G1 - non Priority)	9:45
End of Curtailment (G1 - non Priority)	16:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2840 MWh
Total Estimated Curtailed Energy:	932.5 MWh
Percentage of Curtailed Energy:	32.85%

Scada PVs Generation on 03/07/2026 (curtailment time: 09:45 - 16:45)

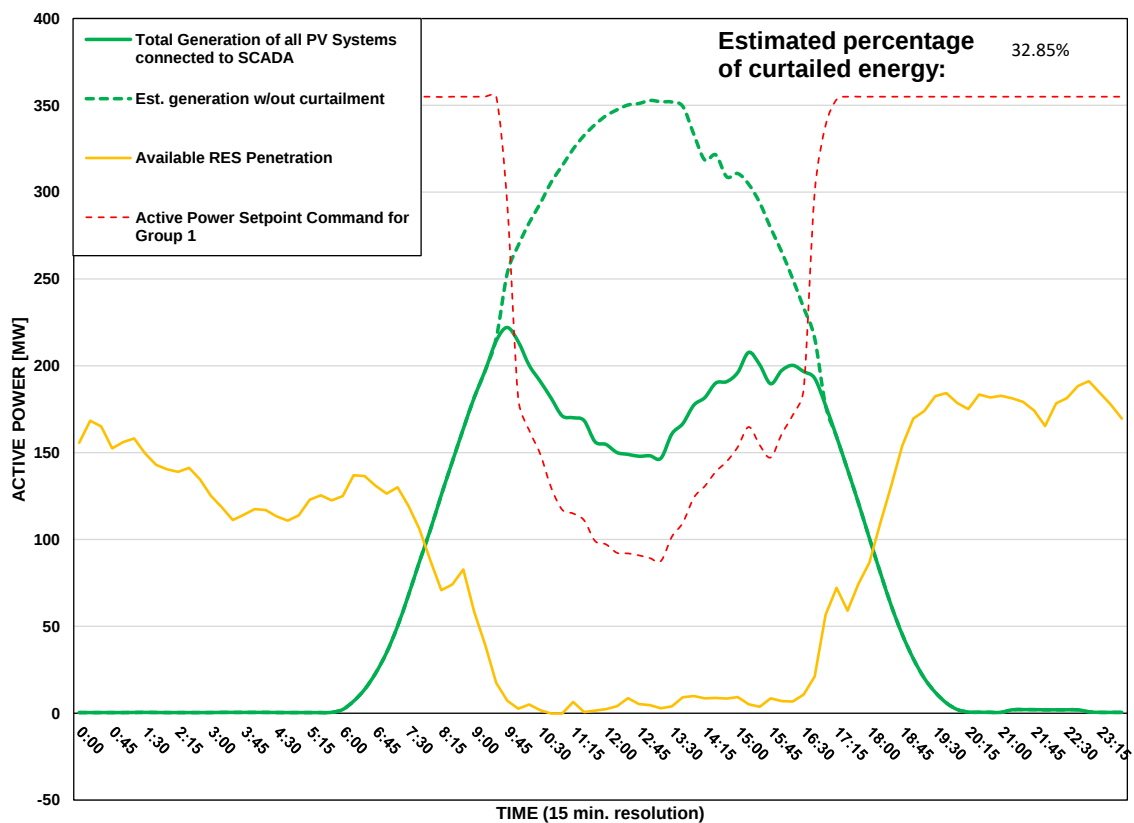


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	04/07/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	7:45	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
Start of Curtailment (G2 - Priority)	11:00	
End of Curtailment (G1 - non Priority)	16:45	
End of Curtailment (G2 - Priority)	12:45	
Instruction from TSOC	YES	Start of cut-off: 11:00 End of cut-off: 12:45
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2798.9 MWh	
Total Estimated Curtailed Energy:	1598.5 MWh	Total Est. Energy of the cut-off PV systems using IoT: 7.3MWh
Percentage of Curtailed Energy:	57.13%	

Scada PVs Generation on 04/07/2026 (curtailment time: 07:45 - 16:45)

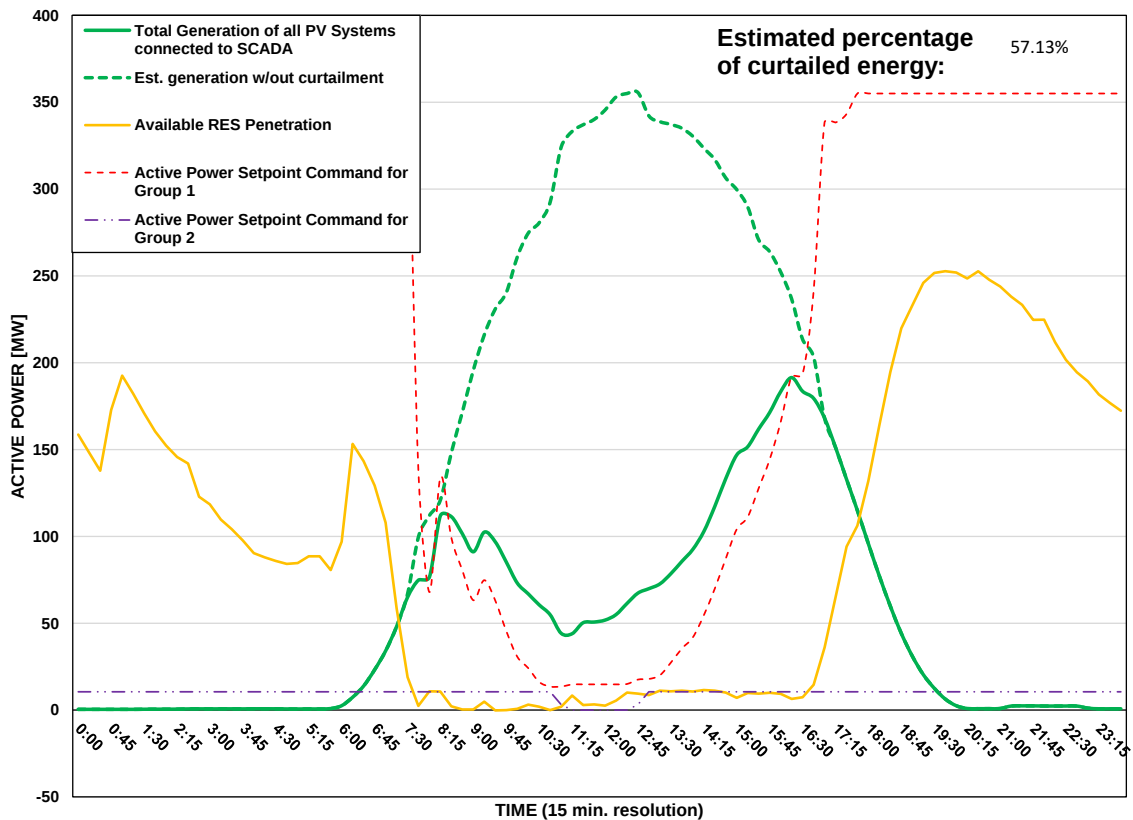

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	05/07/2026
Start of Curtailment (G1 - non Priority)	9:00
End of Curtailment (G1 - non Priority)	17:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2683.8 MWh
Total Estimated Curtailed Energy:	1264.7 MWh
Percentage of Curtailed Energy:	47.12%

Scada PVs Generation on 05/07/2026 (curtailment time: 09:00 - 17:15)

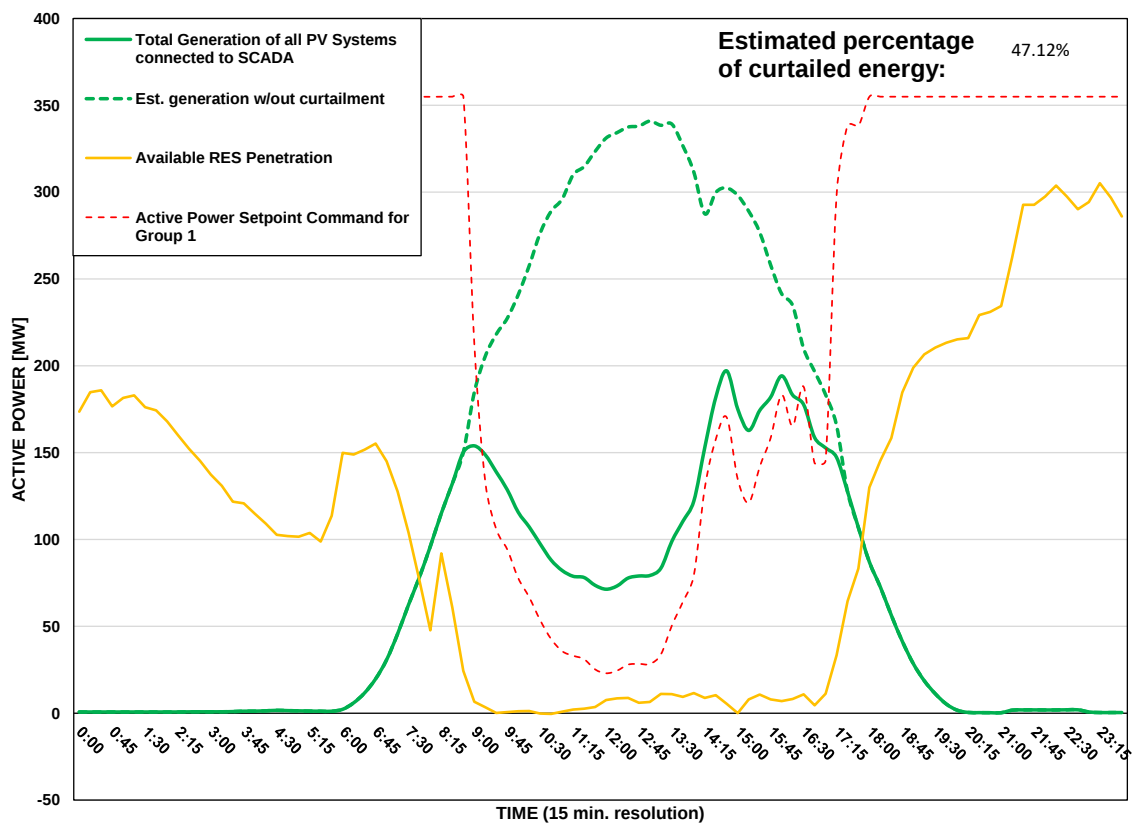

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	06/07/2026
Start of Curtailment (G1 - non Priority)	11:00
End of Curtailment (G1 - non Priority)	13:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2161.7 MWh
Total Estimated Curtailed Energy:	219.9 MWh
Percentage of Curtailed Energy:	10.17%

Scada PVs Generation on 06/07/2026 (curtailment time: 11:00 - 13:15)

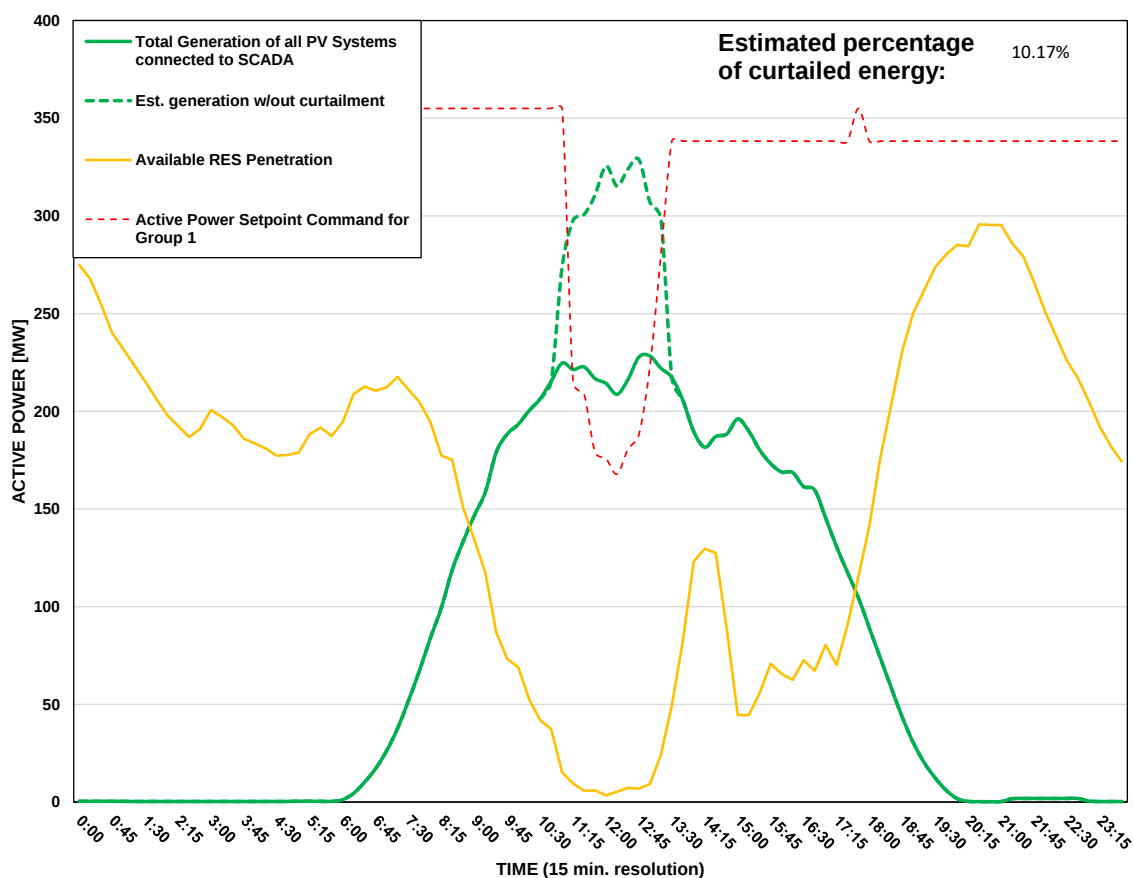

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	7/7/2026
Start of Curtailment (G1 - non Priority)	9:15
End of Curtailment (G1 - non Priority)	16:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2526.7 MWh
Total Estimated Curtailed Energy:	545.6 MWh
Percentage of Curtailed Energy:	21.62%

Scada PVs Generation on 07/07/2026 (curtailment time: 09:15 - 16:30)

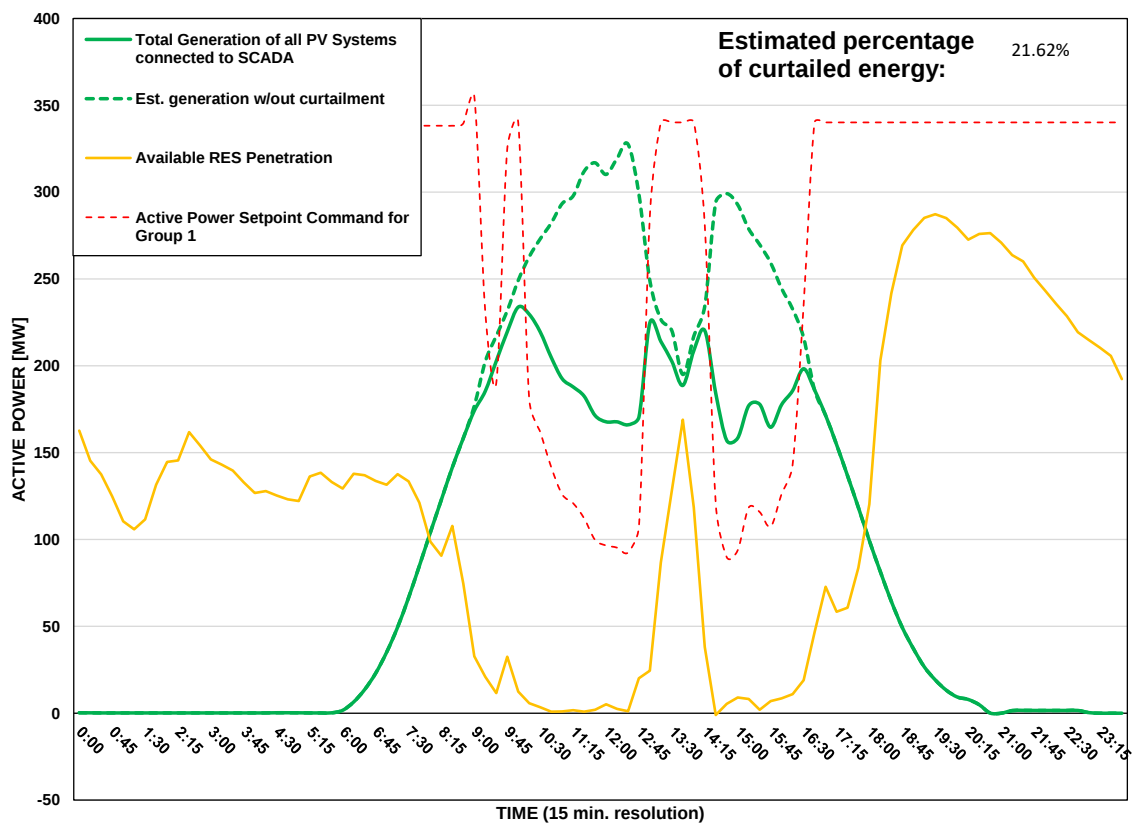

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	08/07/2026
Start of Curtailment (G1 - non Priority)	9:45
End of Curtailment (G1 - non Priority)	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2674.1 MWh
Total Estimated Curtailed Energy:	802.3 MWh
Percentage of Curtailed Energy:	30.02%

Scada PVs Generation on 08/07/2026 (curtailment time: 09:45 - 16:00)

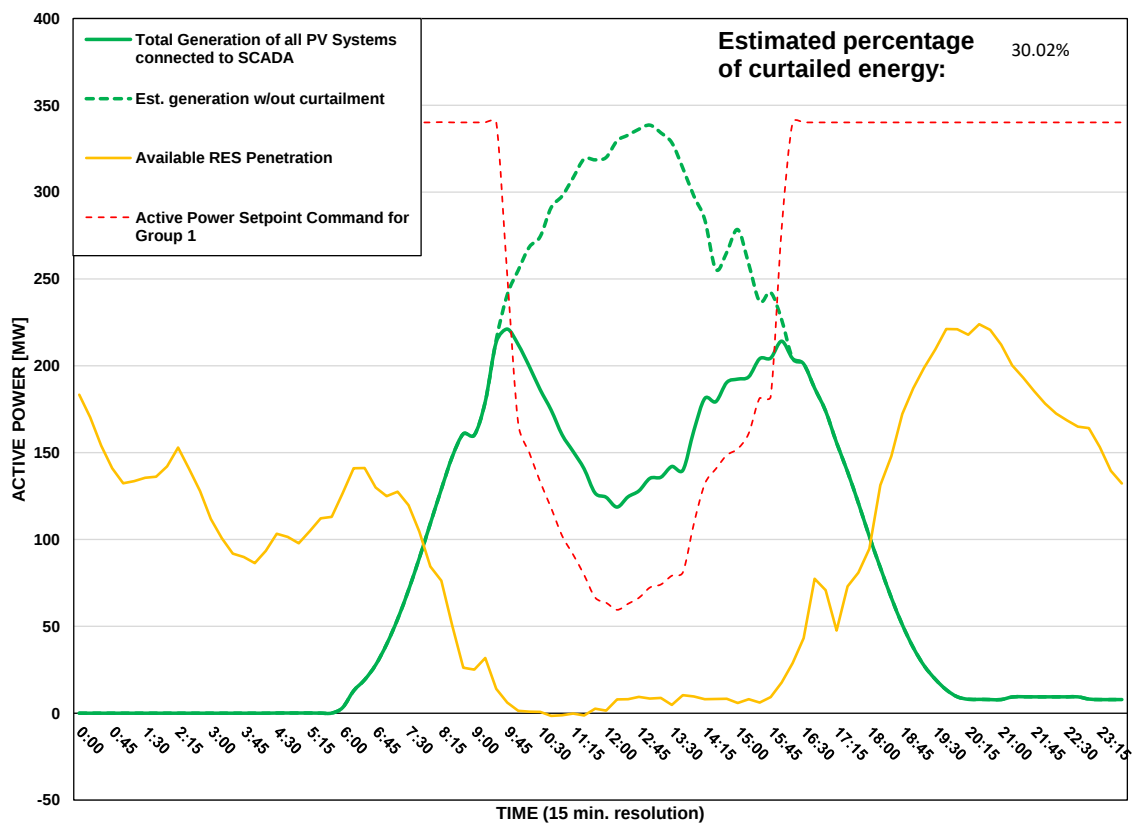

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	09/07/2026
Start of Curtailment (G1 - non Priority)	8:45
End of Curtailment (G1 - non Priority)	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2712.2 MWh
Total Estimated Curtailed Energy:	923.8 MWh
Percentage of Curtailed Energy:	34.07%

Scada PVs Generation on 09/07/2026 (curtailment time: 08:45 - 16:15)

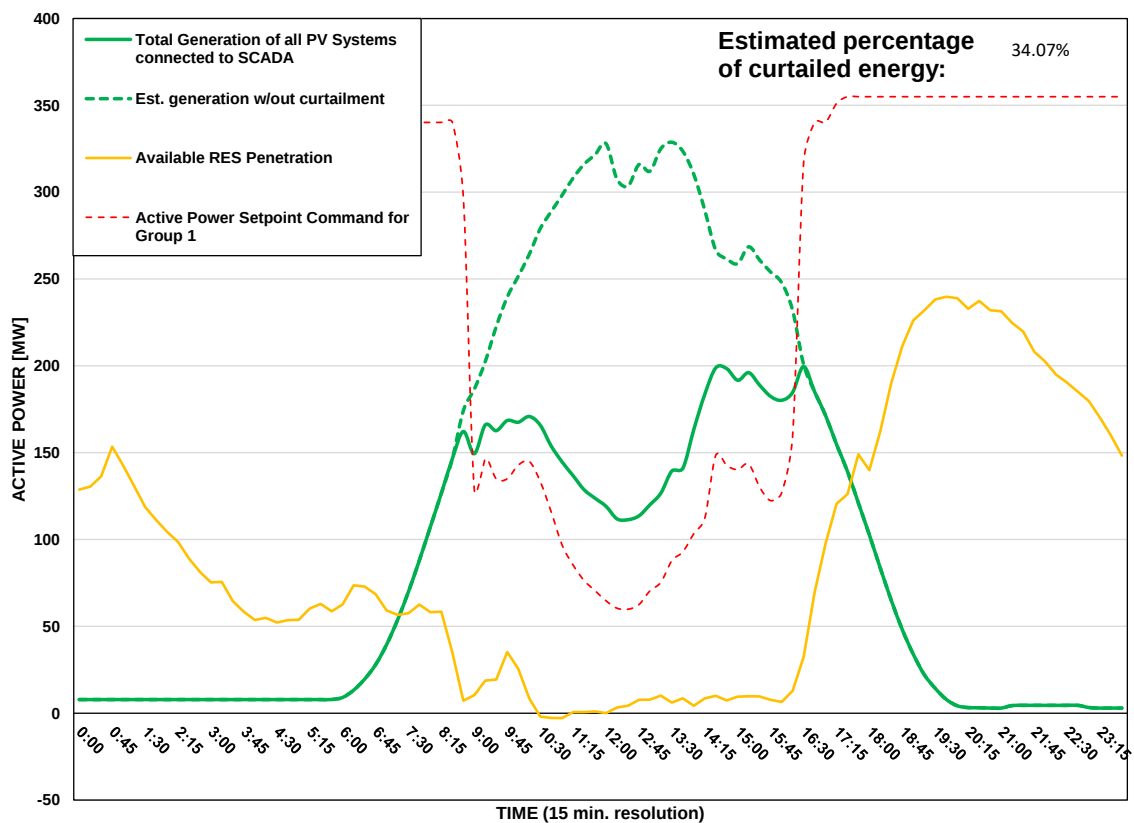

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	10/07/2026
Start of Curtailment (G1 - non Priority)	9:15
End of Curtailment (G1 - non Priority)	17:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2882.5 MWh
Total Estimated Curtailed Energy:	1150.7 MWh
Percentage of Curtailed Energy:	39.92%

Scada PVs Generation on 10/07/2026 (curtailment time: 09:15 - 17:00)

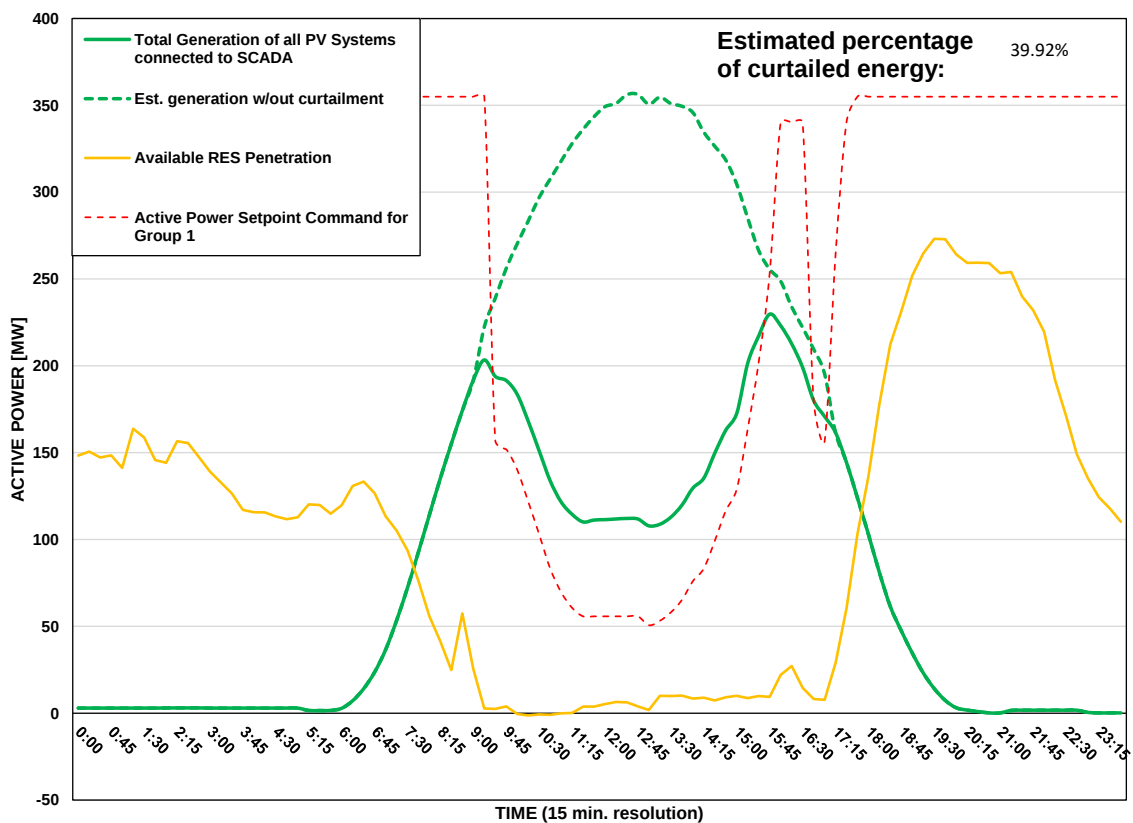


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	11/07/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:15	
Start of Curtailment (G2 - Priority)	10:30	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	17:00	
End of Curtailment (G2 - Priority)	14:00	
Instruction from TSOC	YES	Start of cut-off: 10:15 End of cut-off: 13:45
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2891.7 MWh	
Total Estimated Curtailed Energy:	1666.4 MWh	Total Est. Energy of the cut-off PV systems using IoT: 13.8MWh
Percentage of Curtailed Energy:	57.64%	

Scada PVs Generation on 11/07/2026 (curtailment time: 08:15 - 17:00)

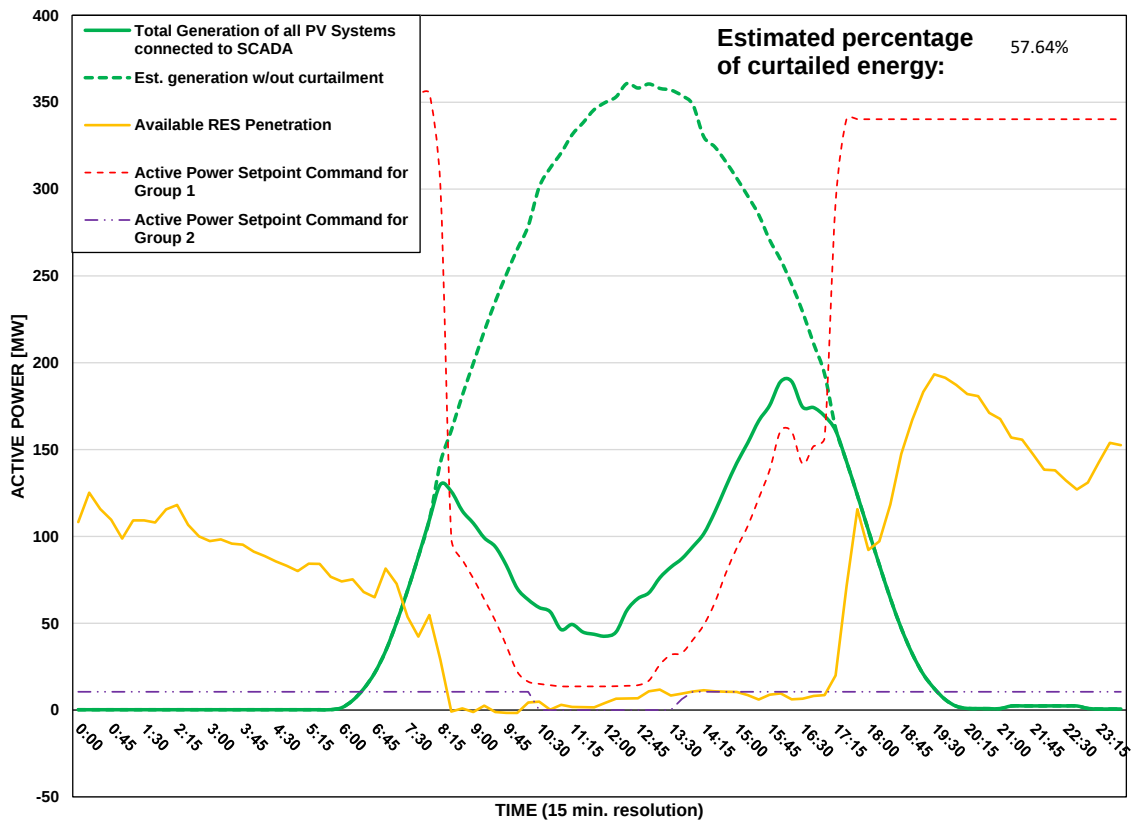

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	12/07/2026
Start of Curtailment (G1 - non Priority)	8:45
End of Curtailment (G1 - non Priority)	17:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2720.2 MWh
Total Estimated Curtailed Energy:	1243.6 MWh
Percentage of Curtailed Energy:	45.72%

Scada PVs Generation on 12/07/2026 (curtailment time: 08:45 - 17:15)

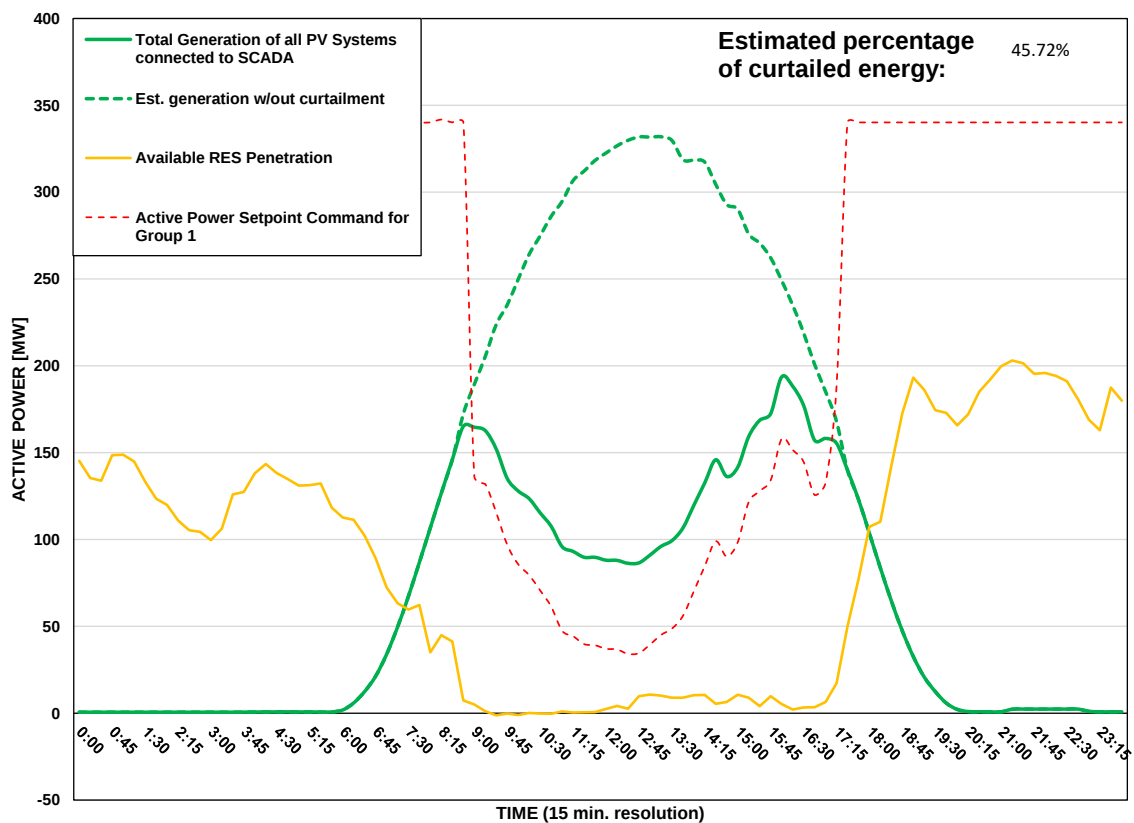


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	13/07/2026
Start of Curtailment (G1 - non Priority)	10:30
End of Curtailment (G1 - non Priority)	15:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2743.7 MWh
Total Estimated Curtailed Energy:	429.4 MWh
Percentage of Curtailed Energy:	15.65%

Scada PVs Generation on 13/07/2026 (curtailment time: 10:30 - 15:00)

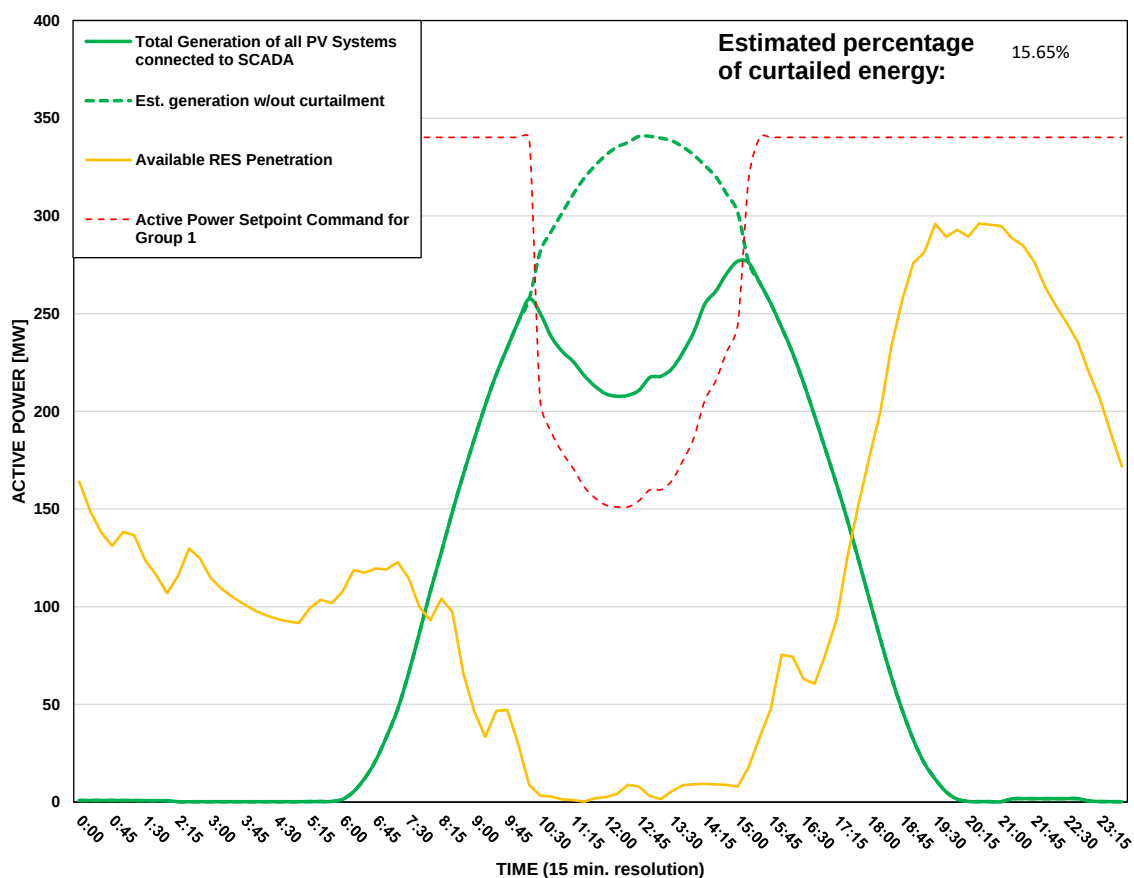

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	14/07/2026
Start of Curtailment (G1 - non Priority)	10:00
End of Curtailment (G1 - non Priority)	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2755 MWh
Total Estimated Curtailed Energy:	513 MWh
Percentage of Curtailed Energy:	18.62%

Scada PVs Generation on 14/07/2026 (curtailment time: 10:00 - 15:30)

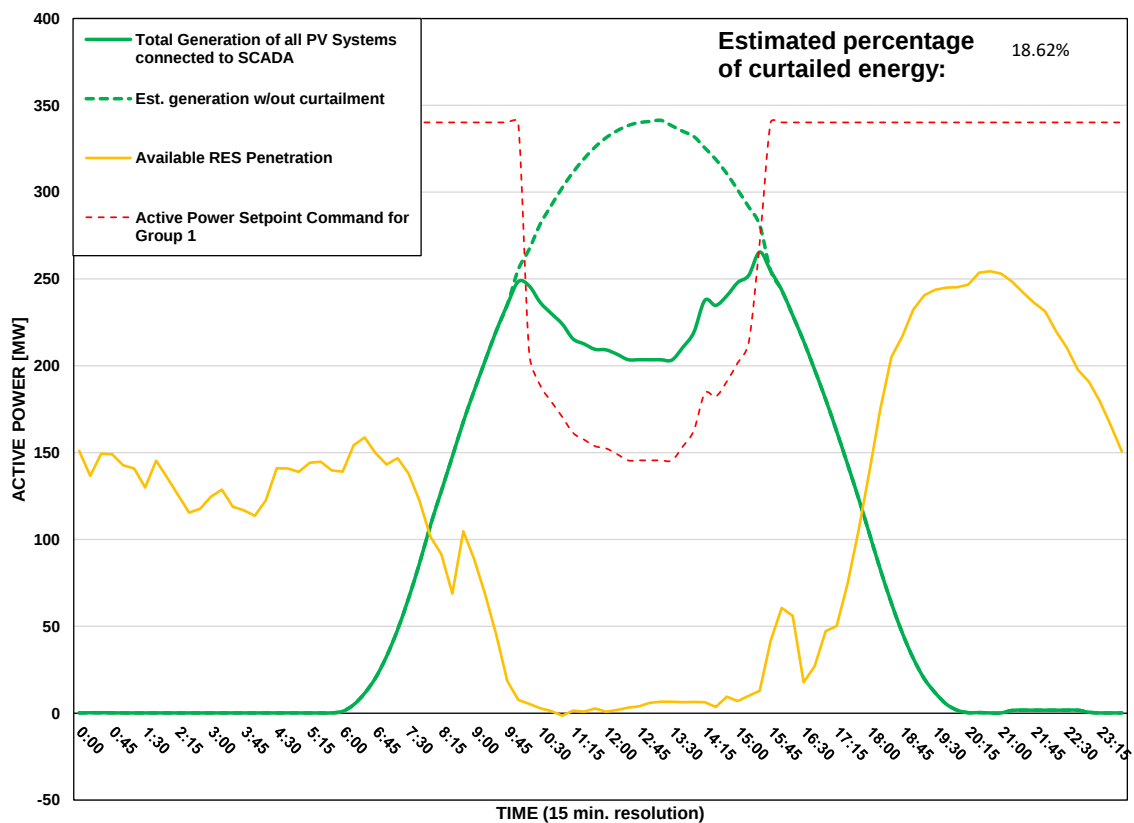

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	15/07/2026
Start of Curtailment (G1 - non Priority)	10:00
End of Curtailment (G1 - non Priority)	14:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2691.5 MWh
Total Estimated Curtailed Energy:	331.7 MWh
Percentage of Curtailed Energy:	12.33%

Scada PVs Generation on 15/07/2026 (curtailment time: 10:00 - 14:15)

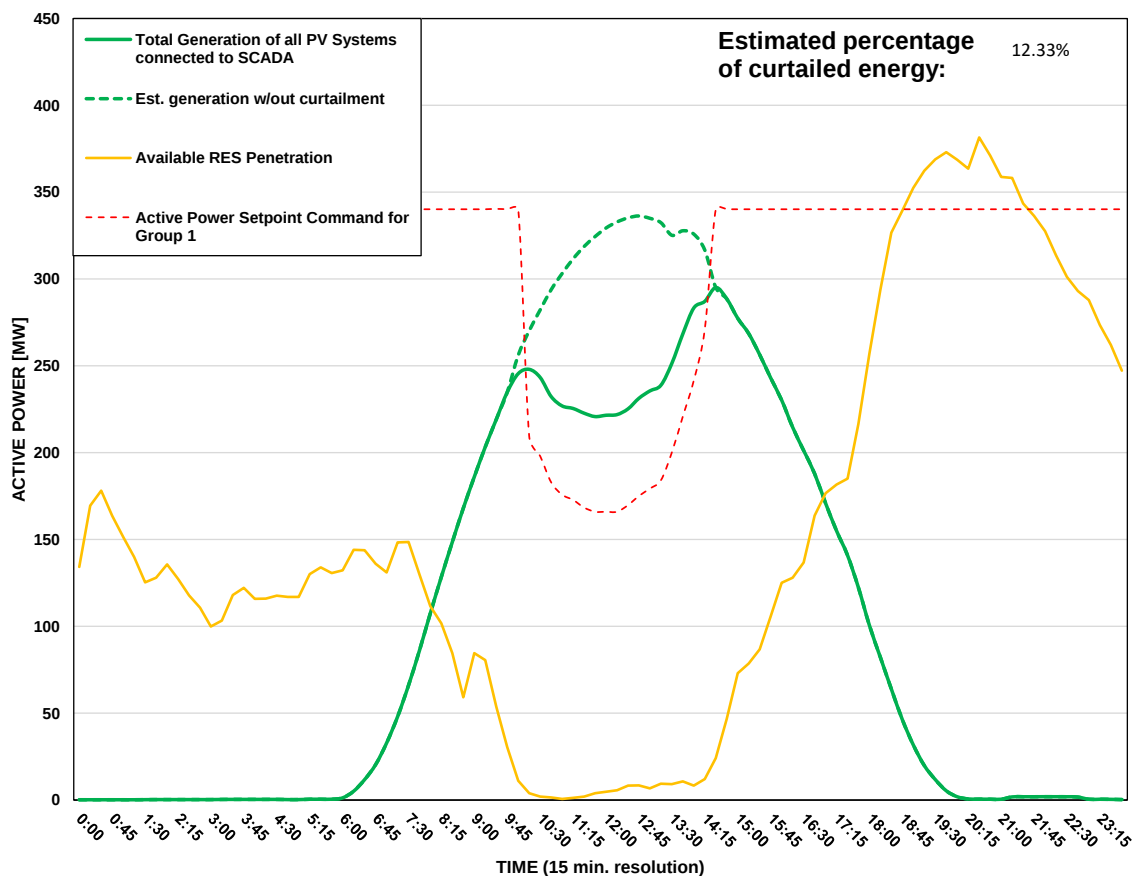

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	16/07/2026
Start of Curtailment (G1 - non Priority)	9:30
End of Curtailment (G1 - non Priority)	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2702.8 MWh
Total Estimated Curtailed Energy:	576 MWh
Percentage of Curtailed Energy:	21.31%

Scada PVs Generation on 16/07/2026 (curtailment time: 09:30 - 15:15)

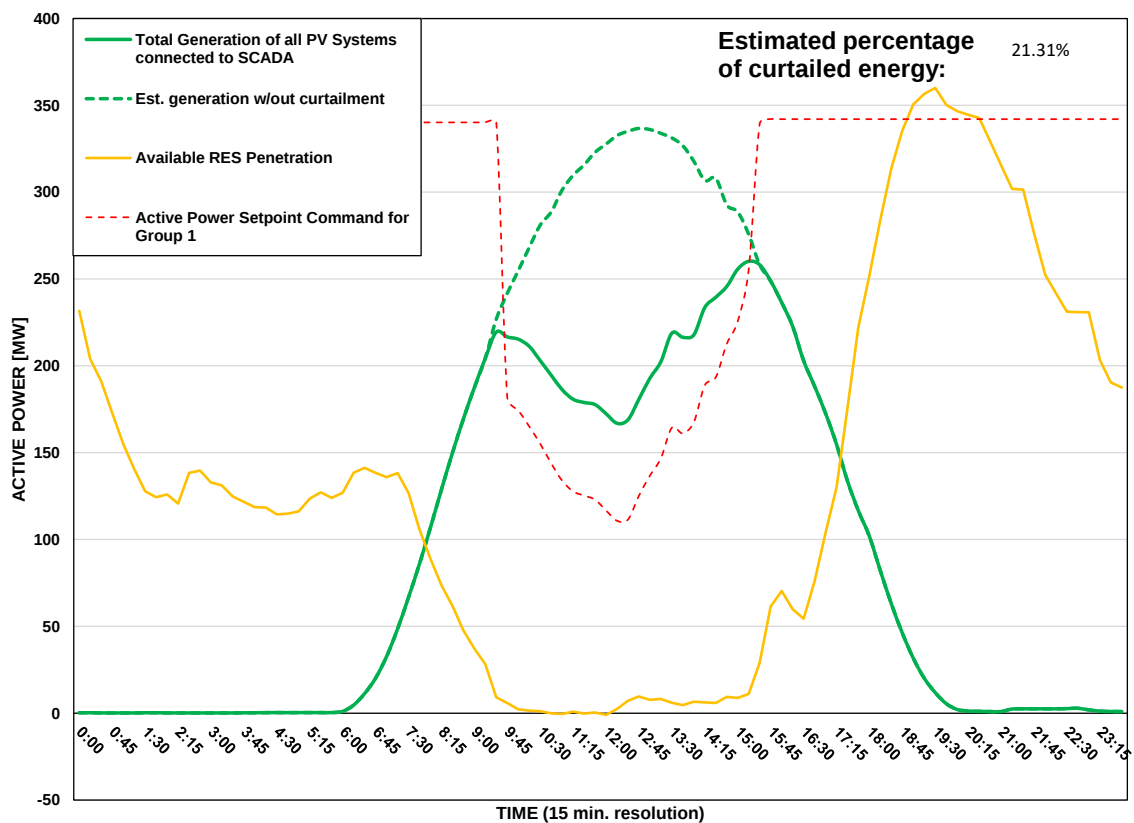

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	17/07/2026
Start of Curtailment (G1 - non Priority)	10:00
End of Curtailment (G1 - non Priority)	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2724.7 MWh
Total Estimated Curtailed Energy:	511.9 MWh
Percentage of Curtailed Energy:	18.79%

Scada PVs Generation on 17/07/2026 (curtailment time: 10:00 - 15:15)

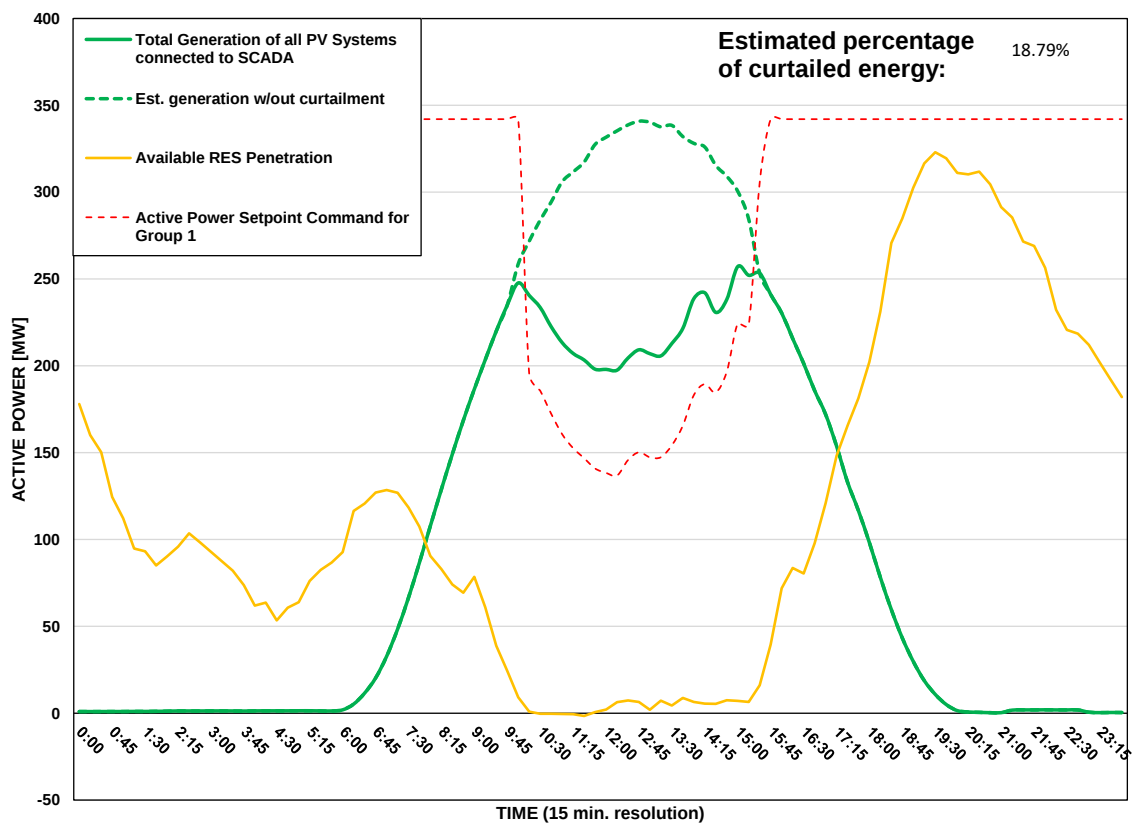

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	18/07/2026
Start of Curtailment (G1 - non Priority)	9:30
End of Curtailment (G1 - non Priority)	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2664.3 MWh
Total Estimated Curtailed Energy:	747.8 MWh
Percentage of Curtailed Energy:	28.07%

Scada PVs Generation on 18/07/2026 (curtailment time: 09:30 - 16:00)

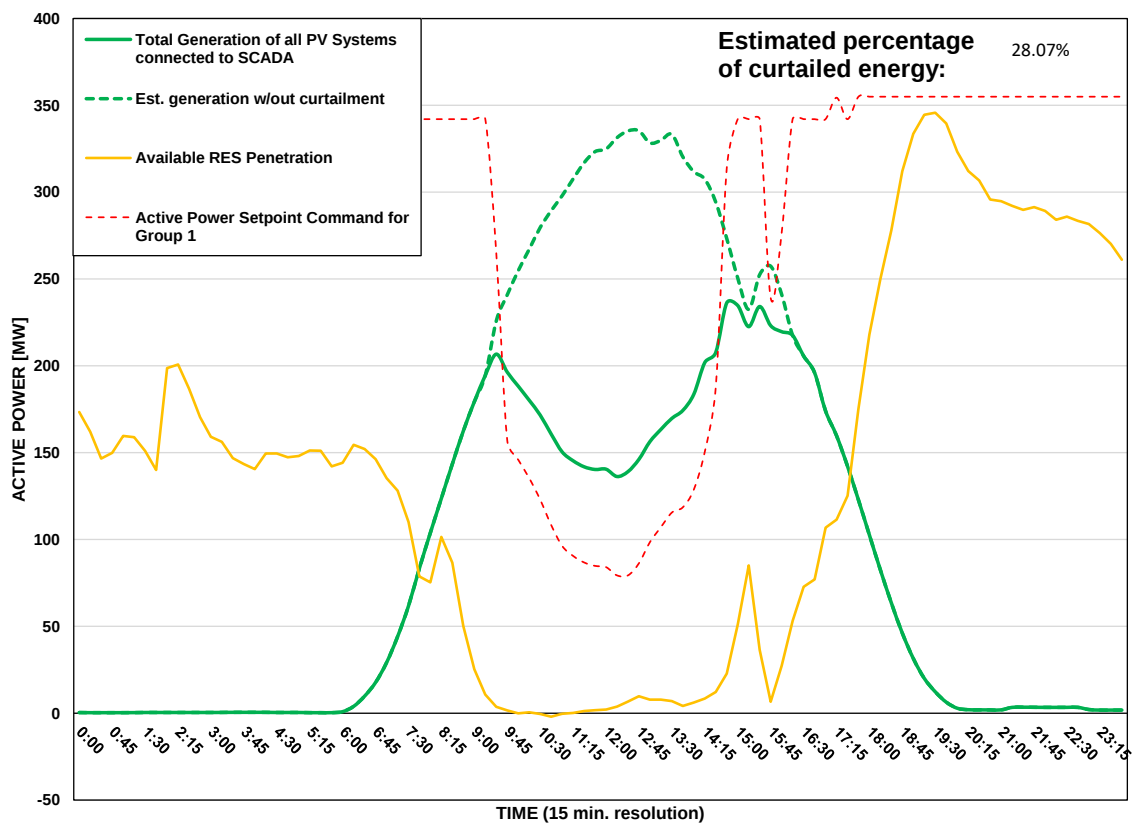


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	19/07/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:30	
Start of Curtailment (G2 - Priority)	11:00	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	16:00	
End of Curtailment (G2 - Priority)	12:30	
Instruction from TSOC	YES	Start of cut-off: 11:15 End of cut-off: 12:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2831 MWh	
Total Estimated Curtailed Energy:	1478.6 MWh	Total Est. Energy of the cut-off PV systems using IoT: 4.3MWh
Percentage of Curtailed Energy:	52.23%	

Scada PVs Generation on 19/07/2026 (curtailment time: 08:30 - 16:00)

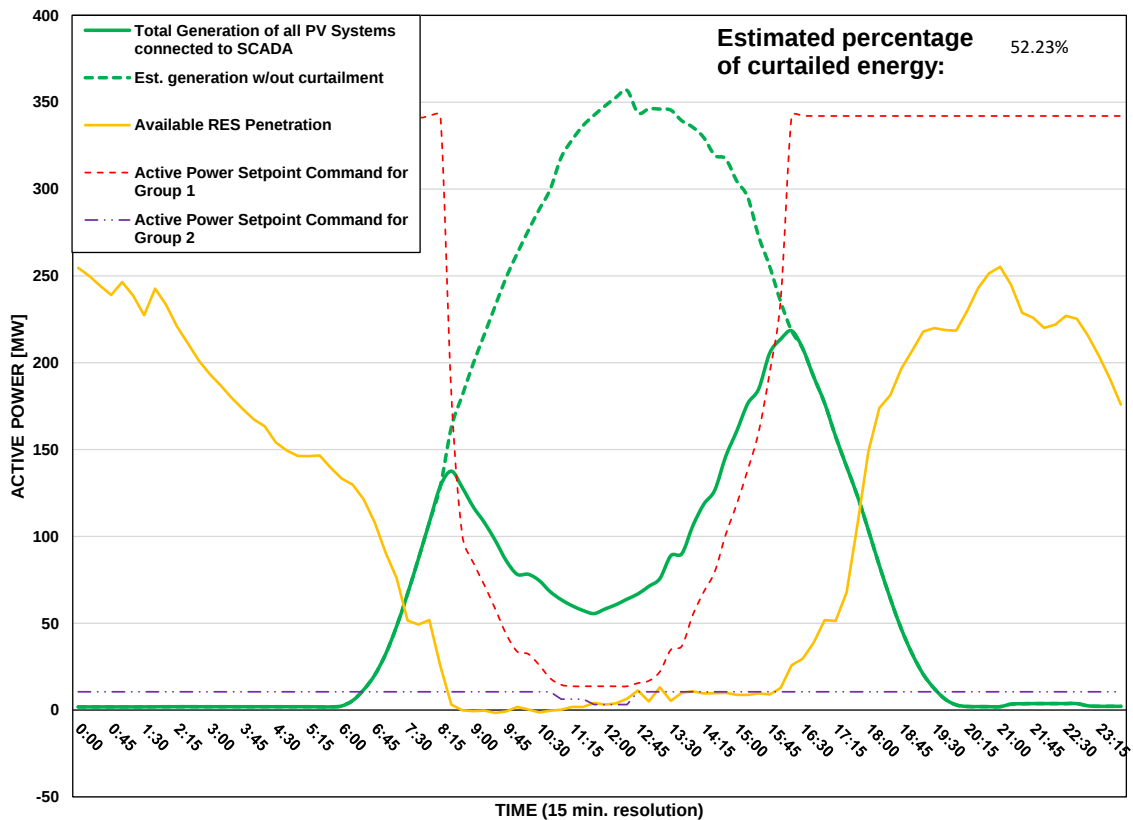

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	20/07/2026
Start of Curtailment (G1 - non Priority)	11:00
	0:00
End of Curtailment (G1 - non Priority)	14:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2695.8 MWh
Total Estimated Curtailed Energy:	192 MWh
Percentage of Curtailed Energy:	7.12%

Scada PVs Generation on 20/07/2026 (curtailment time: 11:00 - 14:00)

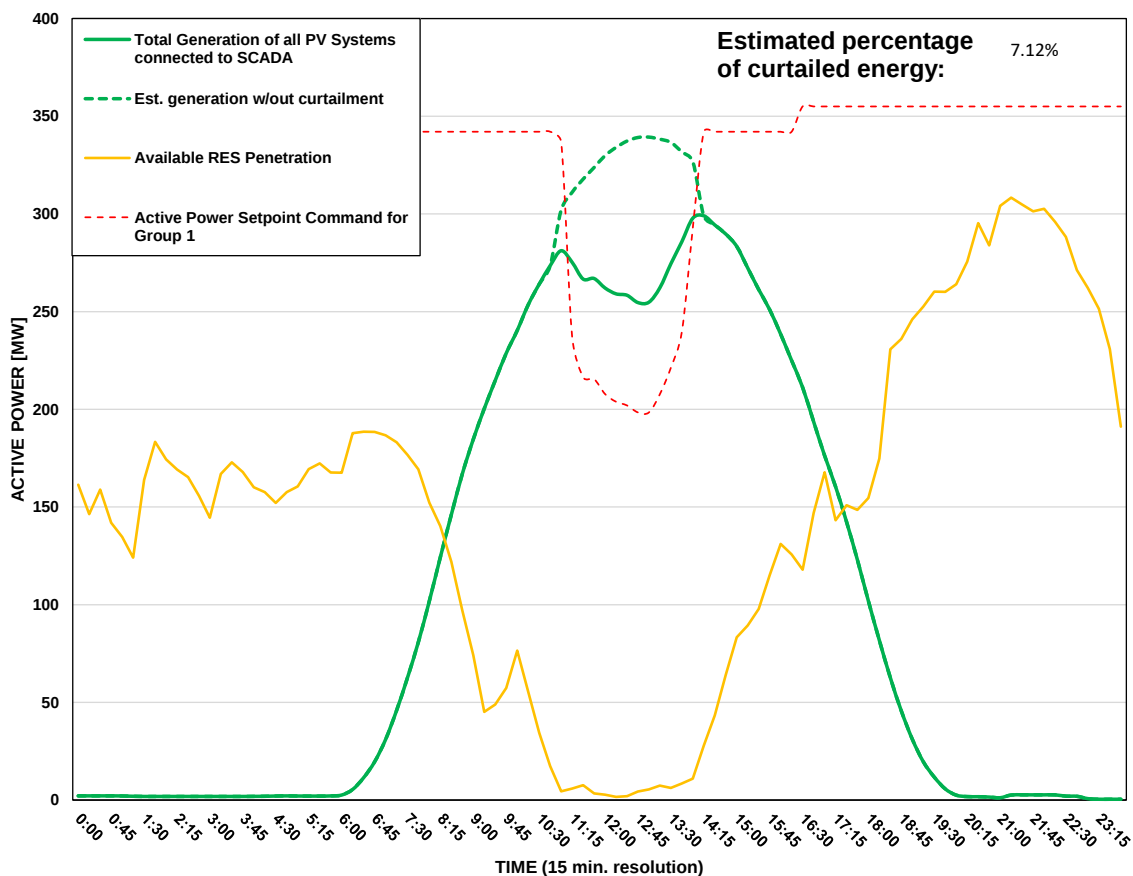

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	21/07/2026
Start of Curtailment (G1 - non Priority)	11:15
End of Curtailment (G1 - non Priority)	13:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2628.8 MWh
Total Estimated Curtailed Energy:	163.4 MWh
Percentage of Curtailed Energy:	6.21%

Scada PVs Generation on 21/07/2026 (curtailment time: 11:15 - 13:45)

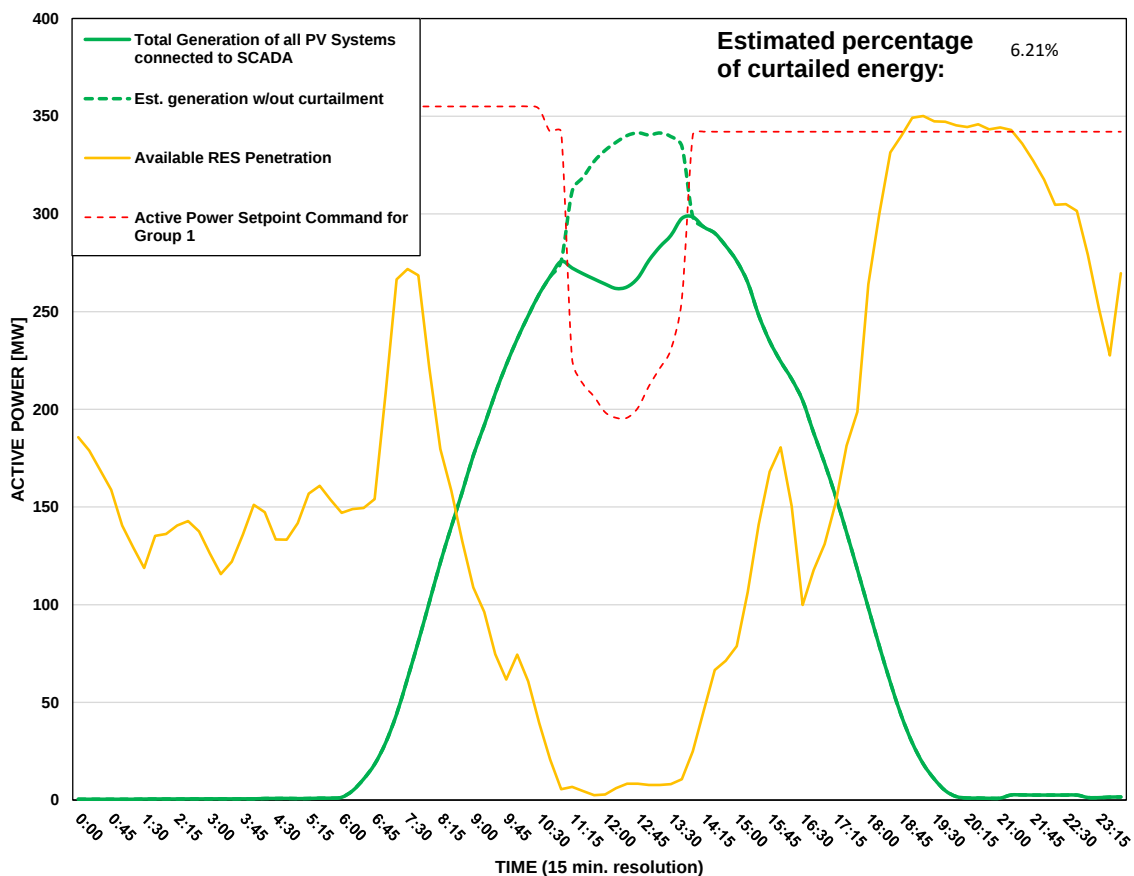

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	22/07/2026
Start of Curtailment (G1 - non Priority)	10:00
End of Curtailment (G1 - non Priority)	14:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2710.6 MWh
Total Estimated Curtailed Energy:	458.8 MWh
Percentage of Curtailed Energy:	16.93%

Scada PVs Generation on 22/07/2026 (curtailment time: 10:00 - 14:45)

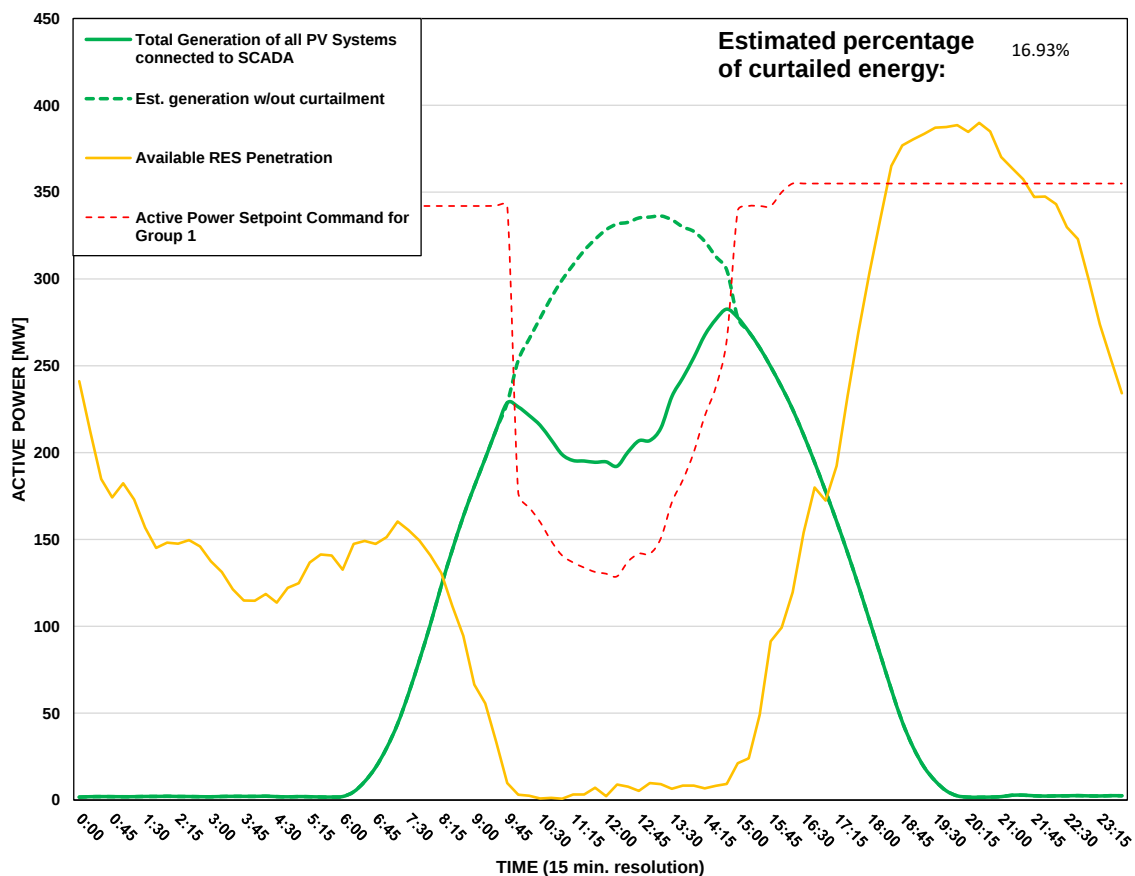

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	23/07/2026
Start of Curtailment (G1 - non Priority)	10:00
End of Curtailment (G1 - non Priority)	15:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2715.1 MWh
Total Estimated Curtailed Energy:	599.3 MWh
Percentage of Curtailed Energy:	22.07%

Scada PVs Generation on 23/07/2026 (curtailment time: 10:00 - 15:00)

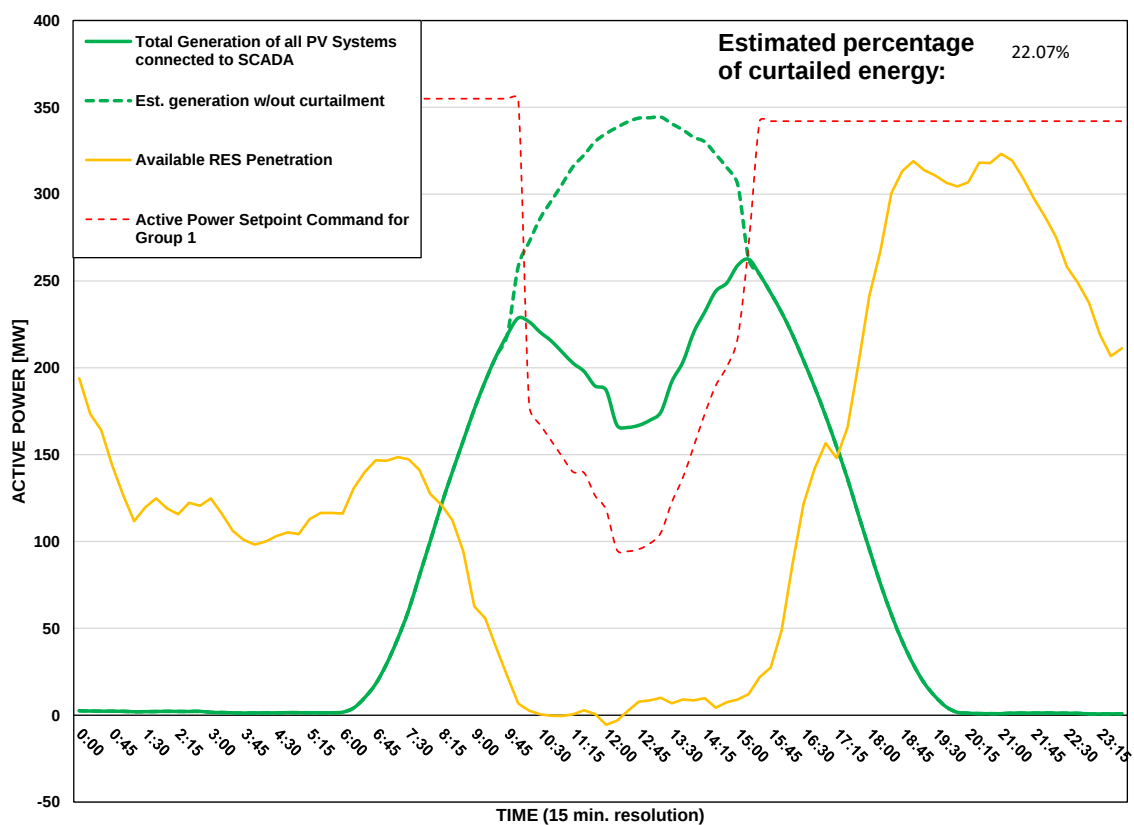

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	24/07/2026
Start of Curtailment (G1 - non Priority)	10:00
End of Curtailment (G1 - non Priority)	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2533.8 MWh
Total Estimated Curtailed Energy:	723.2 MWh
Percentage of Curtailed Energy:	28.54%

Scada PVs Generation on 24/07/2026 (curtailment time: 10:00 - 15:30)

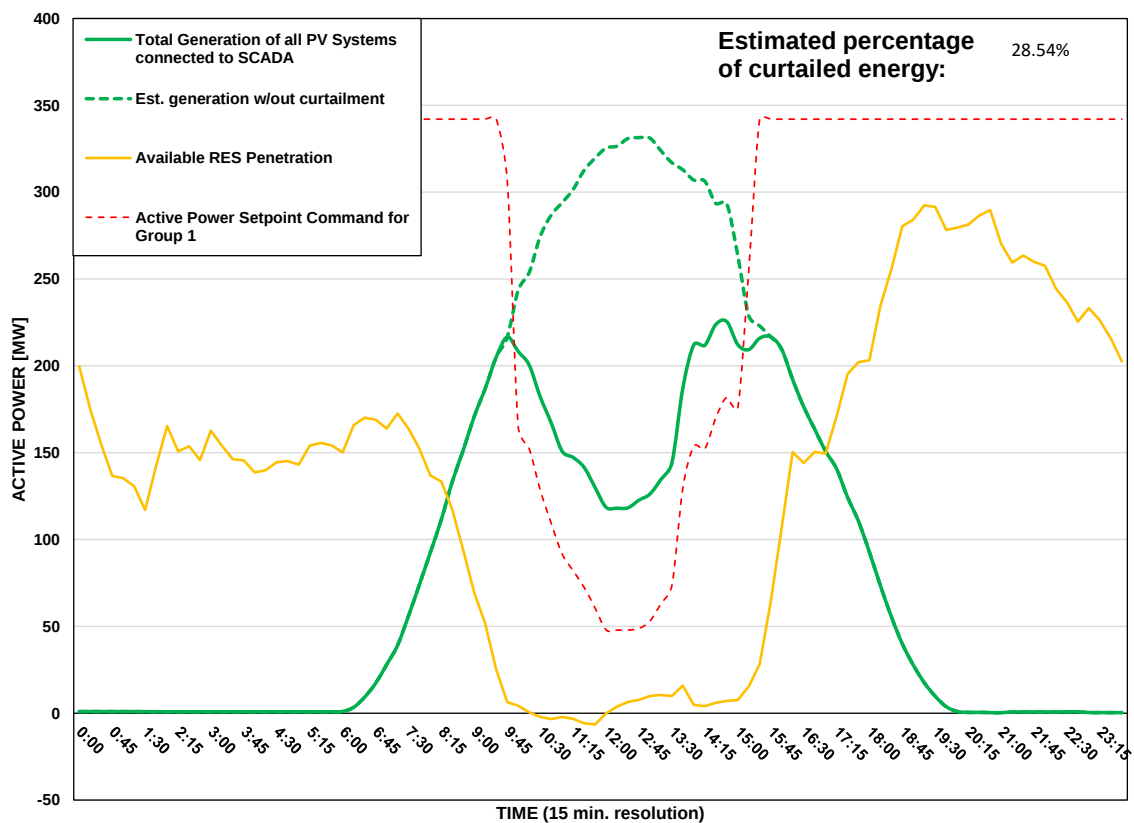


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	25/07/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:45	
Start of Curtailment (G2 - Priority)	10:30	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	17:45	
End of Curtailment (G2 - Priority)	12:30	
Instruction from TSOC	YES	Start of cut-off: 10:30 End of cut-off: 12:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2370.2 MWh	
Total Estimated Curtailed Energy:	1410.2 MWh	Total Est. Energy of the cut-off PV systems using IoT: 6.5MWh
Percentage of Curtailed Energy:	59.5%	

Scada PVs Generation on 25/07/2026 (curtailment time: 08:45 - 17:45)

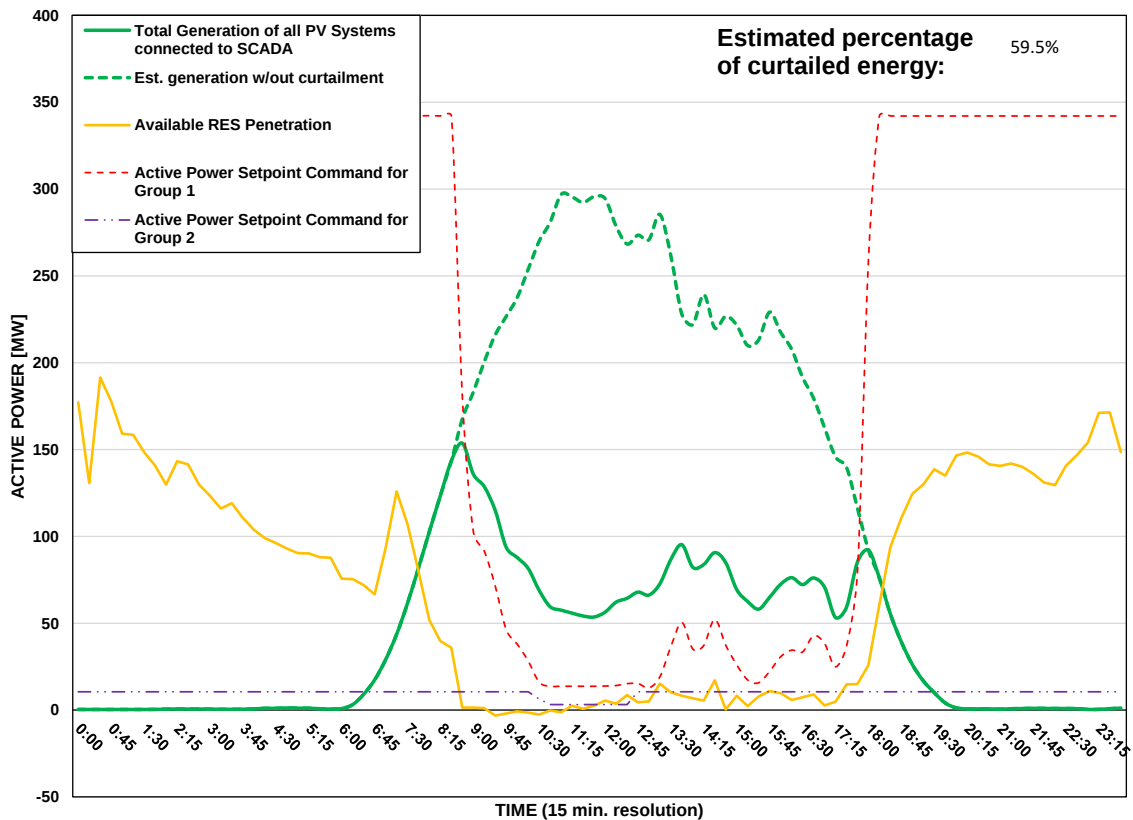


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	26/07/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:15	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
Start of Curtailment (G2 - Priority)	10:45	
End of Curtailment (G1 - non Priority)	17:30	
End of Curtailment (G2 - Priority)	15:00	
Instruction from TSOC	YES	Start of cut-off: 10:45 End of cut-off: 15:00
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2746.3 MWh	
Total Estimated Curtailed Energy:	1755.5 MWh	Total Est. Energy of the cut-off PV systems using IoT: 13.6MWh
Percentage of Curtailed Energy:	63.92%	

Scada PVs Generation on 26/07/2026 (curtailment time: 08:15 - 17:30)

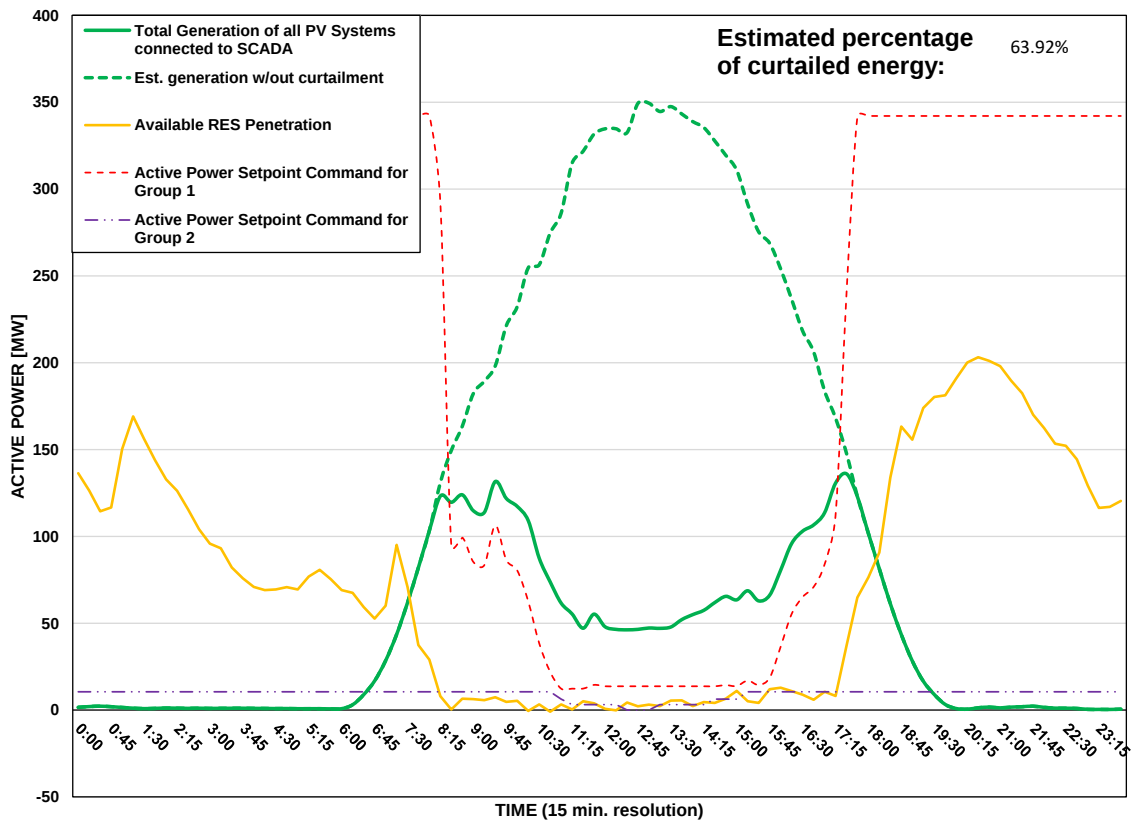

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	27/07/2026
Start of Curtailment (G1 - non Priority)	9:30
End of Curtailment (G1 - non Priority)	17:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2835.8 MWh
Total Estimated Curtailed Energy:	879.4 MWh
Percentage of Curtailed Energy:	31.01%

Scada PVs Generation on 27/07/2026 (curtailment time: 09:30 - 17:15)

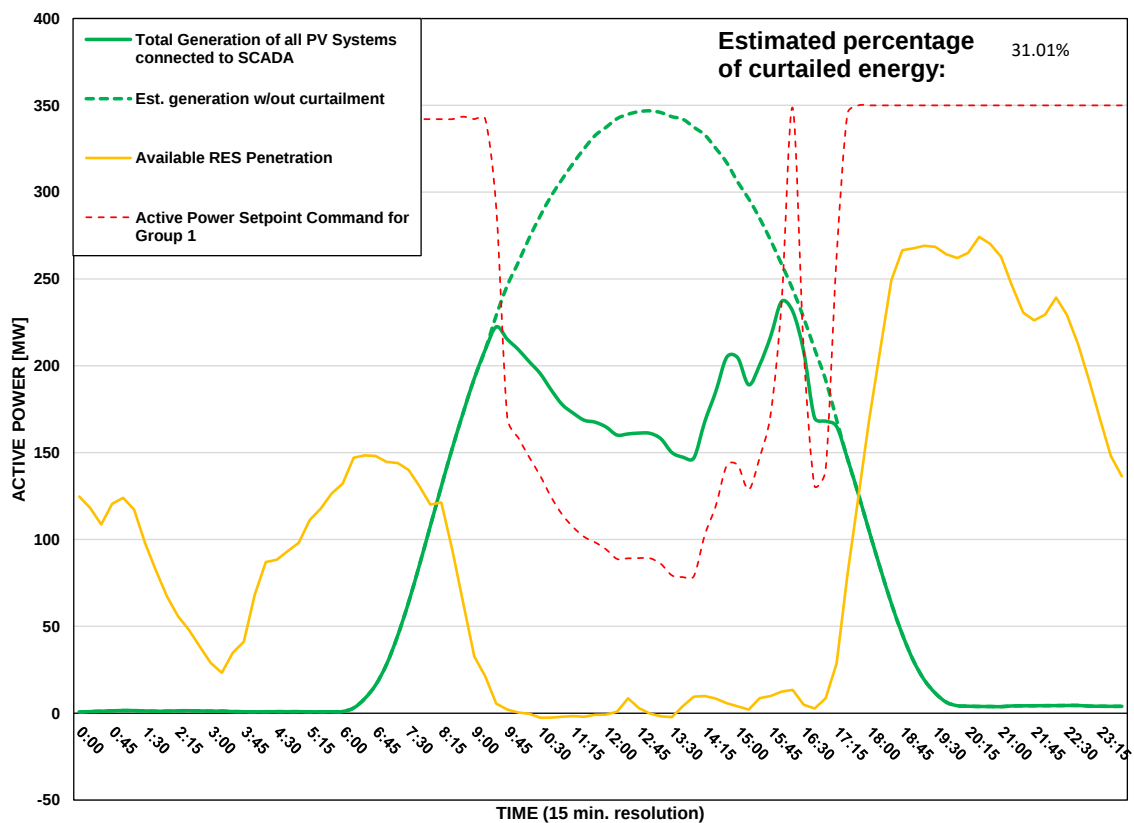

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	28/07/2026
Start of Curtailment (G1 - non Priority)	9:00
End of Curtailment (G1 - non Priority)	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2836.2 MWh
Total Estimated Curtailed Energy:	963 MWh
Percentage of Curtailed Energy:	33.95%

Scada PVs Generation on 28/07/2026 (curtailment time: 09:00 - 15:30)

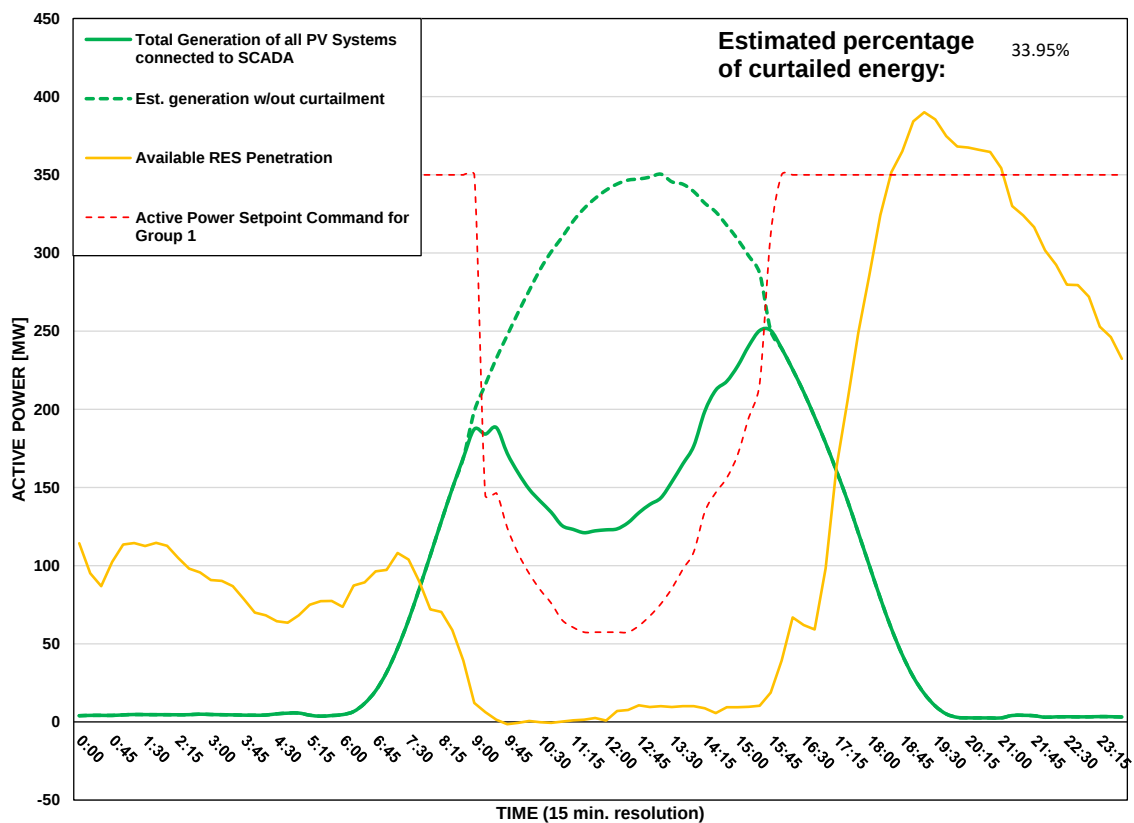

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	29/07/2026
Start of Curtailment (G1 - non Priority)	9:30
End of Curtailment (G1 - non Priority)	15:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2818.8 MWh
Total Estimated Curtailed Energy:	657 MWh
Percentage of Curtailed Energy:	23.31%

Scada PVs Generation on 29/07/2026 (curtailment time: 09:30 - 15:30)

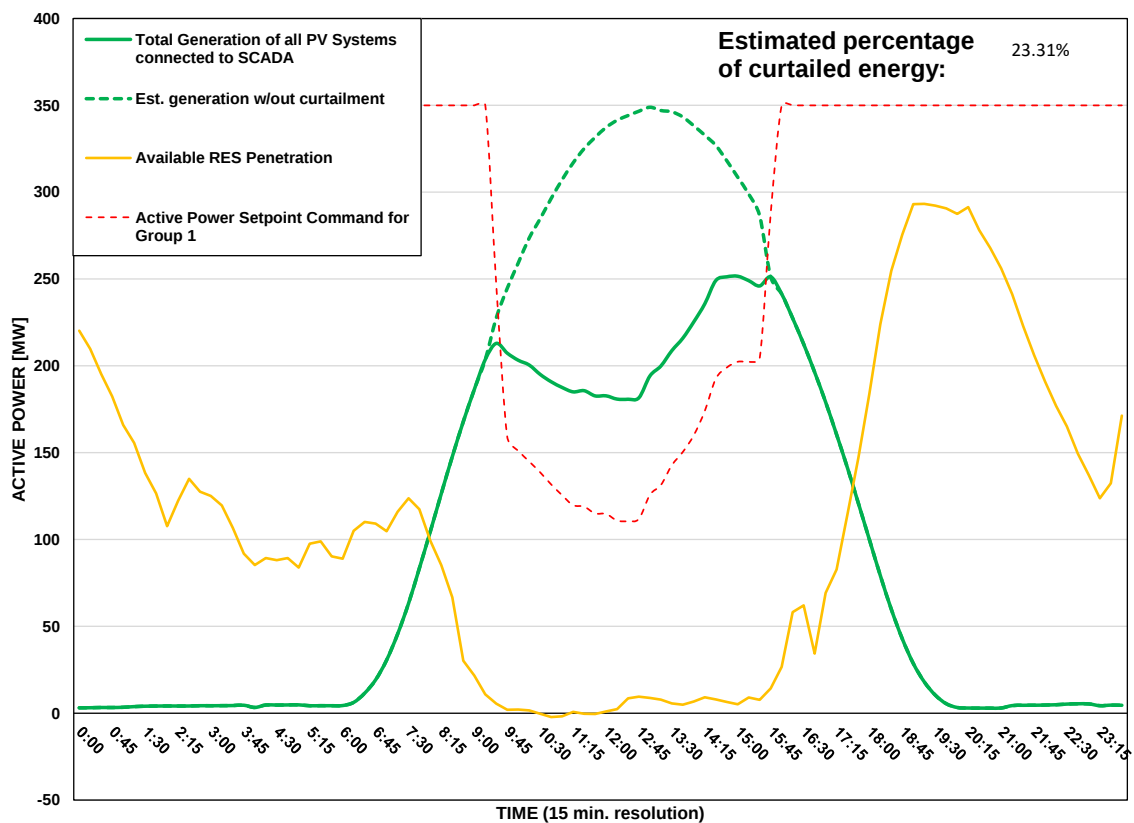

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	30/07/2026
Start of Curtailment (G1 - non Priority)	9:45
End of Curtailment (G1 - non Priority)	14:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2809.9 MWh
Total Estimated Curtailed Energy:	584.5 MWh
Percentage of Curtailed Energy:	20.8%

Scada PVs Generation on 30/07/2026 (curtailment time: 09:45 - 14:45)

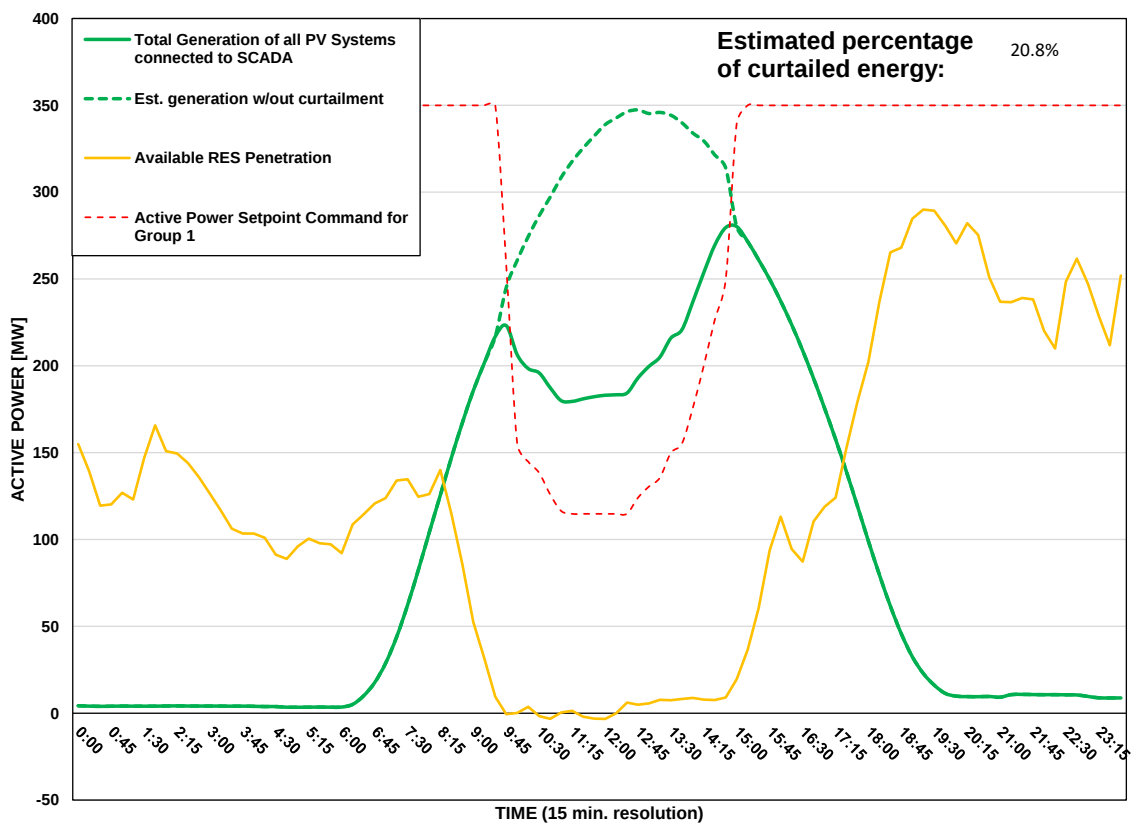

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	31/07/2026
Start of Curtailment (G1 - non Priority)	9:45
End of Curtailment (G1 - non Priority)	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2818.2 MWh
Total Estimated Curtailed Energy:	755.3 MWh
Percentage of Curtailed Energy:	26.8%

Scada PVs Generation on 31/07/2026 (curtailment time: 09:45 - 15:45)

