

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	01/09/2026
Start of Curtailment (G1 - non Priority)	10:00
End of Curtailment (G1 - non Priority)	14:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2487.3 MWh
Total Estimated Curtailed Energy:	378.9 MWh
Percentage of Curtailed Energy:	15.23%

Scada PVs Generation on 01/09/2026 (curtailment time: 10:00 - 14:15)

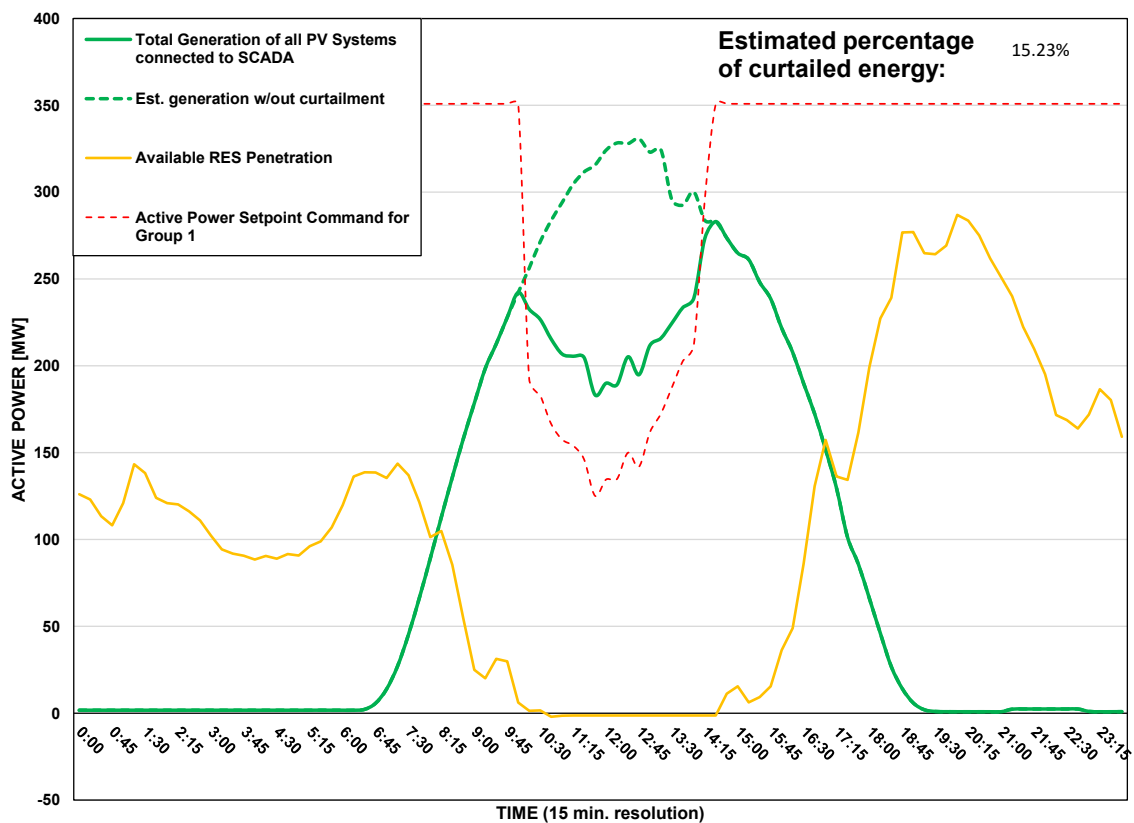

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	02/09/2026
Start of Curtailment (G1 - non Priority)	10:00
End of Curtailment (G1 - non Priority)	15:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2543.2 MWh
Total Estimated Curtailed Energy:	425.5 MWh
Percentage of Curtailed Energy:	16.74%

Scada PVs Generation on 02/09/2026 (curtailment time: 10:00 - 15:00)

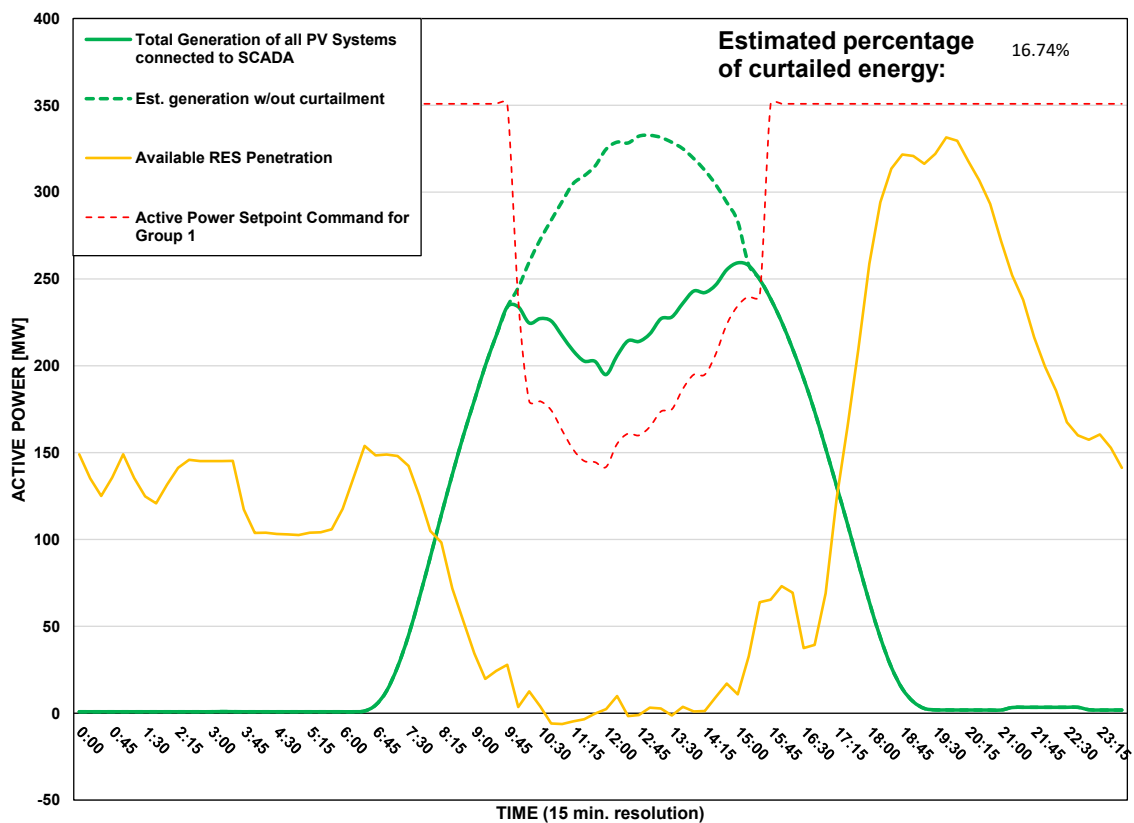

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	03/09/2026
Start of Curtailment (G1 - non Priority)	10:15
End of Curtailment (G1 - non Priority)	14:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2502.8 MWh
Total Estimated Curtailed Energy:	246.2 MWh
Percentage of Curtailed Energy:	9.84%

Scada PVs Generation on 03/09/2026 (curtailment time: 10:15 - 14:15)

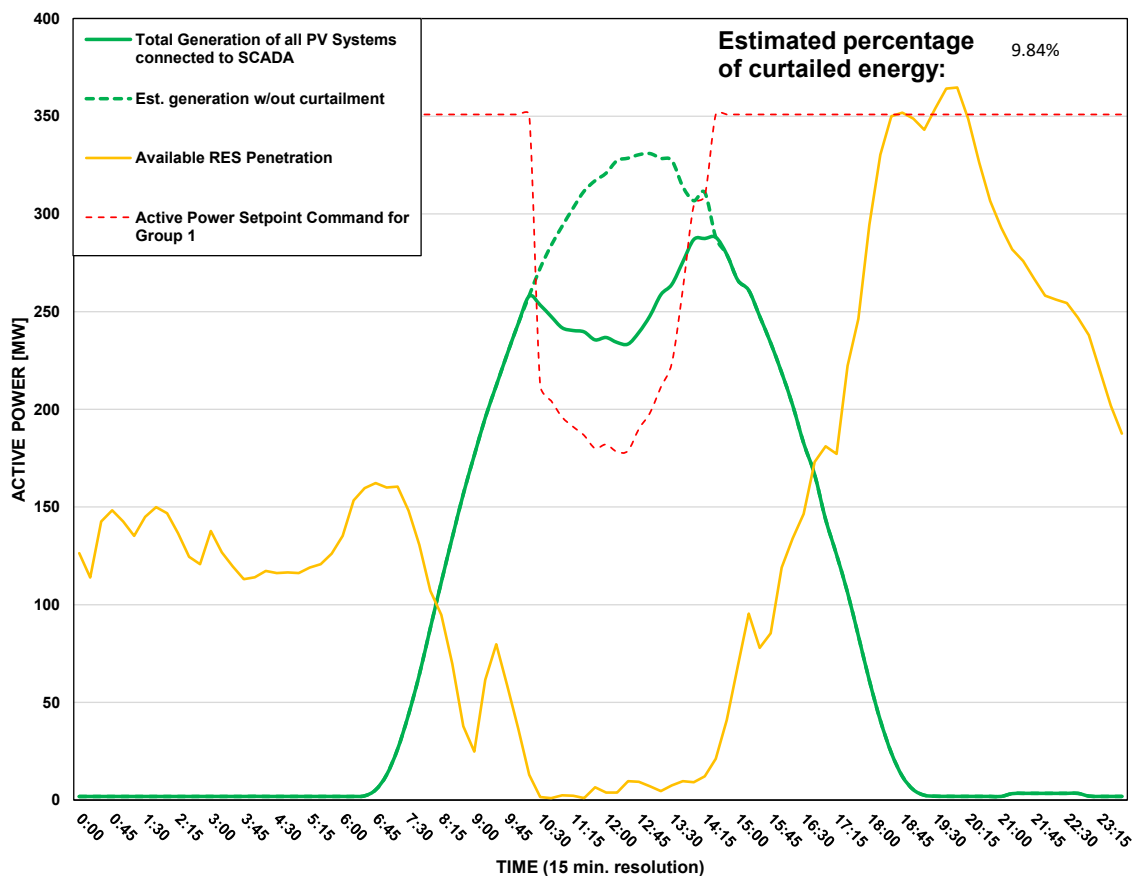


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	04/09/2026
Start of Curtailment (G1 - non Priority)	9:00
Start of Curtailment (G2 - Priority)	9:15
End of Curtailment (G1 - non Priority)	15:30
End of Curtailment (G2 - Priority)	12:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2404.9 MWh
Total Estimated Curtailed Energy:	752.1 MWh
Percentage of Curtailed Energy:	31.28%

Scada PVs Generation on 04/09/2026 (curtailment time: 09:00 - 15:30)

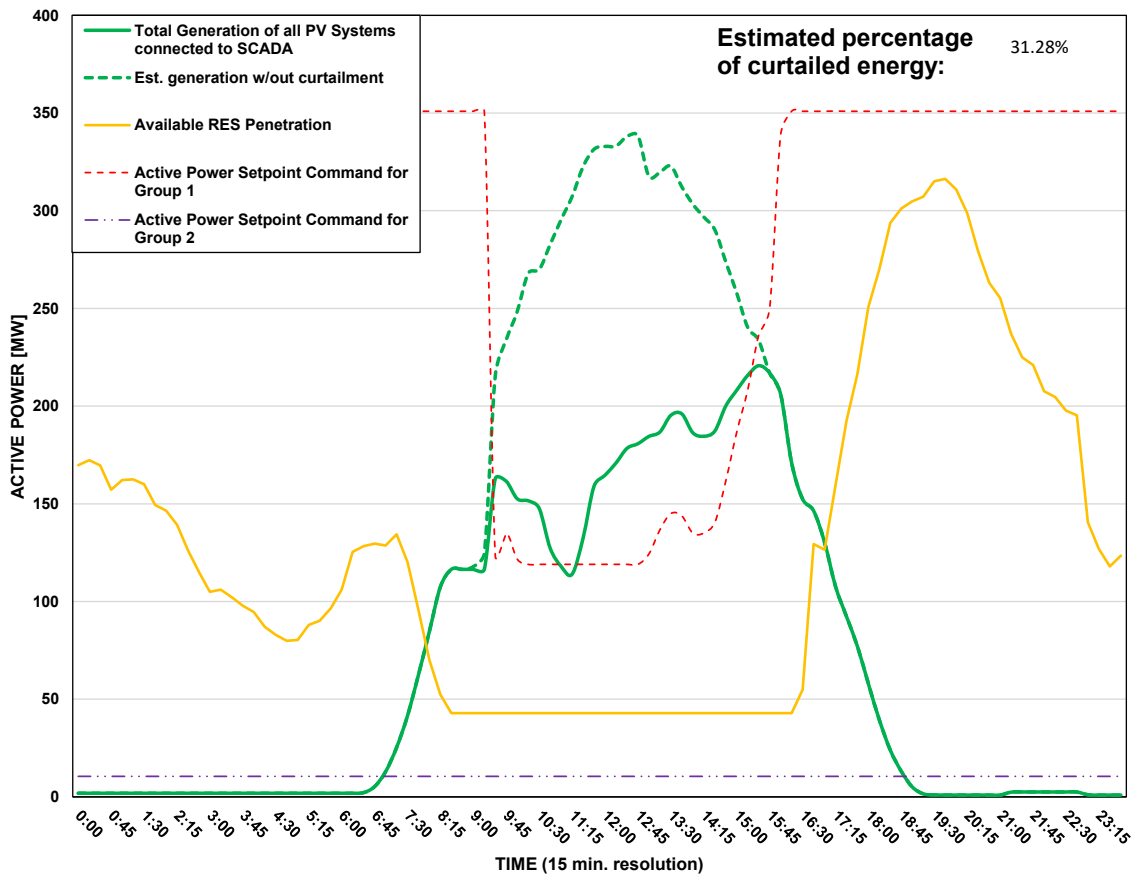


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	05/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:15	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
Start of Curtailment (G2 - Priority)	11:00	
End of Curtailment (G1 - non Priority)	15:45	
End of Curtailment (G2 - Priority)	14:00	
Instruction from TSOC	YES	Start of cut-off: 11:00 End of cut-off: 14:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2436.1 MWh	
Total Estimated Curtailed Energy:	1249.9 MWh	Total Est. Energy of the cut-off PV systems using IoT: 13.1MWh
Percentage of Curtailed Energy:	51.31%	

Scada PVs Generation on 05/09/2026 (curtailment time: 08:15 - 15:45)

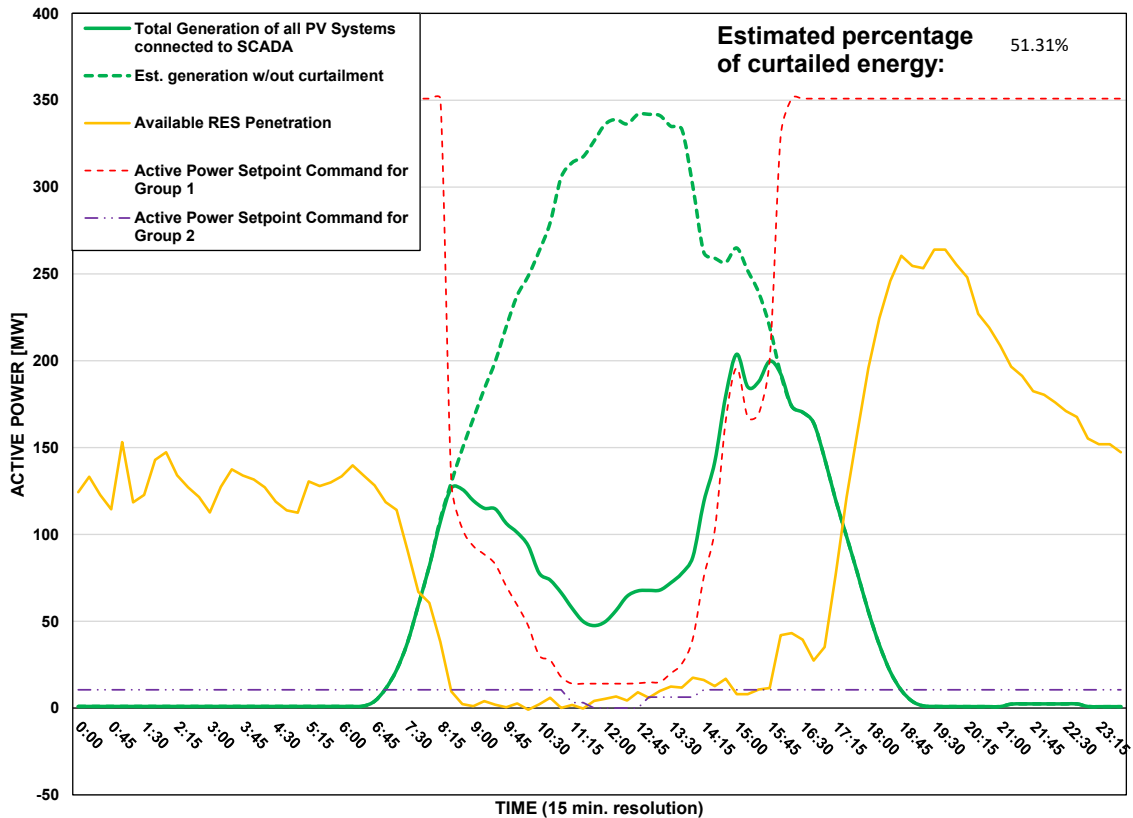


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	06/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:30	
Start of Curtailment (G2 - Priority)	10:45	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	16:00	
End of Curtailment (G2 - Priority)	14:30	
Instruction from TSOC	YES	Start of cut-off: 10:45 End of cut-off: 14:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2561.9 MWh	
Total Estimated Curtailed Energy:	1467.4 MWh	Total Est. Energy of the cut-off PV systems using IoT: 13.5MWh
Percentage of Curtailed Energy:	57.28%	

Scada PVs Generation on 06/09/2026 (curtailment time: 08:30 - 16:00)

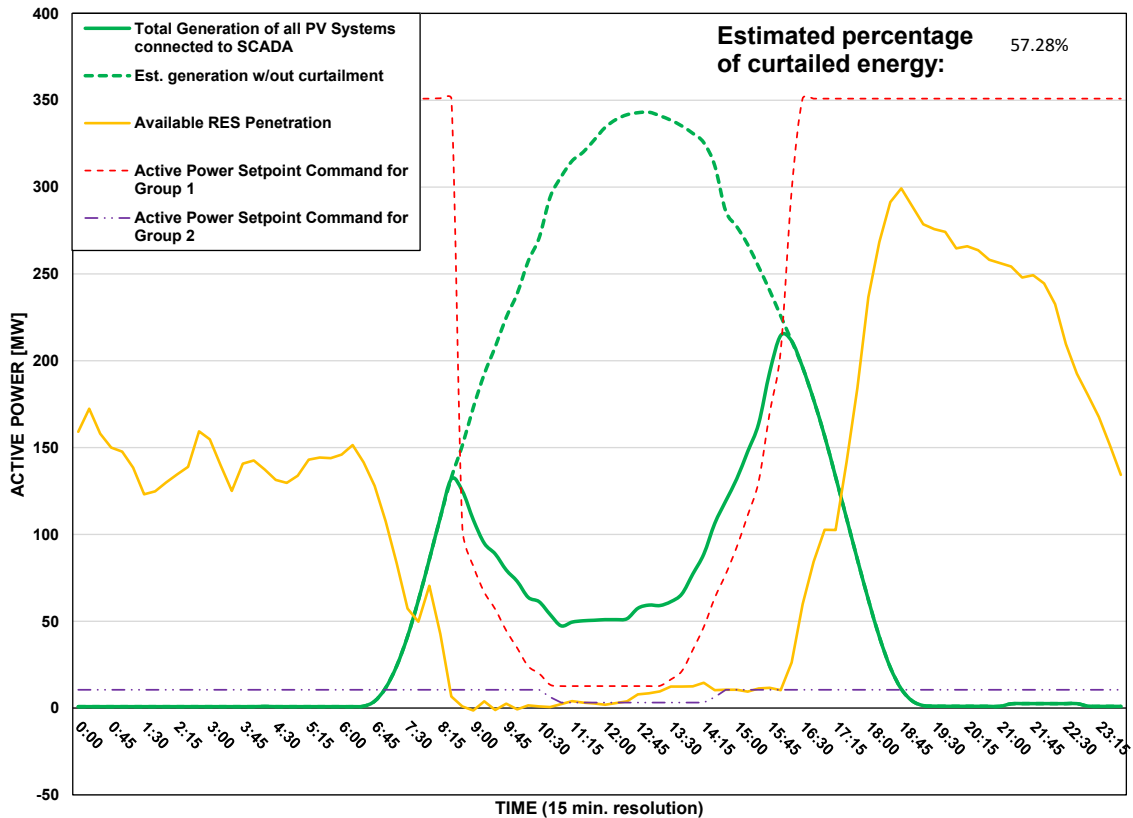

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	07/09/2026
Start of Curtailment (G1 - non Priority)	9:30
End of Curtailment (G1 - non Priority)	15:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2557 MWh
Total Estimated Curtailed Energy:	584.9 MWh
Percentage of Curtailed Energy:	22.87%

Scada PVs Generation on 07/09/2026 (curtailment time: 09:30 - 15:00)

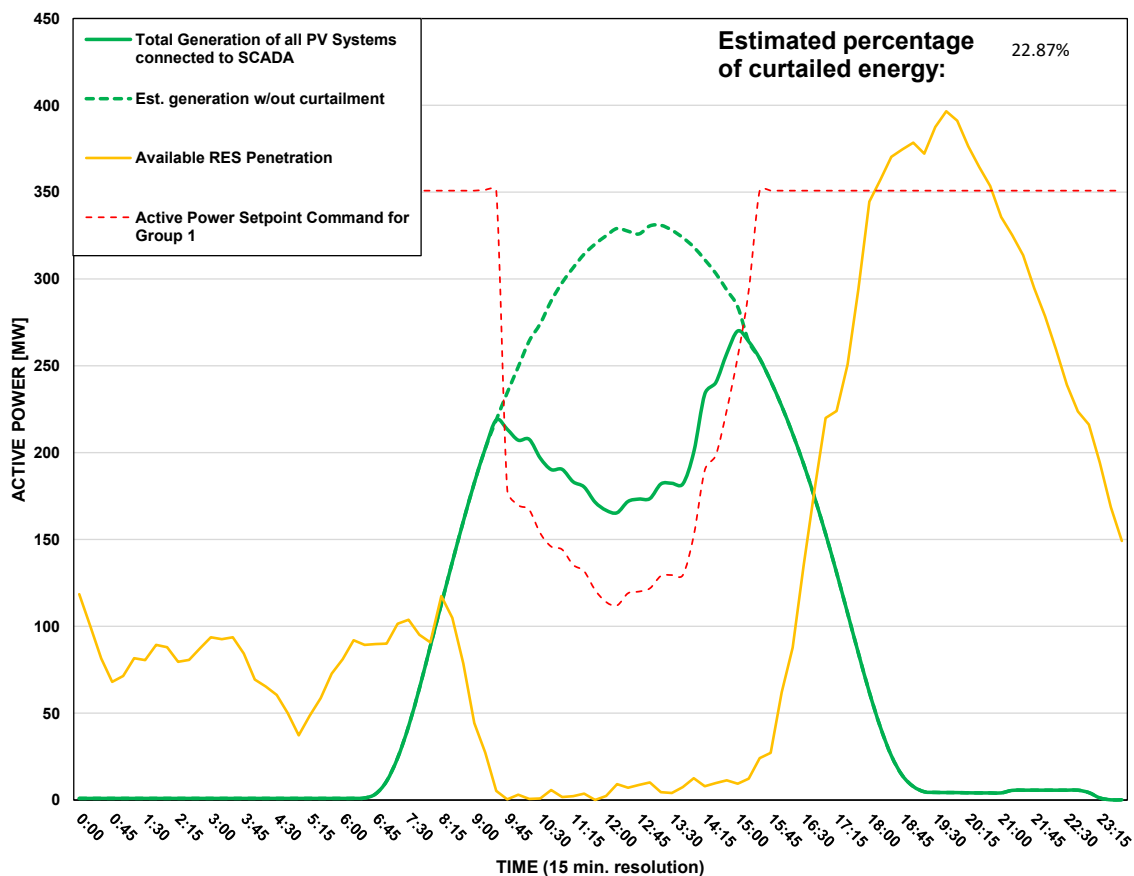

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	08/09/2026
Start of Curtailment (G1 - non Priority)	9:30
End of Curtailment (G1 - non Priority)	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2516.2 MWh
Total Estimated Curtailed Energy:	973.4 MWh
Percentage of Curtailed Energy:	38.69%

Scada PVs Generation on 08/09/2026 (curtailment time: 09:30 - 16:15)

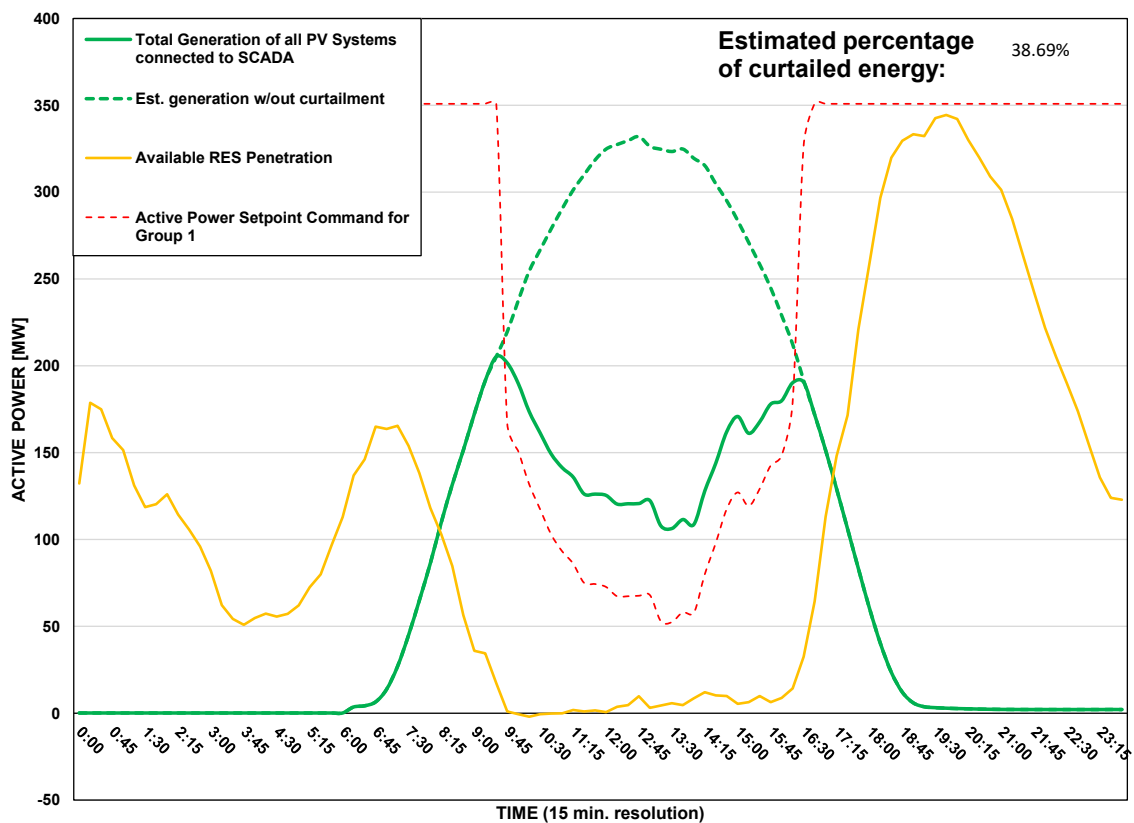


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	09/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	9:00	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
Start of Curtailment (G2 - Priority)	12:00	
End of Curtailment (G1 - non Priority)	16:30	
End of Curtailment (G2 - Priority)	13:45	
Instruction from TSOC	YES	Start of cut-off: 12:00 End of cut-off: 13:45
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2495 MWh	
Total Estimated Curtailed Energy:	1222.1 MWh	Total Est. Energy of the cut-off PV systems using IoT: 3.9MWh
Percentage of Curtailed Energy:	48.98%	

Scada PVs Generation on 09/09/2026 (curtailment time: 09:00 - 16:30)

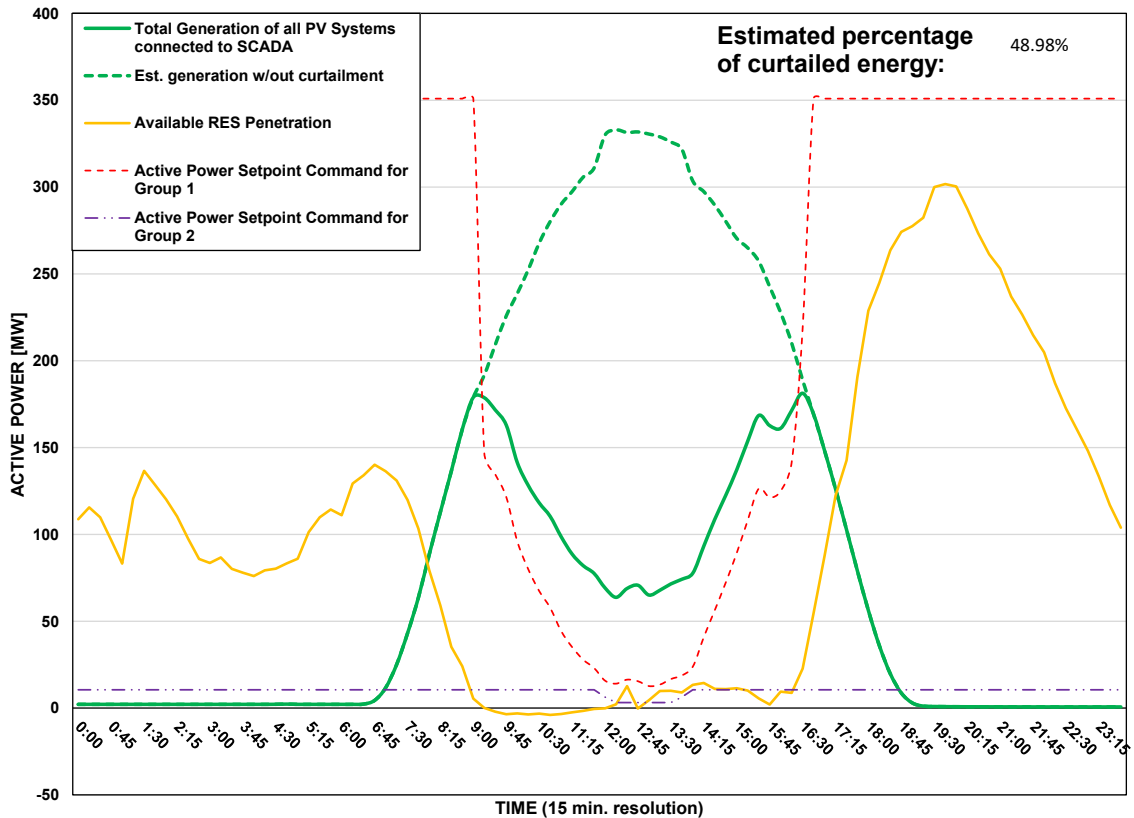

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	10/09/2026
Start of Curtailment (G1 - non Priority)	9:00
End of Curtailment (G1 - non Priority)	16:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2471.9 MWh
Total Estimated Curtailed Energy:	1113.6 MWh
Percentage of Curtailed Energy:	45.05%

Scada PVs Generation on 10/09/2026 (curtailment time: 09:00 - 16:15)

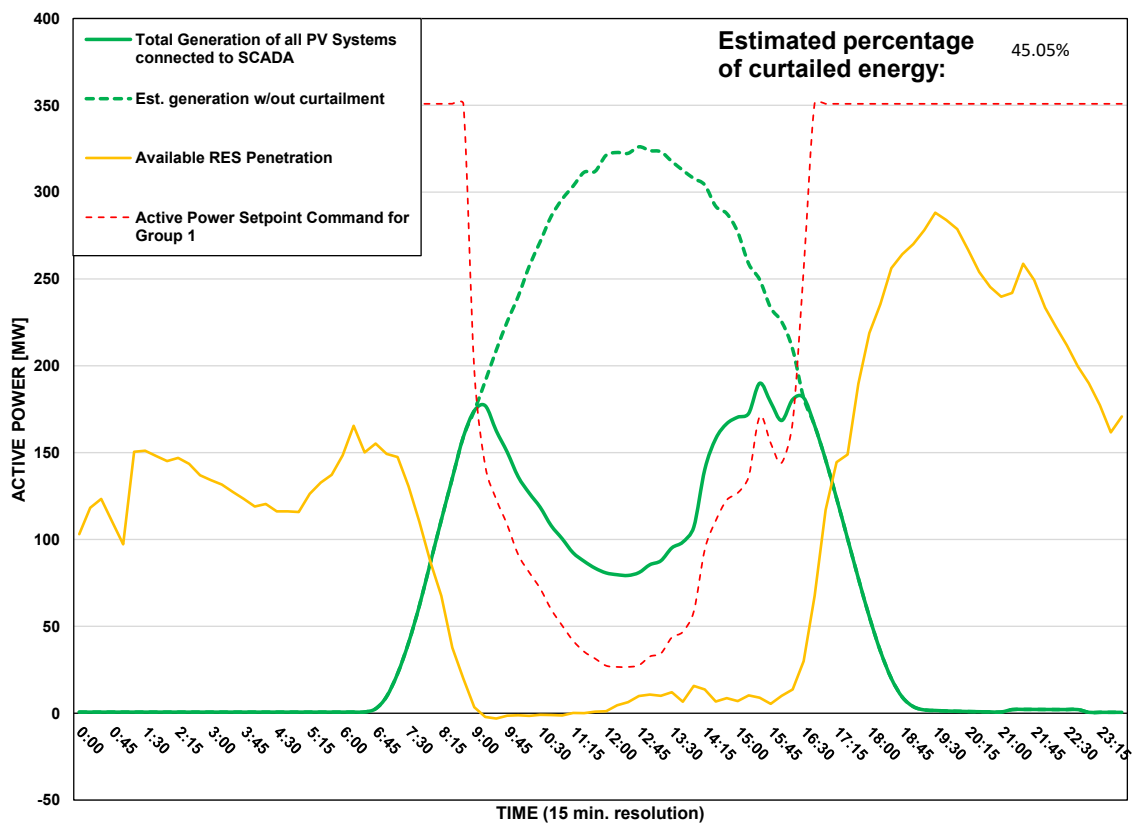

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	11/09/2026
Start of Curtailment (G1 - non Priority)	9:00
End of Curtailment (G1 - non Priority)	16:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2495.7 MWh
Total Estimated Curtailed Energy:	1207.7 MWh
Percentage of Curtailed Energy:	48.39%

Scada PVs Generation on 11/09/2026 (curtailment time: 09:00 - 16:00)

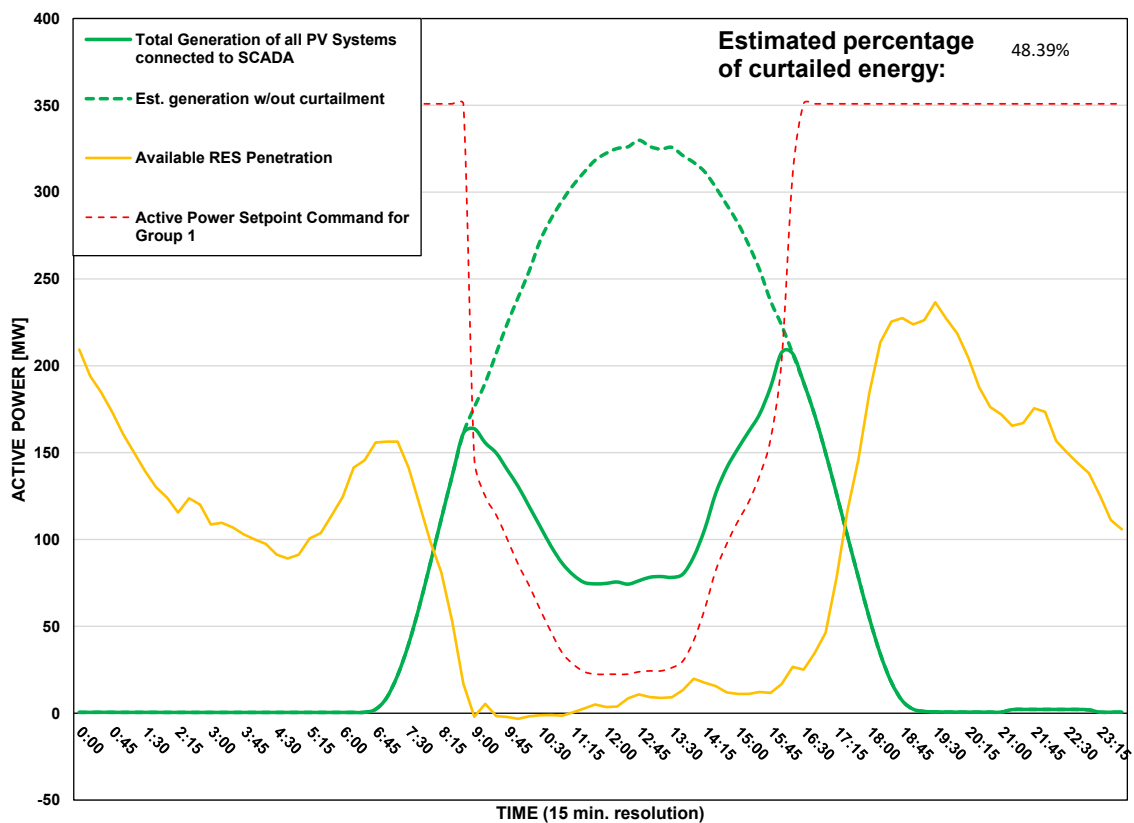


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	12/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:30	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
Start of Curtailment (G2 - Priority)	11:00	
End of Curtailment (G1 - non Priority)	16:15	
End of Curtailment (G2 - Priority)	13:00	
Instruction from TSOC	YES	Start of cut-off: 11:15 End of cut-off: 13:00
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2473.9 MWh	
Total Estimated Curtailed Energy:	1359.3 MWh	Total Est. Energy of the cut-off PV systems using IoT: 5.2MWh
Percentage of Curtailed Energy:	54.95%	

Scada PVs Generation on 12/09/2026 (curtailment time: 08:30 - 16:15)

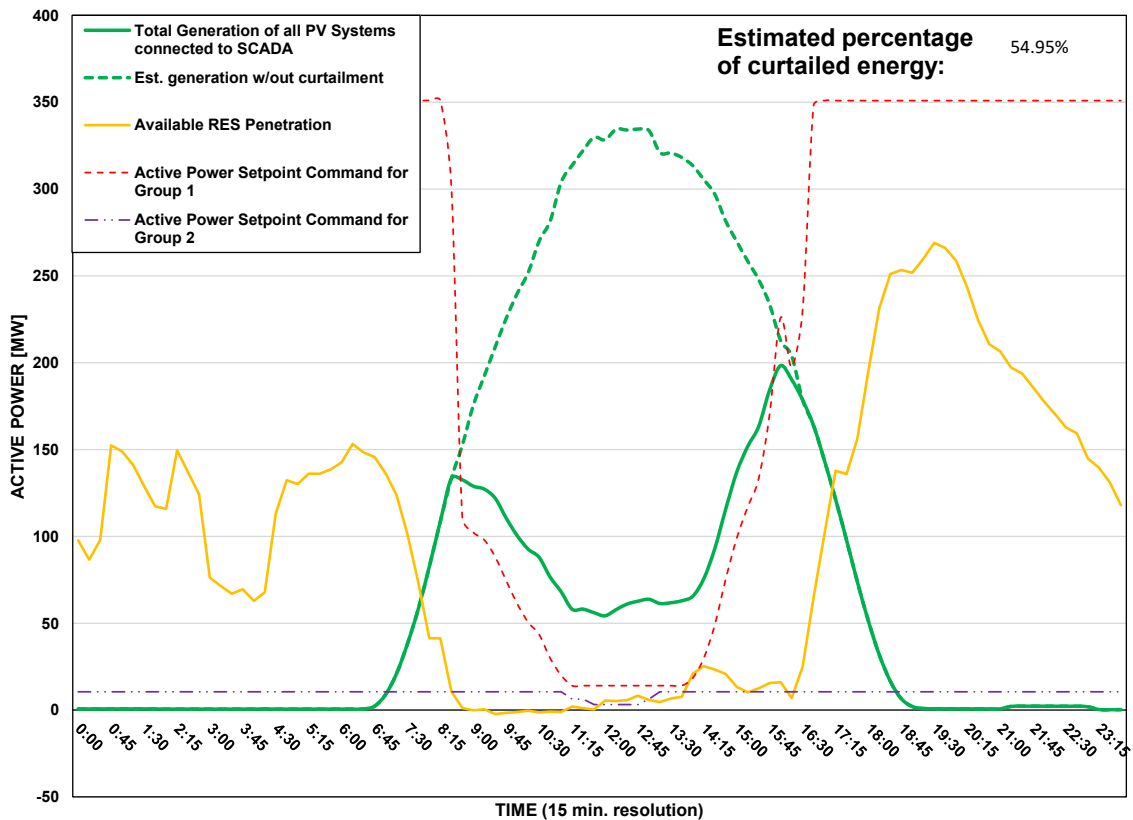


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	13/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:15	
Start of Curtailment (G2 - Priority)	9:30	Cut-off areas using IoT: PV-NIC1, PV-NIC4, PV-NIC7, PV-LCA/FAM1, PV-LIM2, PV-LIM4, PV-PAF2, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	16:00	
End of Curtailment (G2 - Priority)	14:45	
Instruction from TSOC	YES	Start of cut-off: 10:15 End of cut-off: 14:45
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2430.5 MWh	
Total Estimated Curtailed Energy:	1500.9 MWh	Total Est. Energy of the cut-off PV systems using IoT: 43.1MWh
Percentage of Curtailed Energy:	61.75%	

Scada PVs Generation on 13/09/2026 (curtailment time: 08:15 - 16:00)

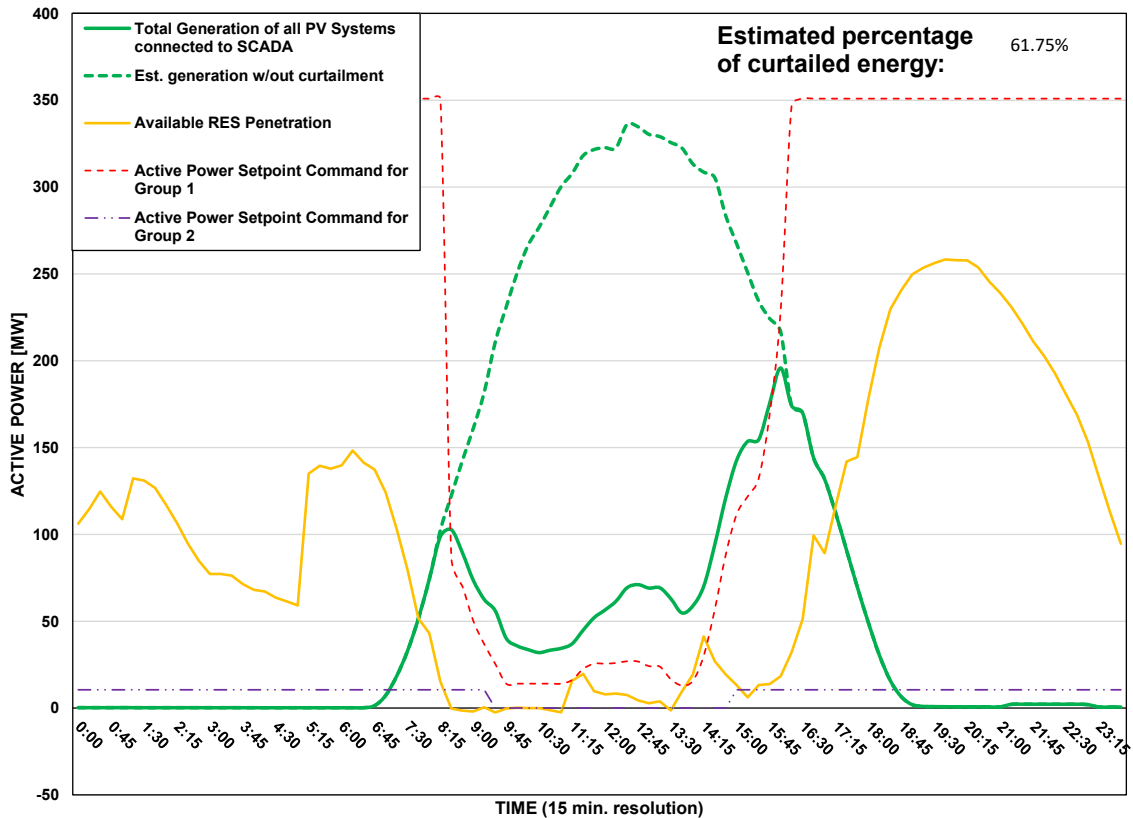

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	14/09/2026
Start of Curtailment (G1 - non Priority)	9:30
End of Curtailment (G1 - non Priority)	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2351.7 MWh
Total Estimated Curtailed Energy:	748.7 MWh
Percentage of Curtailed Energy:	31.84%

Scada PVs Generation on 14/09/2026 (curtailment time: 09:30 - 15:45)

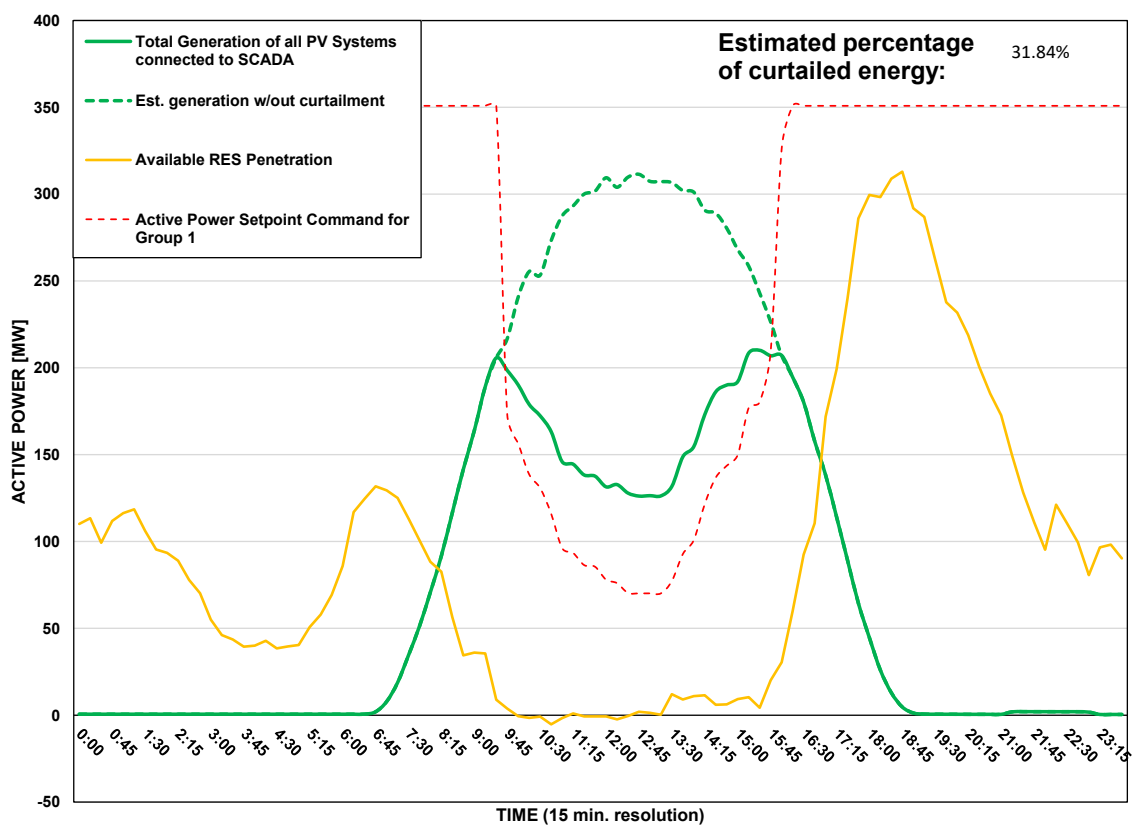

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	15/09/2026
Start of Curtailment (G1 - non Priority)	9:15
End of Curtailment (G1 - non Priority)	15:15
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2328.4 MWh
Total Estimated Curtailed Energy:	519.5 MWh
Percentage of Curtailed Energy:	22.31%

Scada PVs Generation on 15/09/2026 (curtailment time: 09:15 - 15:15)

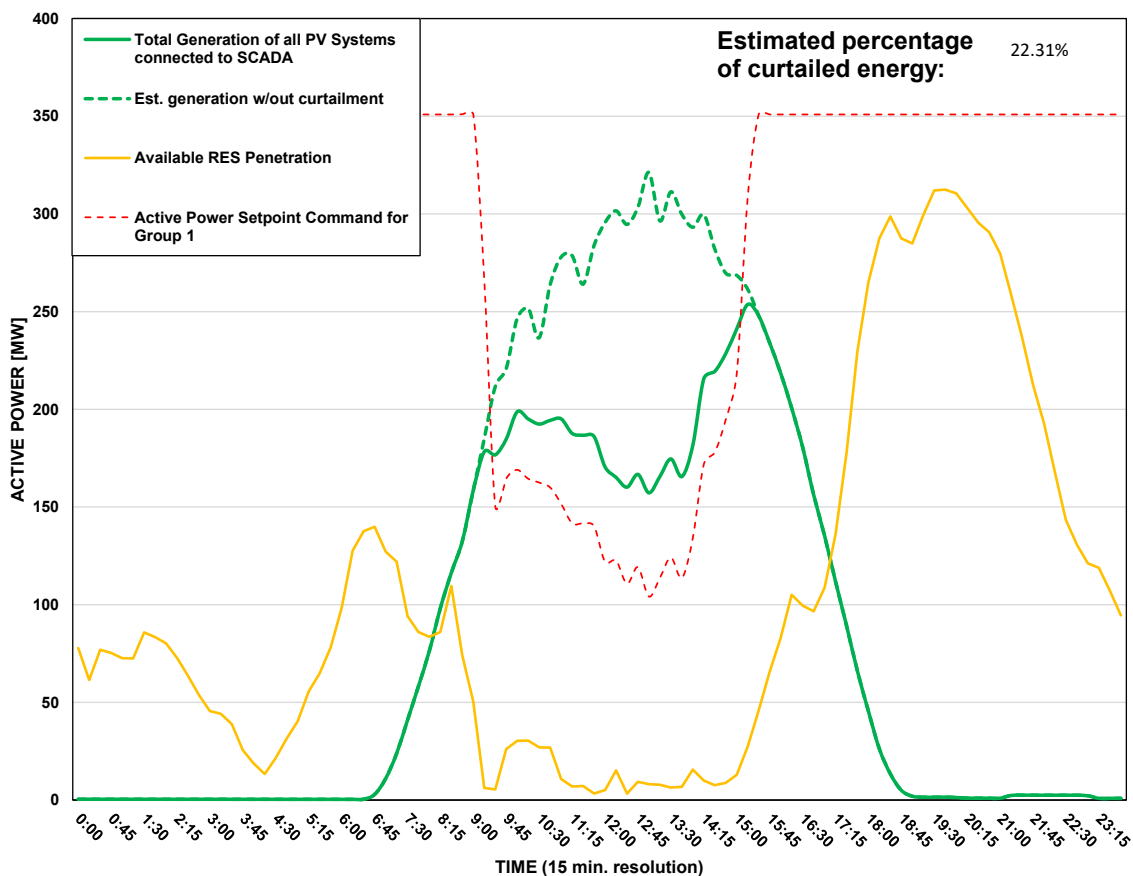

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	16/09/2026
Start of Curtailment (G1 - non Priority)	9:45
End of Curtailment (G1 - non Priority)	14:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2409.9 MWh
Total Estimated Curtailed Energy:	483.6 MWh
Percentage of Curtailed Energy:	20.07%

Scada PVs Generation on 16/09/2026 (curtailment time: 09:45 - 14:30)

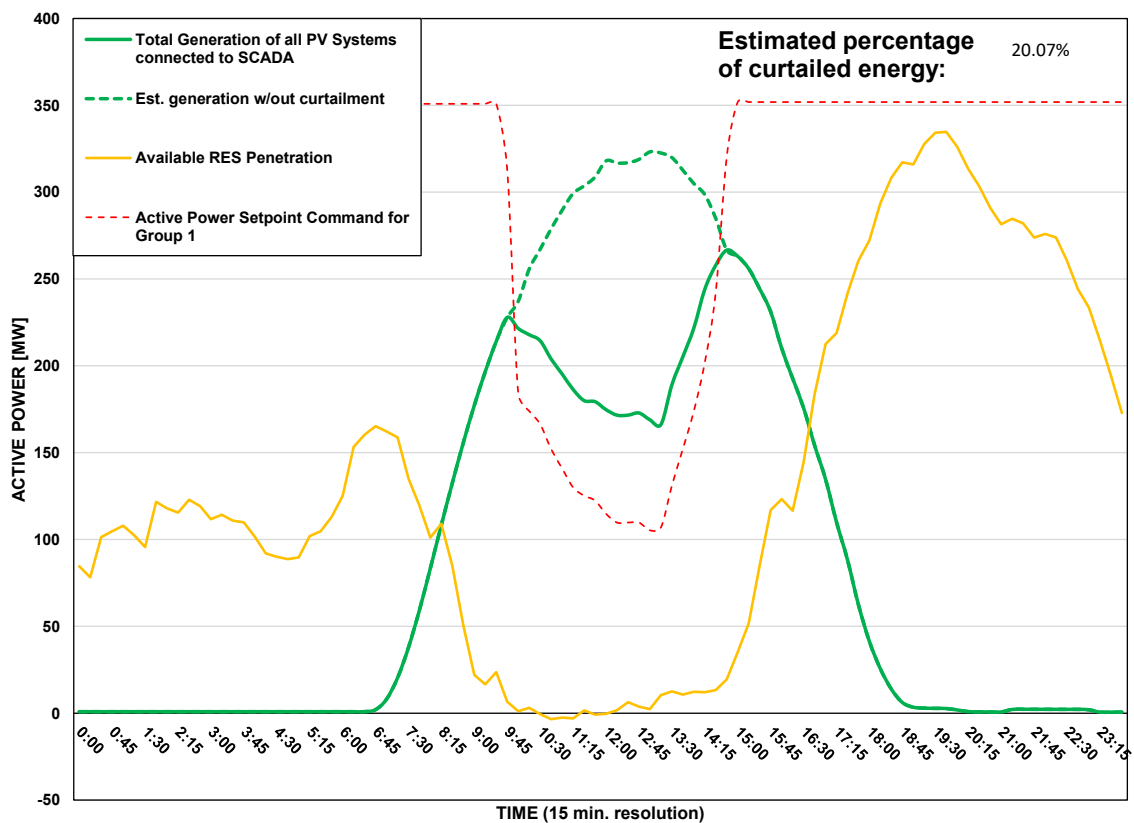

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	17/09/2026
Start of Curtailment (G1 - non Priority)	9:30
End of Curtailment (G1 - non Priority)	14:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2149.2 MWh
Total Estimated Curtailed Energy:	496.9 MWh
Percentage of Curtailed Energy:	23.12%

Scada PVs Generation on 17/09/2026 (curtailment time: 09:30 - 14:00)

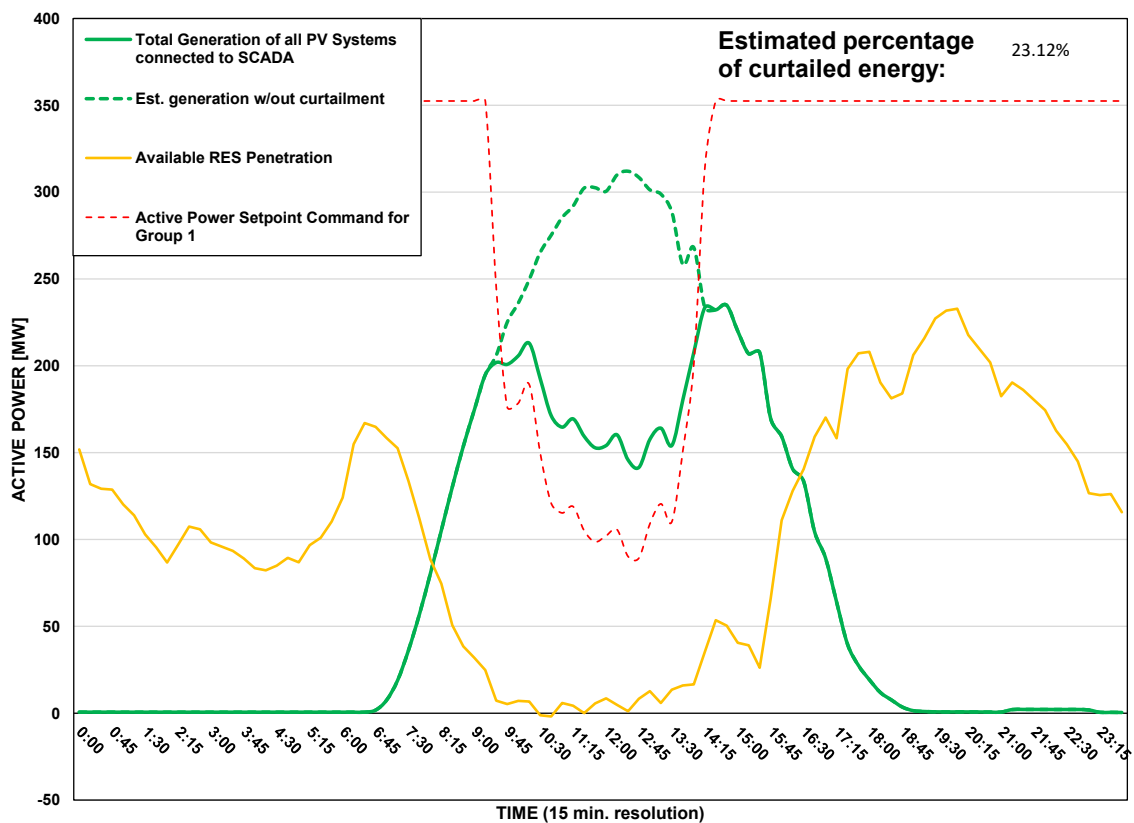

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	18/09/2026
Start of Curtailment (G1 - non Priority)	9:15
End of Curtailment (G1 - non Priority)	17:00
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1767.1 MWh
Total Estimated Curtailed Energy:	844.2 MWh
Percentage of Curtailed Energy:	47.77%

Scada PVs Generation on 18/09/2026 (curtailment time: 09:15 - 17:00)

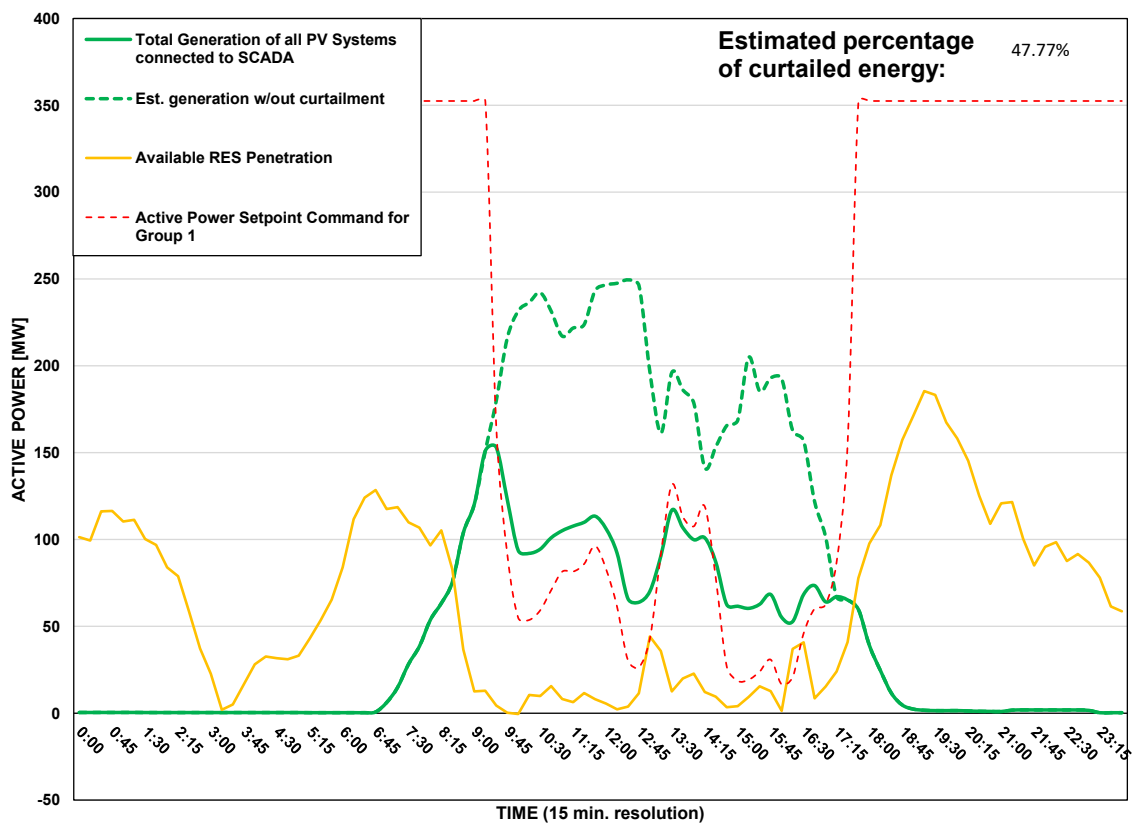


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	19/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	7:45	
Start of Curtailment (G2 - Priority)	10:00	Cut-off areas using IoT: PV-NIC7, PV-LCA/FAM1, PV-LCA/FAM3, PV-LIM2, PV-LIM4, PV-PAF2, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	16:30	
End of Curtailment (G2 - Priority)	15:30	
Instruction from TSOC	YES	Start of cut-off: 07:15 End of cut-off: 16:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2296.6 MWh	
Total Estimated Curtailed Energy:	1628.9 MWh	Total Est. Energy of the cut-off PV systems using IoT: 54.1MWh
Percentage of Curtailed Energy:	70.93%	

Scada PVs Generation on 19/09/2026 (curtailment time: 07:45 - 16:30)

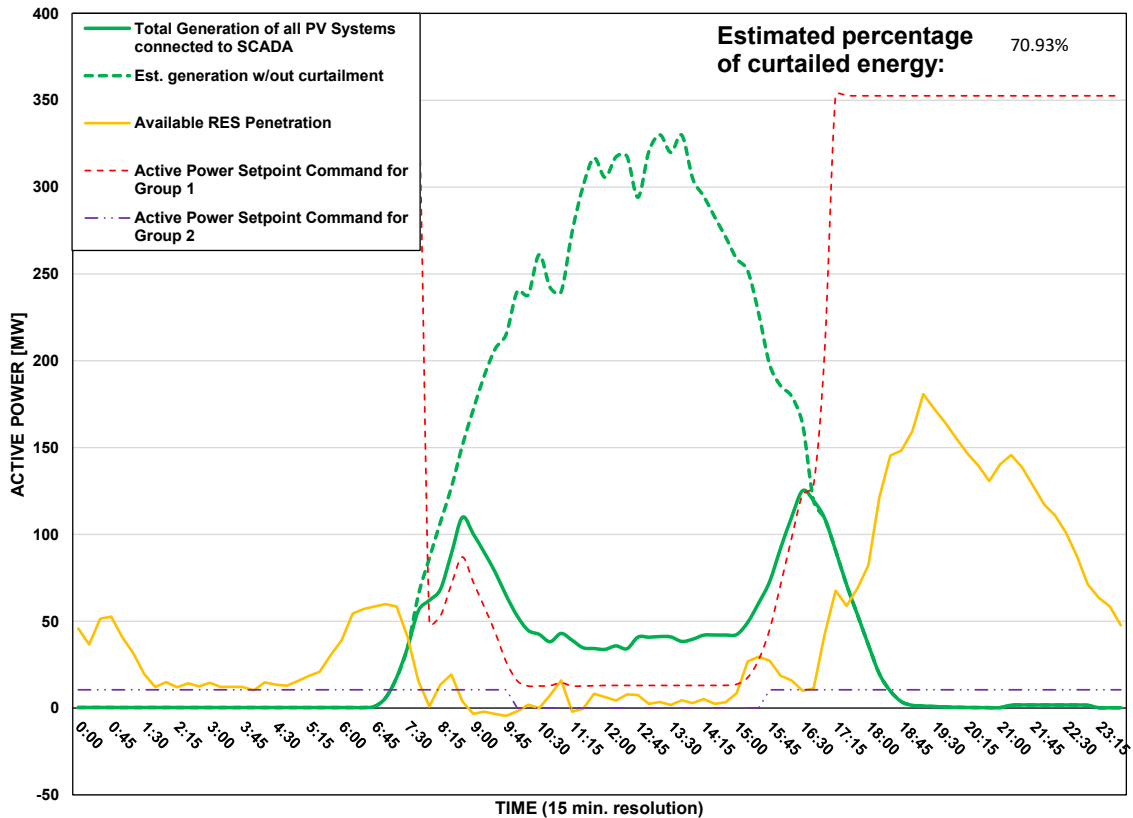


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	20/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:30	
Start of Curtailment (G2 - Priority)	10:00	Cut-off areas using IoT: PV-NIC7, PV-LIM1, PV-PAF3, PV -ARTICLE 102, PV-NPZEX1
End of Curtailment (G1 - non Priority)	16:45	
End of Curtailment (G2 - Priority)	14:30	
Instruction from TSOC	YES	Start of cut-off: 07:15 End of cut-off: 16:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2305.8 MWh	
Total Estimated Curtailed Energy:	1554.6 MWh	Total Est. Energy of the cut-off PV systems using IoT: 95.3MWh
Percentage of Curtailed Energy:	67.42%	

Scada PVs Generation on 20/09/2026 (curtailment time: 08:30 - 16:45)

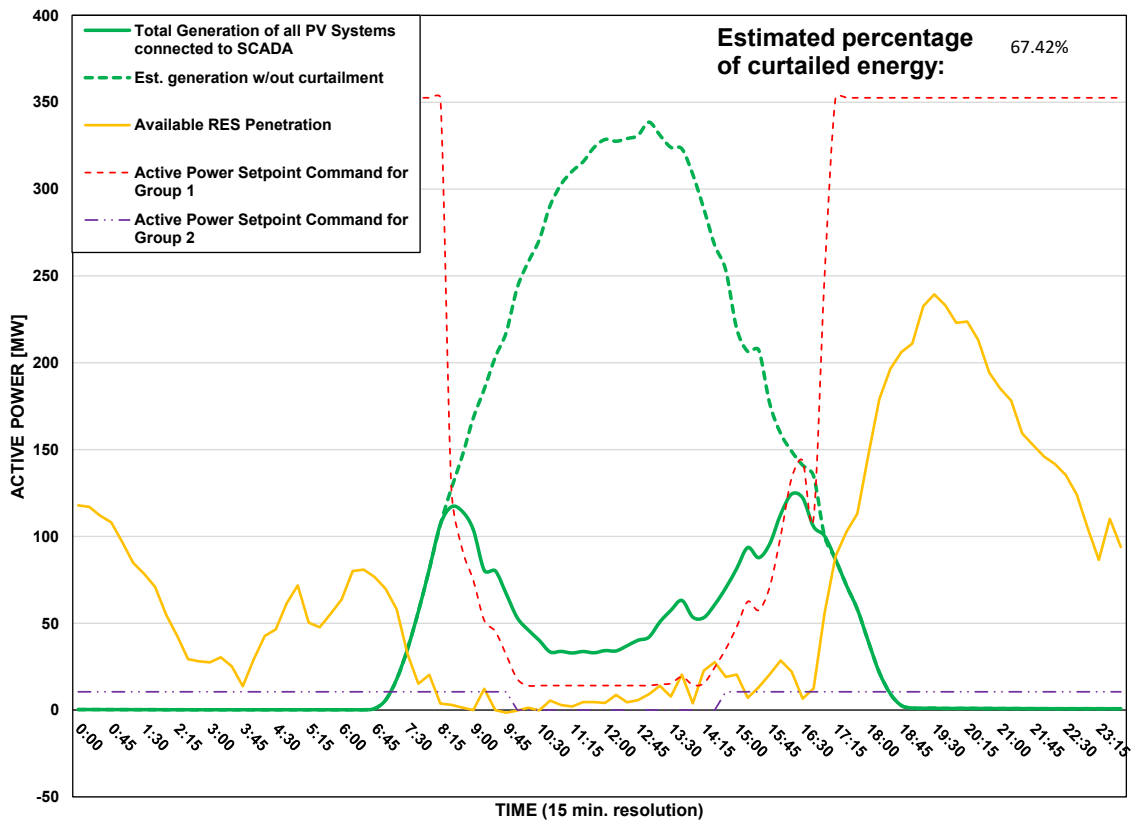

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	21/09/2026	Cut-off of PV Systems using RIPPLE:
Start of Curtailment (G1 - non Priority)	9:15	Cut-off areas using RIPPLE: PAF 2
End of Curtailment (G1 - non Priority)	16:30	
Instruction from TSOC	YES	Start of cut-off: 12:15 End of cut-off: 13:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2160.3 MWh	Total Est. Energy of the cut-off PV systems using RIPPLE: 2.6MWh
Total Estimated Curtailed Energy:	831 MWh	
Percentage of Curtailed Energy:	38.47%	

Scada PVs Generation on 21/09/2026 (curtailment time: 09:15 - 16:30)

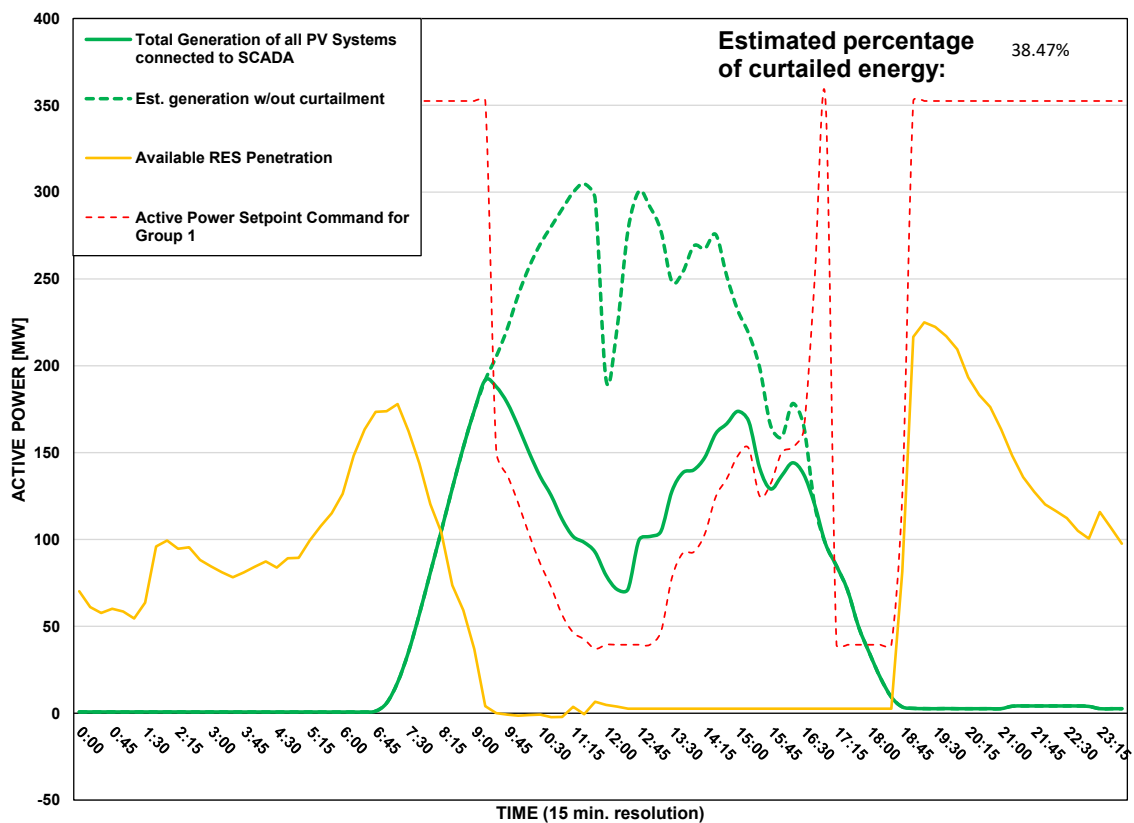


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	22/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	9:00	
Start of Curtailment (G2 - Priority)	11:30	Cut-off areas using IoT: PV -ARTICLE 102
End of Curtailment (G1 - non Priority)	15:30	
End of Curtailment (G2 - Priority)	14:00	
Instruction from TSOC	YES	Start of cut-off: 11:15 End of cut-off: 14:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2231 MWh	
Total Estimated Curtailed Energy:	981.9 MWh	Total Est. Energy of the cut-off PV systems using IoT: 5MWh
Percentage of Curtailed Energy:	44.06%	

Scada PVs Generation on 22/09/2026 (curtailment time: 09:00 - 15:30)

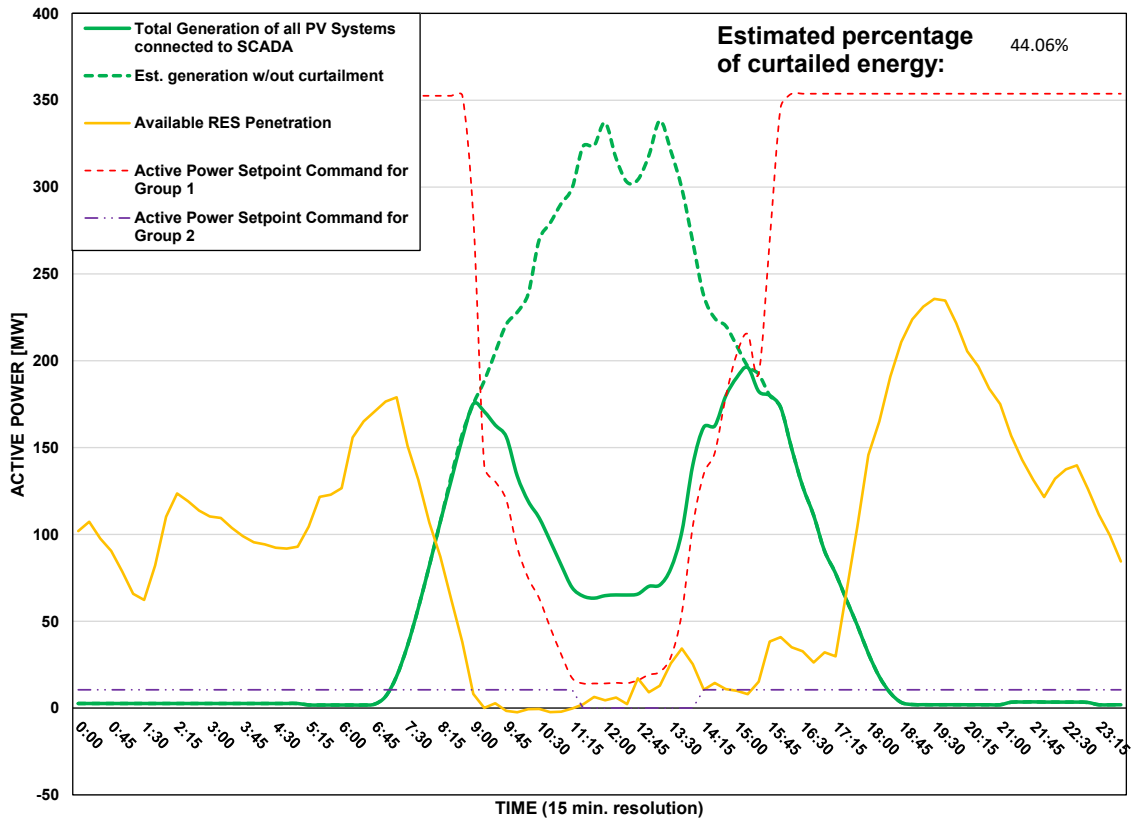

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	23/09/2026
Start of Curtailment (G1 - non Priority)	9:30
End of Curtailment (G1 - non Priority)	16:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2265.5 MWh
Total Estimated Curtailed Energy:	1140.4 MWh
Percentage of Curtailed Energy:	50.34%

Scada PVs Generation on 23/09/2026 (curtailment time: 09:30 - 16:45)

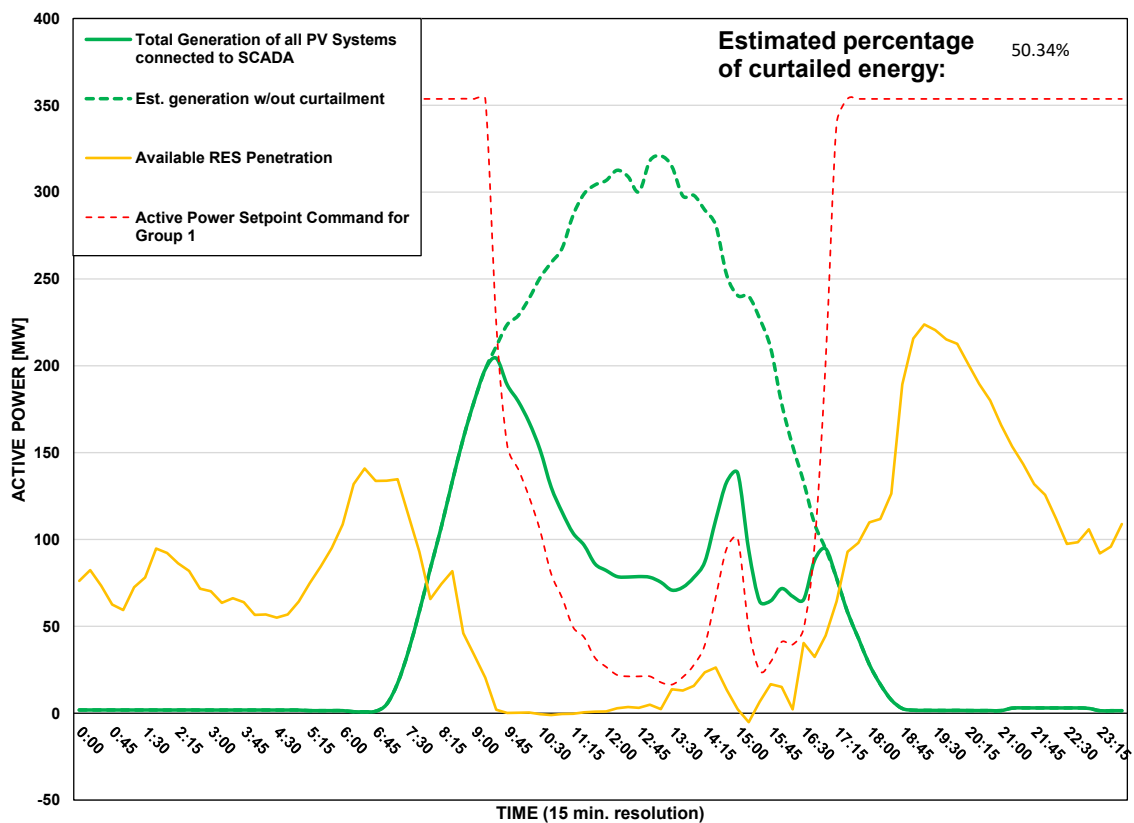

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION




Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	24/09/2026
Start of Curtailment (G1 - non Priority)	9:15
End of Curtailment (G1 - non Priority)	15:45
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	2113 MWh
Total Estimated Curtailed Energy:	757.8 MWh
Percentage of Curtailed Energy:	35.96%

Scada PVs Generation on 24/09/2026 (curtailment time: 09:15 - 15:45)

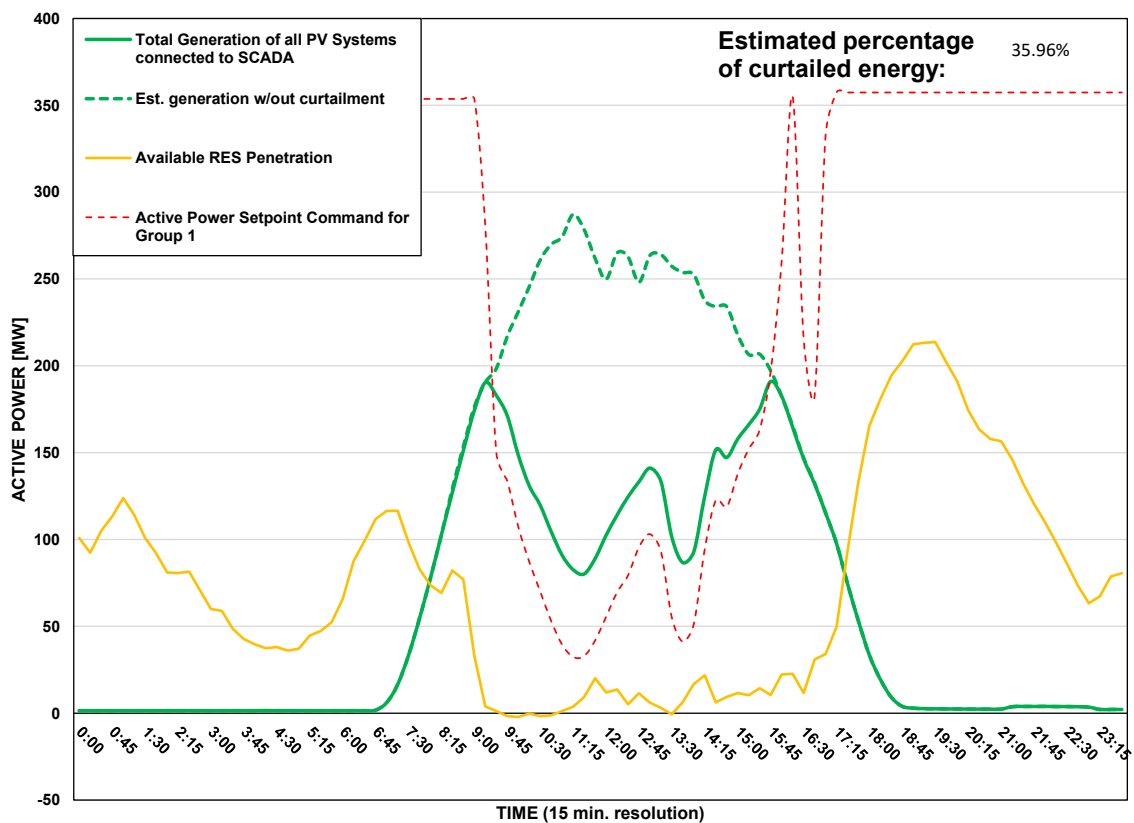


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	25/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	9:00	
Start of Curtailment (G2 - Priority)	11:00	Cut-off areas using IoT: PV-LIM3, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	17:15	
End of Curtailment (G2 - Priority)	16:00	
Instruction from TSOC	YES	Start of cut-off: 11:00 End of cut-off: 16:00
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2510.2 MWh	
Total Estimated Curtailed Energy:	1583.6 MWh	Total Est. Energy of the cut-off PV systems using IoT: 26.2MWh
Percentage of Curtailed Energy:	63.09%	

Scada PVs Generation on 25/09/2026 (curtailment time: 09:00 - 17:15)

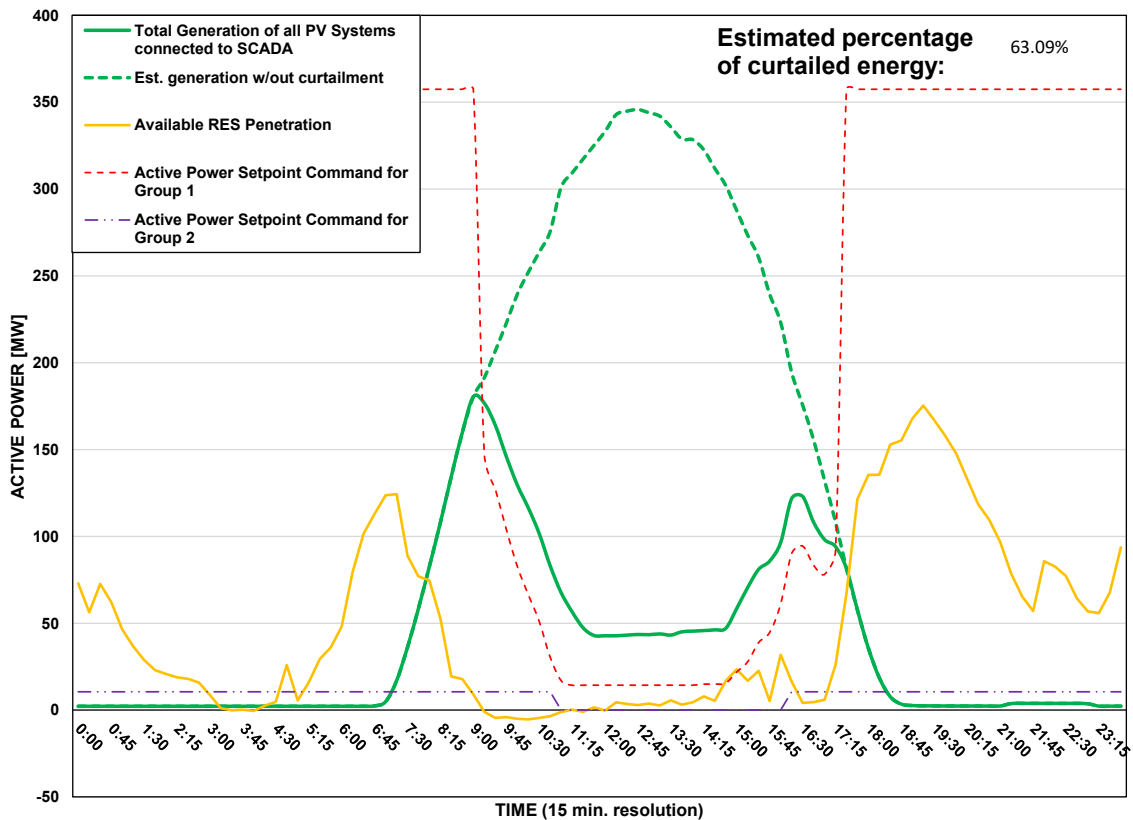


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	26/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:30	
Start of Curtailment (G2 - Priority)	10:00	Cut-off areas using IoT: PV-NIC3, PV-NIC4, PV-NIC5, PV-NIC6, PV-LCA/FAM2, PV-LCA/FAM4, PV-PAF1, PV -ARTICLE 102, PV -PROD 1, PV- NPZEX1
End of Curtailment (G1 - non Priority)	17:00	
End of Curtailment (G2 - Priority)	16:00	
Instruction from TSOC	YES	Start of cut-off: 10:30 End of cut-off: 16:00
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2403.6 MWh	
Total Estimated Curtailed Energy:	1702.2 MWh	Total Est. Energy of the cut-off PV systems using IoT: 288.3MWh
Percentage of Curtailed Energy:	70.82%	

Scada PVs Generation on 26/09/2026 (curtailment time: 08:30 - 17:00)

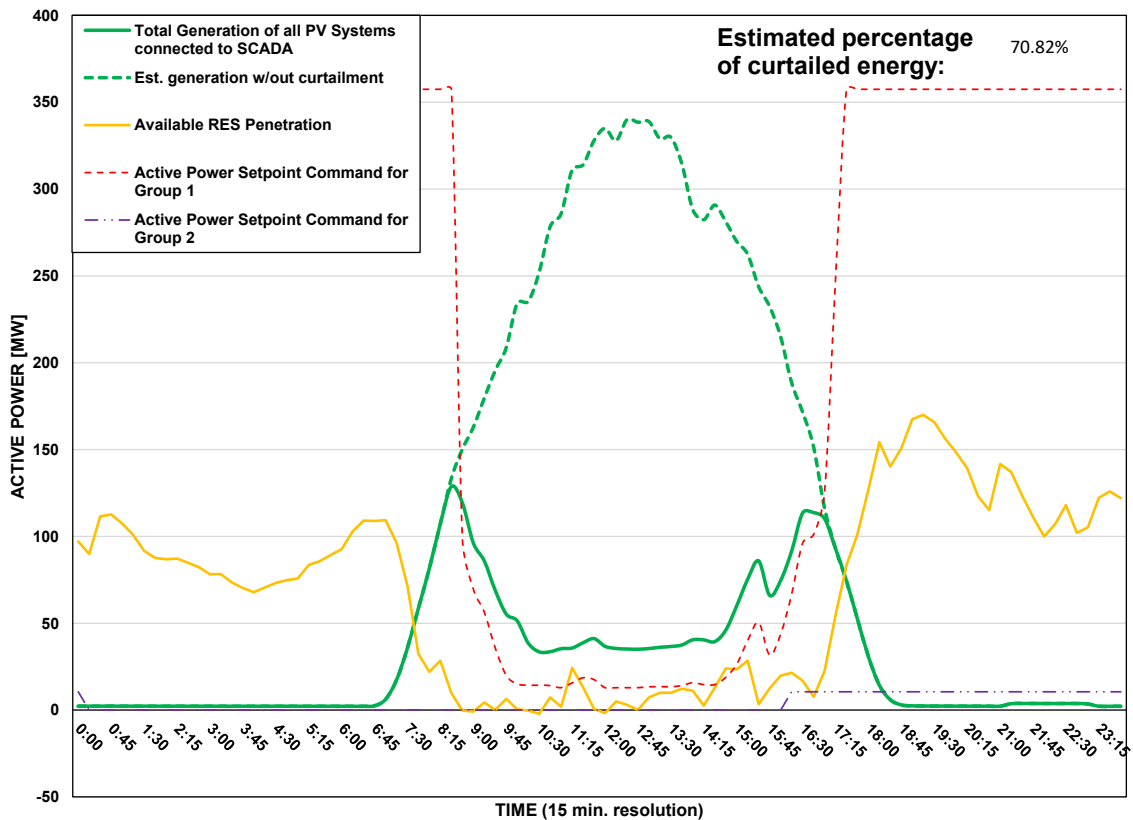


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	27/09/2026	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	8:00	Cut-off areas using RIPPLE: NIC 3, LAR 1, LIM 1 Cut-off areas using IoT: PV-NIC1, PV-NIC4, PV-NIC7, PV-LCA/FAM1, PV-LCA/FAM3, PV-LIM1, PV-LIM2, PV-LIM4, PV-PAF2, PV -ARTICLE 102, PV-NPZEX1
Start of Curtailment (G2 - Priority)	9:30	
End of Curtailment (G1 - non Priority)	16:45	
End of Curtailment (G2 - Priority)	16:00	
Instruction from TSOC	YES	Start of cut-off: 07:15 End of cut-off: 16:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2183.7 MWh	Total Est. Energy of the cut-off PV systems using RIPPLE: 211.2MWh
Total Estimated Curtailed Energy:	1623.6 MWh	Total Est. Energy of the cut-off PV systems using IoT: 232.4MWh
Percentage of Curtailed Energy:	74.35%	

Scada PVs Generation on 27/09/2026 (curtailment time: 08:00 - 16:45)

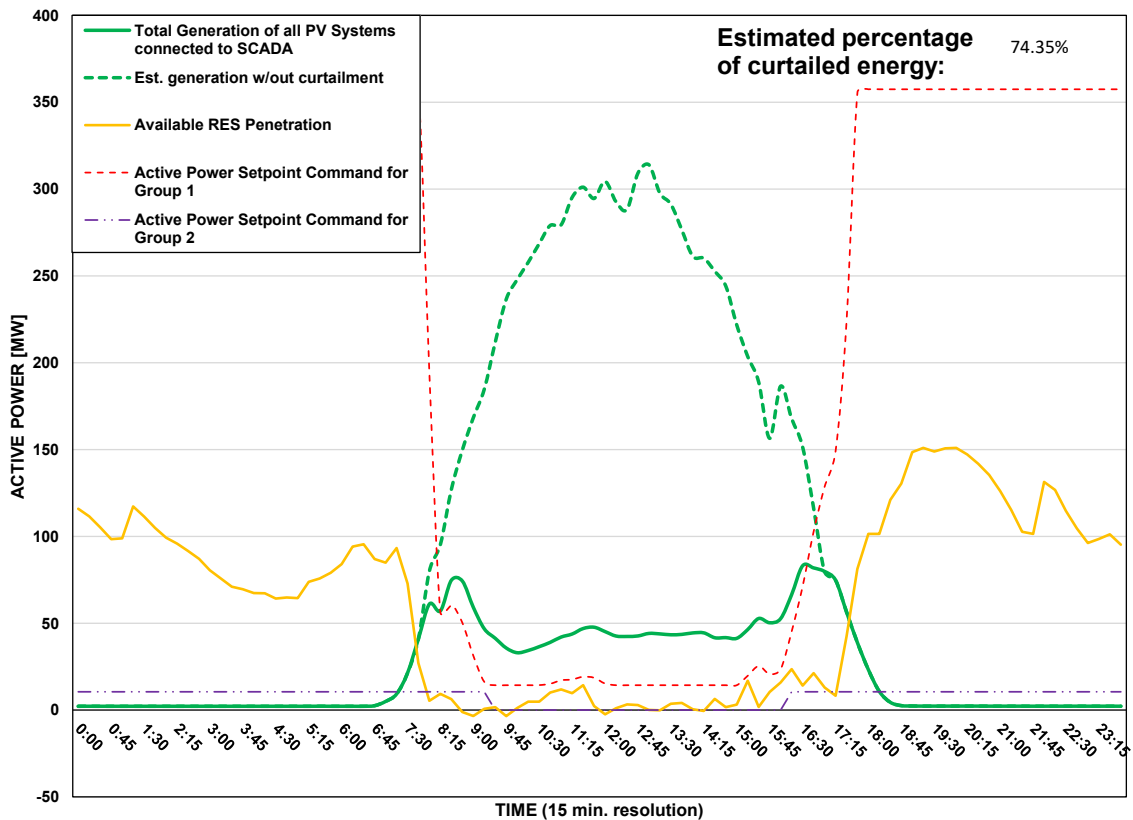


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	28/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:45	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
Start of Curtailment (G2 - Priority)	10:15	
End of Curtailment (G1 - non Priority)	16:00	
End of Curtailment (G2 - Priority)	14:45	
Instruction from TSOC	YES	Start of cut-off: 10:15 End of cut-off: 13:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	1841.8 MWh	
Total Estimated Curtailed Energy:	1021.2 MWh	Total Est. Energy of the cut-off PV systems using IoT: 4.5MWh
Percentage of Curtailed Energy:	55.44%	

Scada PVs Generation on 28/09/2026 (curtailment time: 08:45 - 16:00)

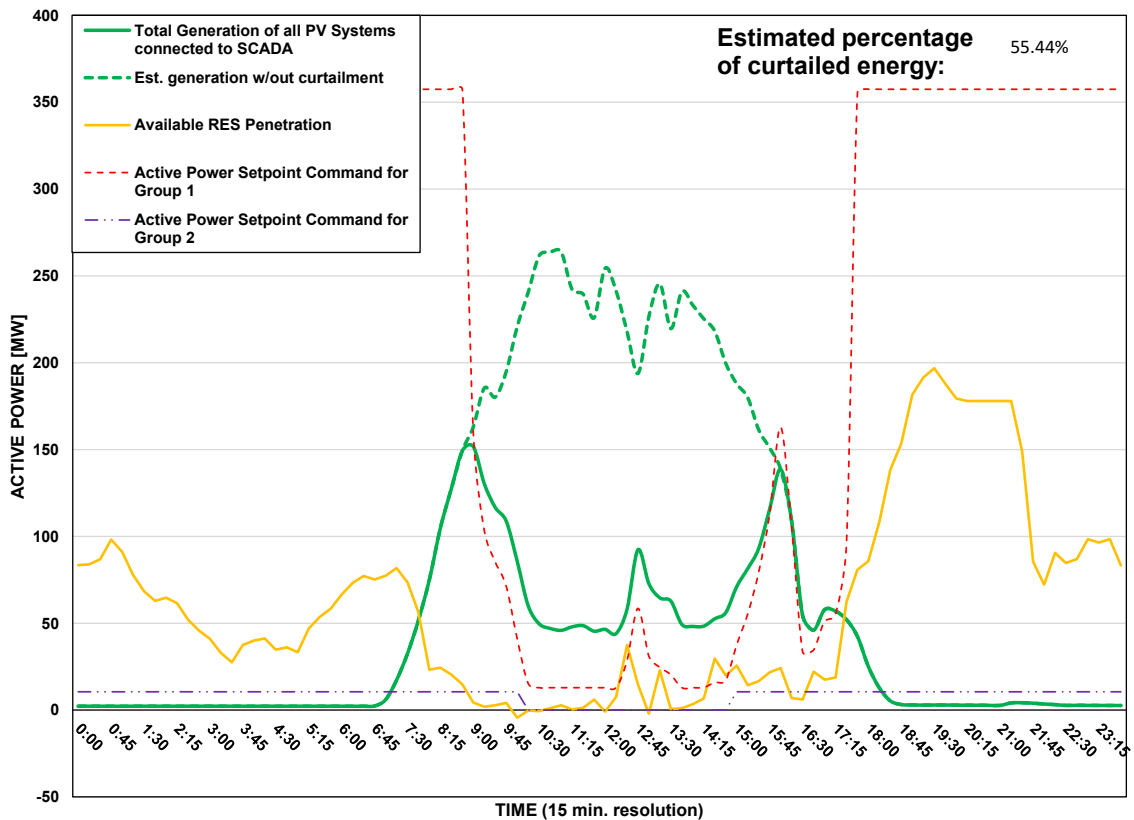


DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



PV Generation Curtailment Report

Date of Curtailment:	29/09/2026	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	8:30	
Start of Curtailment (G2 - Priority)	11:00	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	17:15	
End of Curtailment (G2 - Priority)	15:30	
Instruction from TSOC	YES	Start of cut-off: 11:00 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	2171.5 MWh	
Total Estimated Curtailed Energy:	1396.4 MWh	Total Est. Energy of the cut-off PV systems using IoT: 14.8MWh
Percentage of Curtailed Energy:	64.31%	

Scada PVs Generation on 29/09/2026 (curtailment time: 08:30 - 17:15)

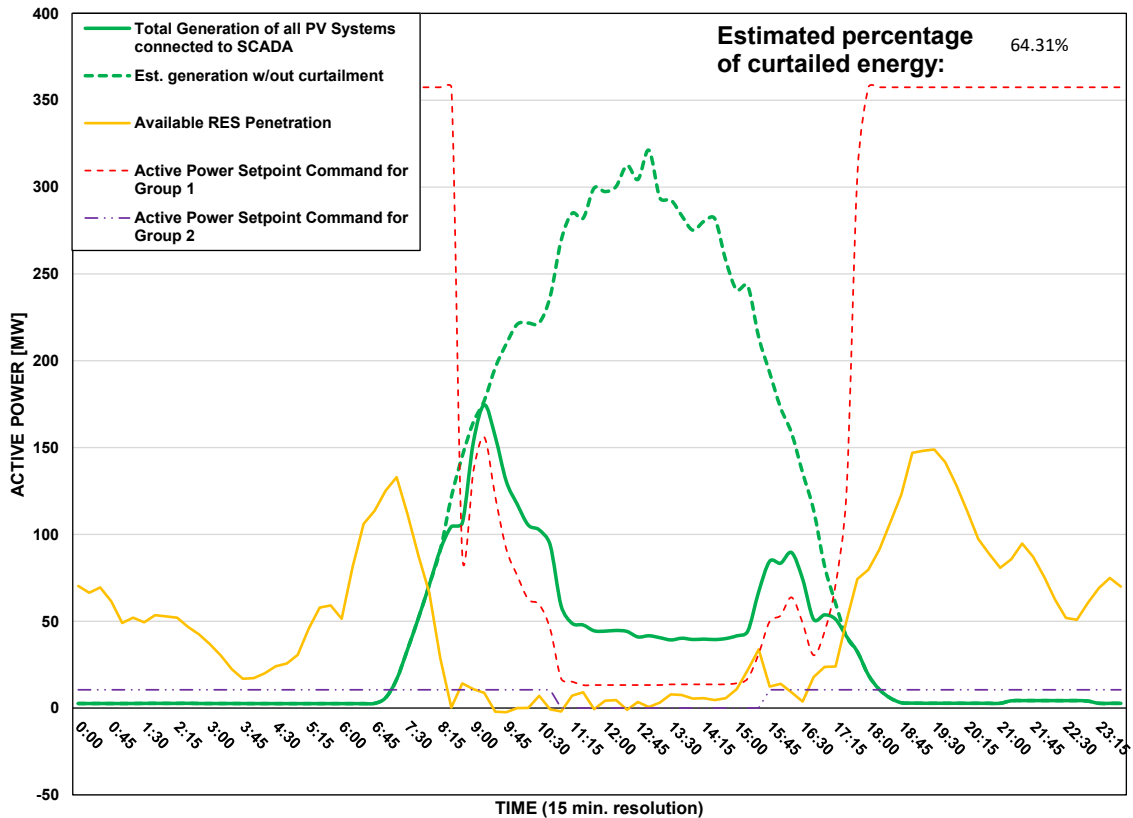

DISTRIBUTION SYSTEM OPERATOR SYSTEM OPERATION



Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	30/09/2026
Start of Curtailment (G1 - non Priority)	9:00
End of Curtailment (G1 - non Priority)	14:30
Instruction from TSOC	YES
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system
Total Estimated Energy of the day:	1357.6 MWh
Total Estimated Curtailed Energy:	213 MWh
Percentage of Curtailed Energy:	15.74%

Scada PVs Generation on 30/09/2026 (curtailment time: 09:00 - 14:30)

