
DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**01/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:00**	
Start of Curtailment (G2 - Priority)	**9:45**	Cut-off areas using RIPPLE: NIC 1, NIC 2, LAR 2, LIM 2, PAF 1 Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:00**	
End of Curtailment (G2 - Priority)	**15:00**	
Instruction from TSOC	**YES**	Start of cut-off: 09:45 End of cut-off: 15:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1674 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 126.5MWh**
Total Estimated Curtailed Energy:	***1110.8 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 9.4MWh**
Percentage of Curtailed Energy:	***66.36%***	

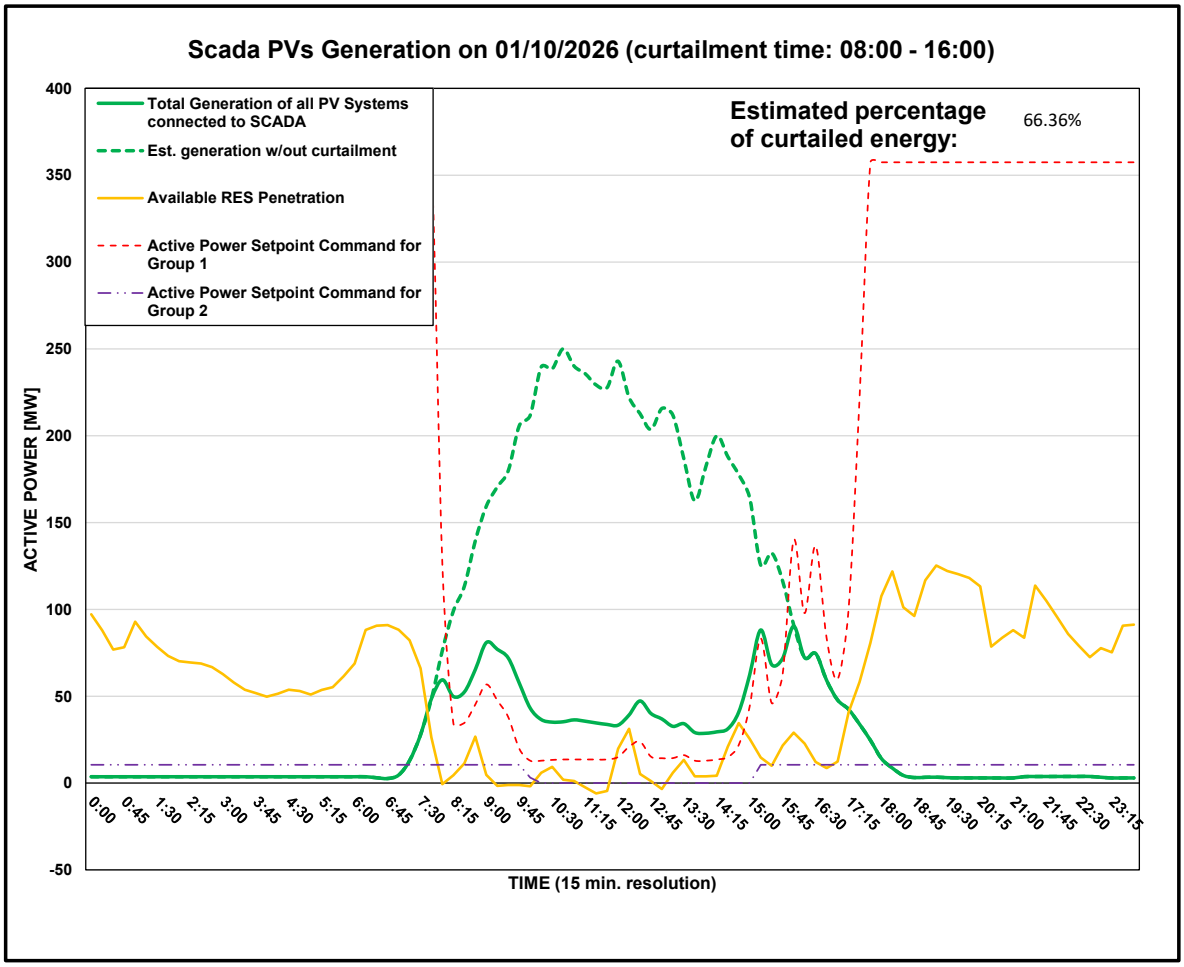


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**02/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:45**	
Start of Curtailment (G2 - Priority)	**9:45**	Cut-off areas using RIPPLE: NIC 1, NIC 2, NIC 3, LAR 1, LAR 2, LIM 1, LIM 2, PAF 1, PAF 2 Cut-off areas using IoT: PV-NIC2, PV-NIC3, PV-NIC5, PV-LCA/FAM2, PV-LCA/FAM4, PV-LIM3, PV-PAF1, PV-PAF3, PV -ARTICLE 102, PV -PROD 1, PV-NPZEX1
End of Curtailment (G1 - non Priority)	**17:30**	
End of Curtailment (G2 - Priority)	**17:30**	
Instruction from TSOC	**YES**	Start of cut-off: 09:45 End of cut-off: 17:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1772.3 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 208.5MWh**
Total Estimated Curtailed Energy:	***1309.2 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 115.3MWh**
Percentage of Curtailed Energy:	***73.88%***	

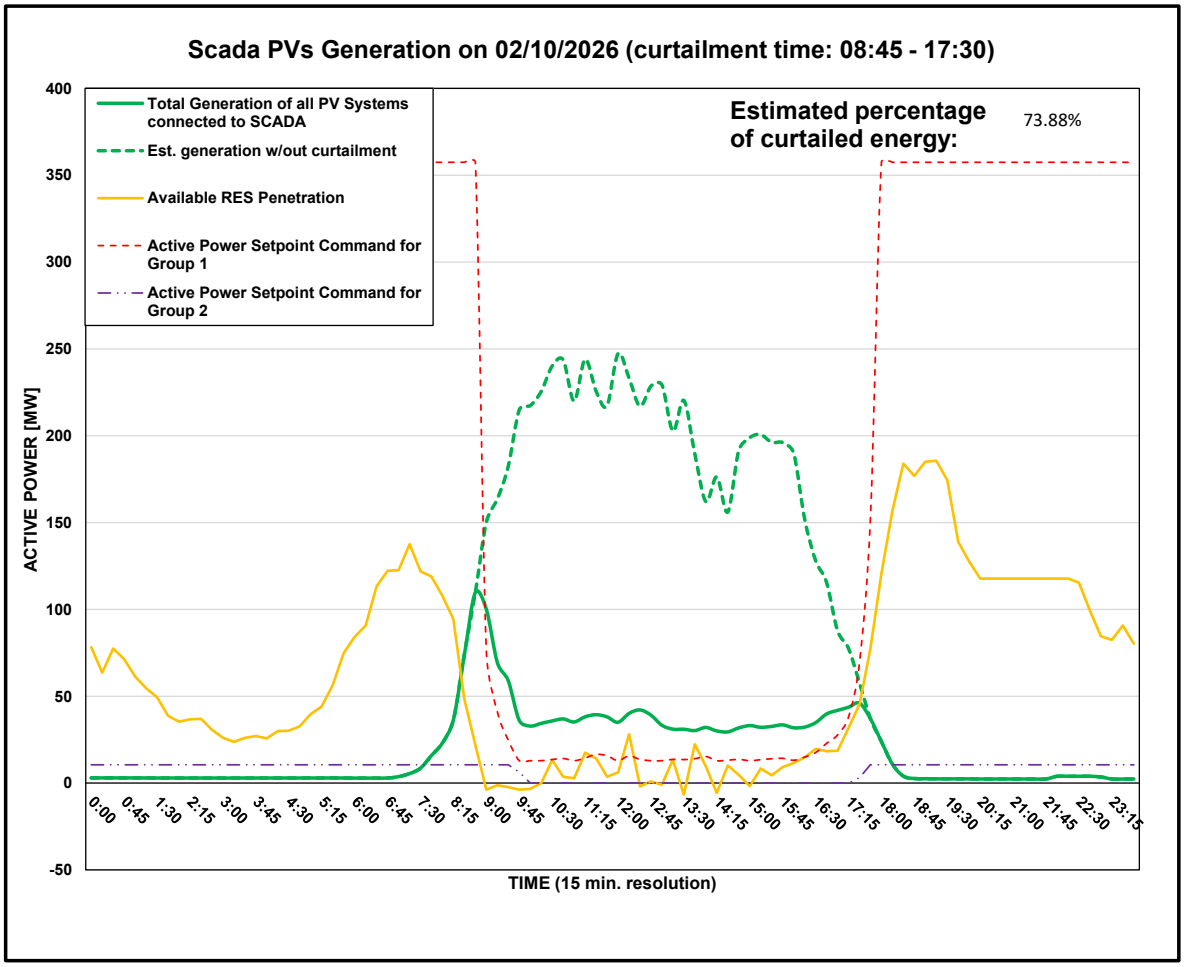


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**03/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:30**	
Start of Curtailment (G2 - Priority)	**9:45**	Cut-off areas using RIPPLE: NIC 1, LAR 2, PAF 2 Cut-off areas using IoT: PV-NIC1, PV-NIC5, PV-NIC6, PV-LCA/FAM4, PV-LIM3, PV-PAF3, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**15:45**	
End of Curtailment (G2 - Priority)	**15:30**	
Instruction from TSOC	**YES**	Start of cut-off: 09:45 End of cut-off: 15:30

Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1753.7 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 113.9MWh**
Total Estimated Curtailed Energy:	***1159.5 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 180.1MWh**
Percentage of Curtailed Energy:	***66.11%***	

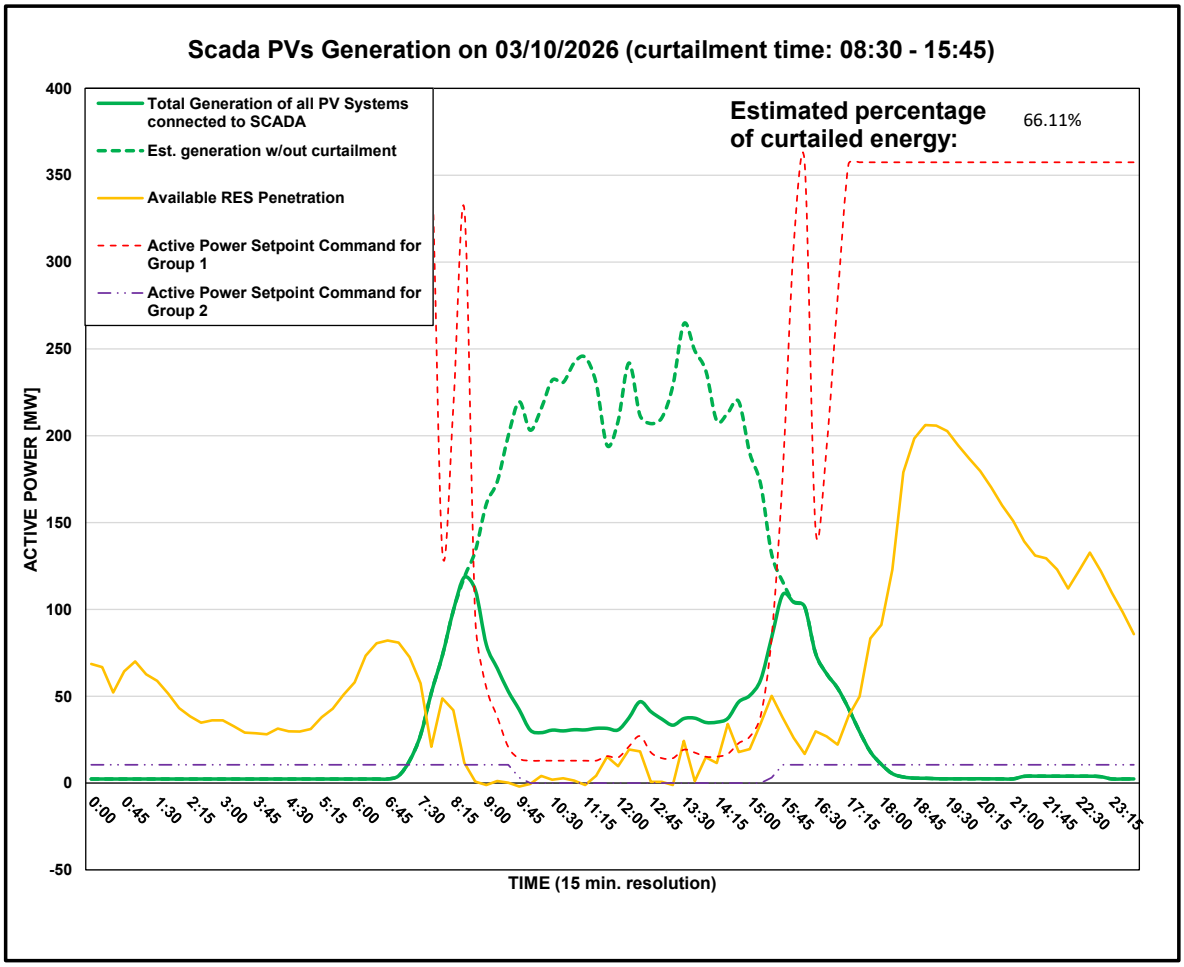


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**04/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:15**	
Start of Curtailment (G2 - Priority)	**8:45**	Cut-off areas using RIPPLE: NIC 1, NIC 2, NIC 3, LAR 1, LIM 1, LIM 2, PAF 1 Cut-off areas using IoT: PV-NIC2, PV-NIC3, PV-NIC4, PV-NIC6, PV-LCA/FAM2, PV-LCA/FAM3, PV-LIM1, PV-PAF1, PV -ARTICLE 102, PV -PROD 1, PV-NPZEX1
End of Curtailment (G1 - non Priority)	**17:00**	
End of Curtailment (G2 - Priority)	**16:45**	
Instruction from TSOC	**YES**	Start of cut-off: 08:45 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1961.5 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 556MWh**
Total Estimated Curtailed Energy:	***1494.5 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 481.6MWh**
Percentage of Curtailed Energy:	***76.19%***	

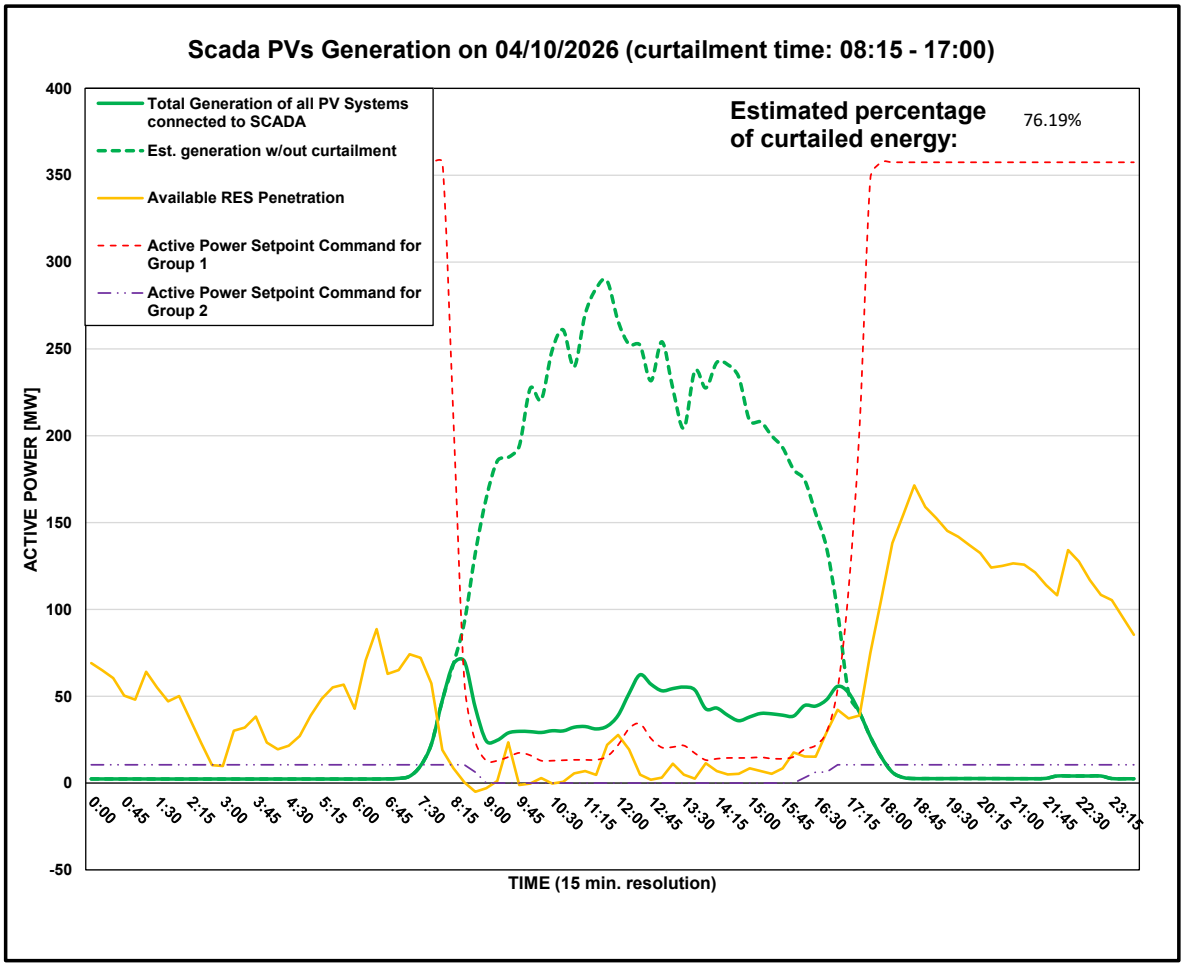


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**05/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:30**	
Start of Curtailment (G2 - Priority)	**9:45**	Cut-off areas using RIPPLE: NIC 2, LAR 2, PAF 2 Cut-off areas using IoT: PV-NIC1, PV-NIC5, PV-LCA/FAM4, PV-LIM3, PV-PAF3, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:00**	
End of Curtailment (G2 - Priority)	**15:00**	
Instruction from TSOC	**YES**	Start of cut-off: 10:00 End of cut-off: 15:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1922.3 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 139.3MWh**
Total Estimated Curtailed Energy:	***1220 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 186.8MWh**
Percentage of Curtailed Energy:	***63.47%***	

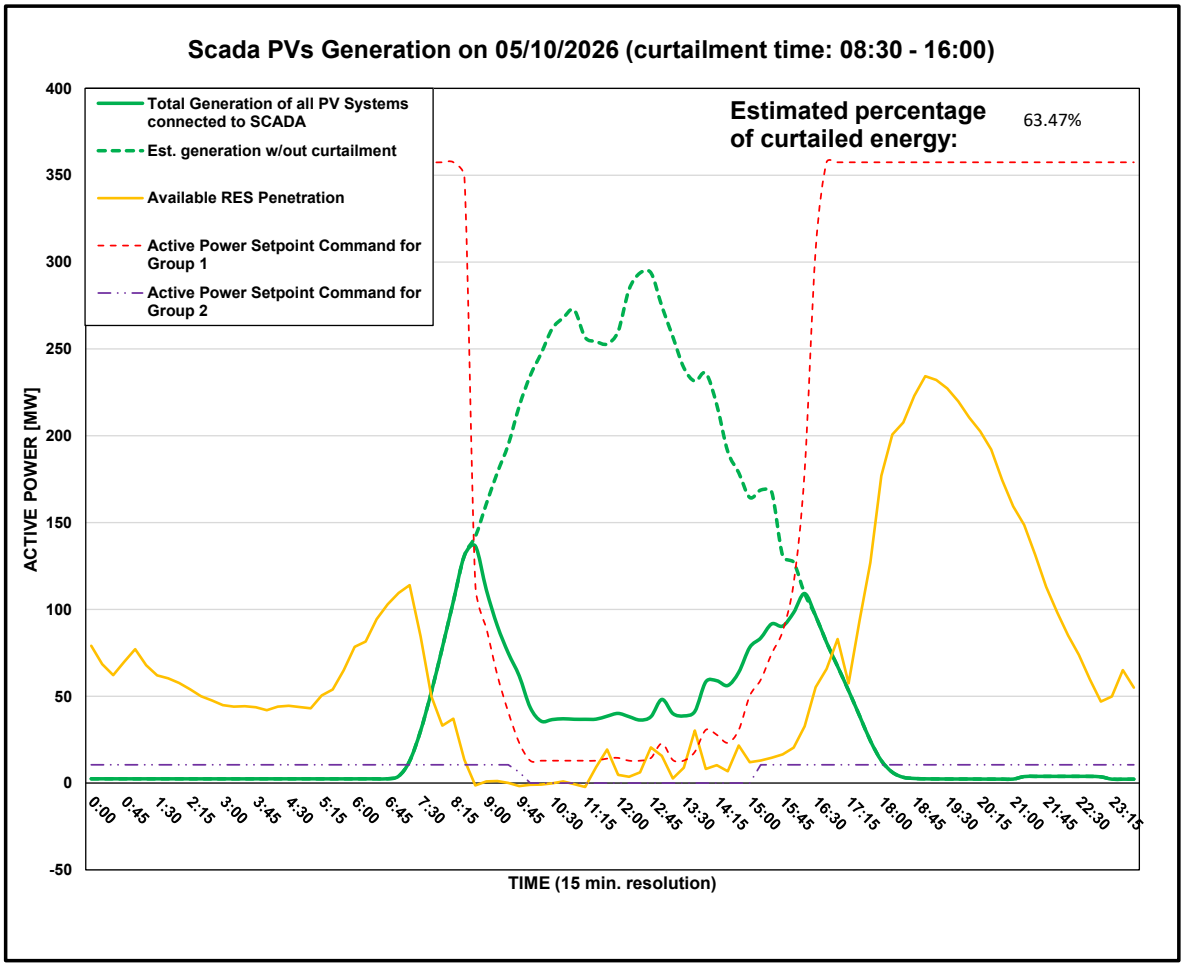


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**06/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**9:15**	
Start of Curtailment (G2 - Priority)	**10:00**	Cut-off areas using RIPPLE: LAR 1, LIM 2, PAF 1 Cut-off areas using IoT: PV-NIC4, PV-NIC7, PV-LCA/FAM1, PV-LIM2, PV-LIM4, PV-PAF1, PV-PAF2, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:45**	
End of Curtailment (G2 - Priority)	**14:30**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 16:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1716.4 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 61.4MWh**
Total Estimated Curtailed Energy:	***1023.1 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 59.6MWh**
Percentage of Curtailed Energy:	***59.6%***	

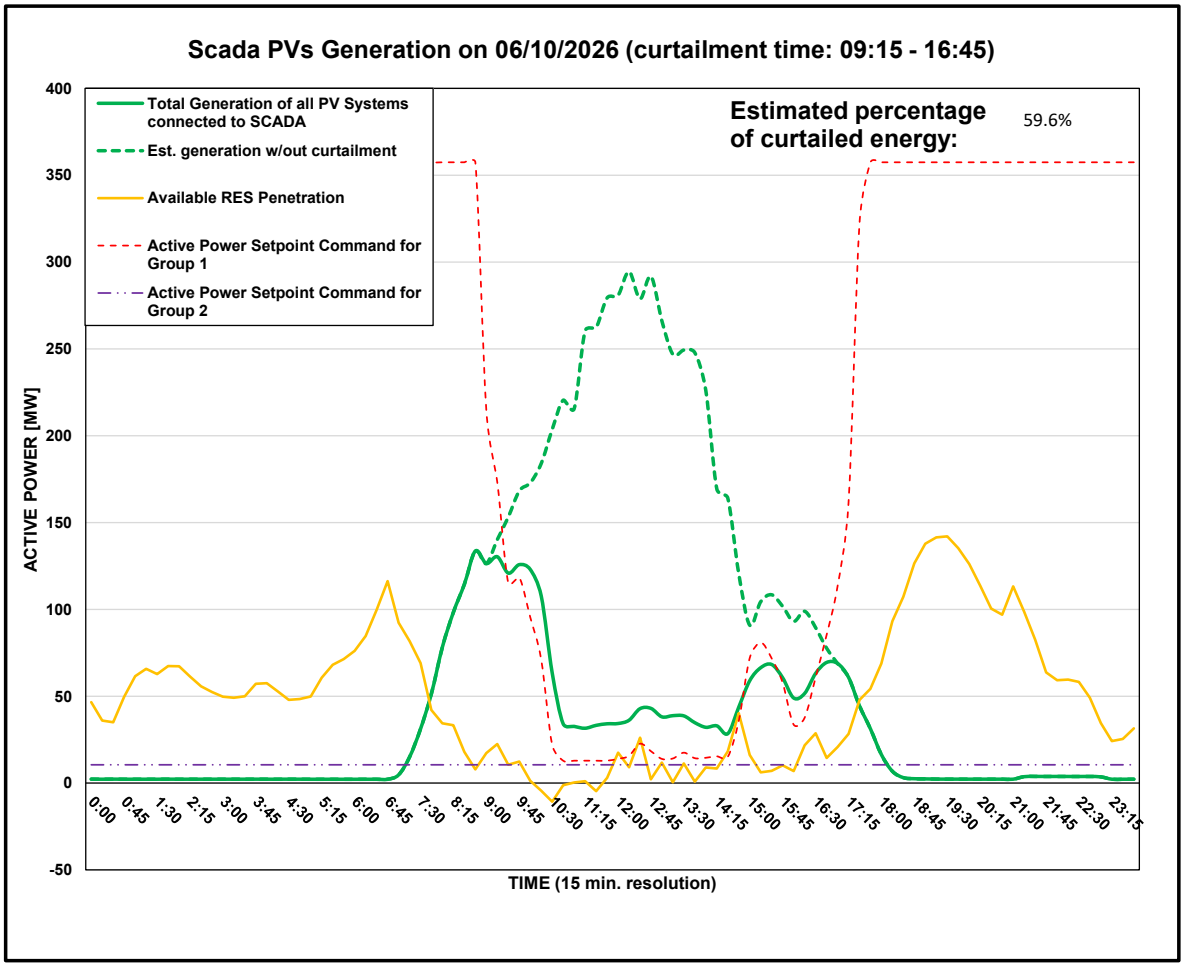


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**07/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:15**	
Start of Curtailment (G2 - Priority)	**10:00**	Cut-off areas using RIPPLE: LIM 1 Cut-off areas using IoT: PV-NIC3, PV-LCA/FAM2, PV-LCA/FAM3, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**14:45**	
End of Curtailment (G2 - Priority)	**14:15**	
Instruction from TSOC	**YES**	Start of cut-off: 10:30 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1623.6 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 47.8MWh**
Total Estimated Curtailed Energy:	***883.2 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 143.4MWh**
Percentage of Curtailed Energy:	***54.4%***	

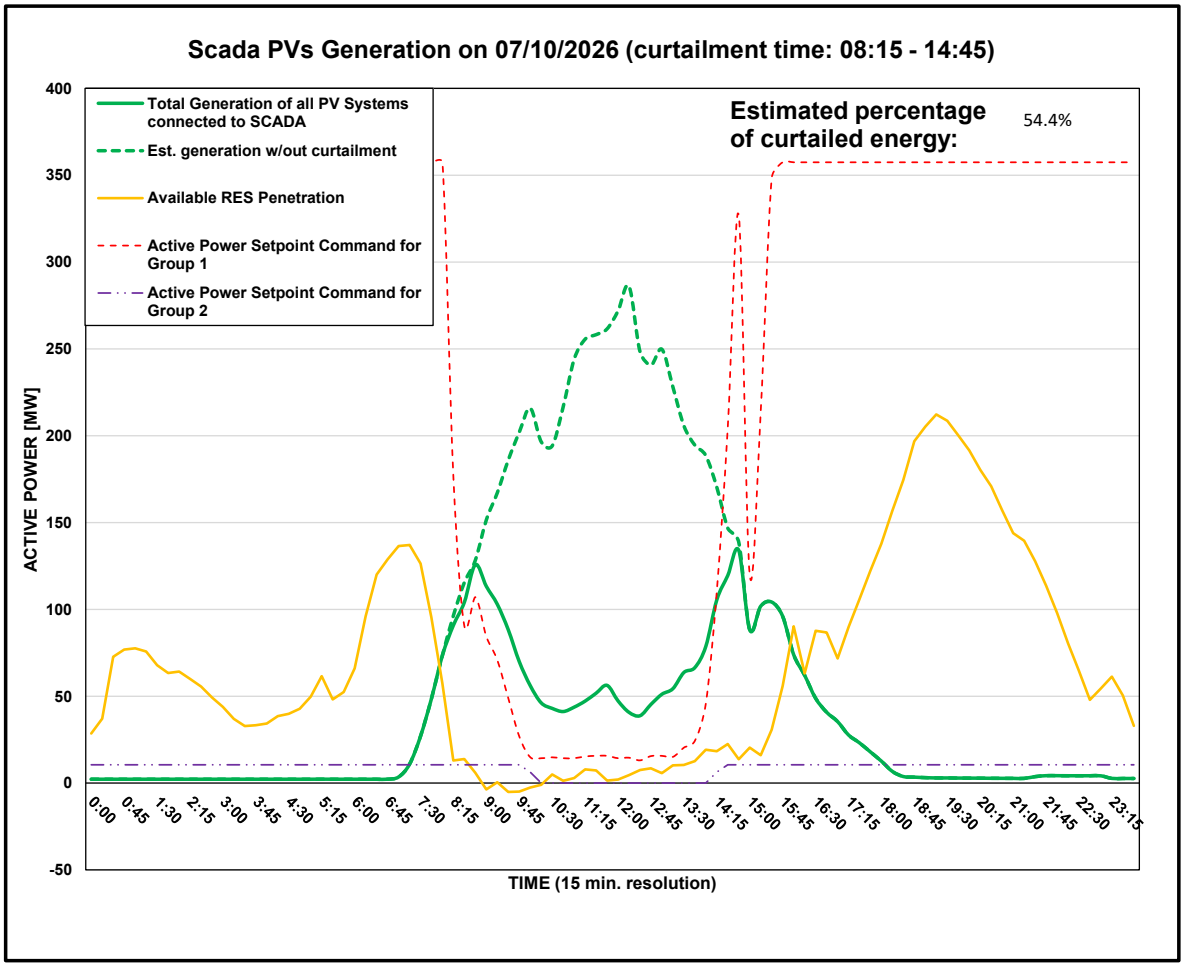


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**08/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:45**	
Start of Curtailment (G2 - Priority)	**10:00**	Cut-off areas using RIPPLE: NIC 3 Cut-off areas using IoT: PV-NIC2, PV-NIC6, PV-LIM1, PV-PAF3, PV -ARTICLE 102, PV -PROD 1, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:15**	
End of Curtailment (G2 - Priority)	**15:00**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 15:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**2006.2 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 73.3MWh**
Total Estimated Curtailed Energy:	***1193 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 158.9MWh**
Percentage of Curtailed Energy:	***59.47%***	

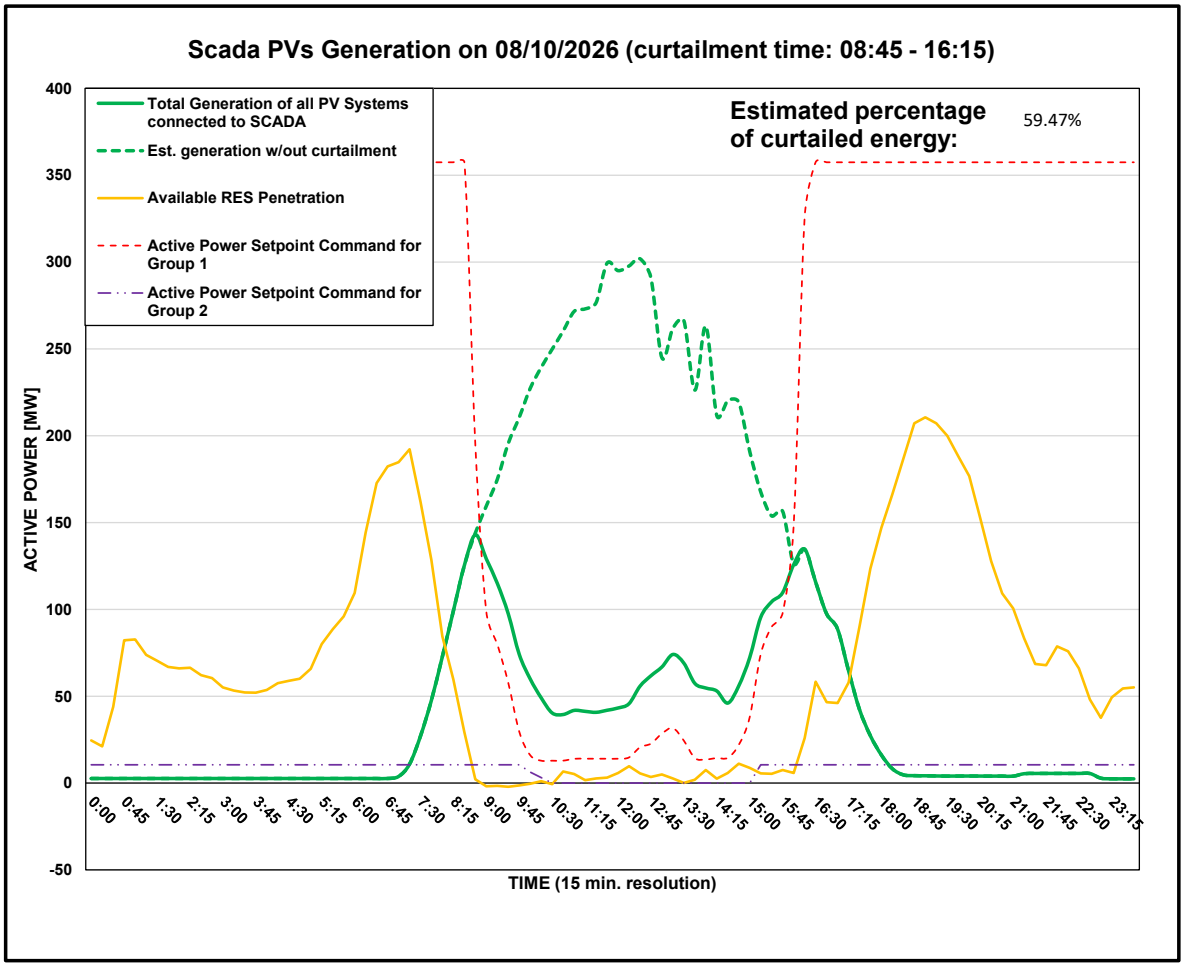


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**09/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:30**	
Start of Curtailment (G2 - Priority)	**9:45**	Cut-off areas using RIPPLE: NIC 1, NIC 2, LAR 2, PAF 1, PAF 2 Cut-off areas using IoT: PV-NIC1, PV-NIC4, PV-NIC5, PV-NIC7, PV-LCA/FAM1, PV-LCA/FAM4, PV-LIM2, PV-LIM3, PV-LIM4, PV-PAF1, PV-PAF2, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:15**	
End of Curtailment (G2 - Priority)	**15:15**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 16:30

Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**2213.3 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 224.2MWh**
Total Estimated Curtailed Energy:	***1464.5 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 280.1MWh**
Percentage of Curtailed Energy:	***66.17%***	

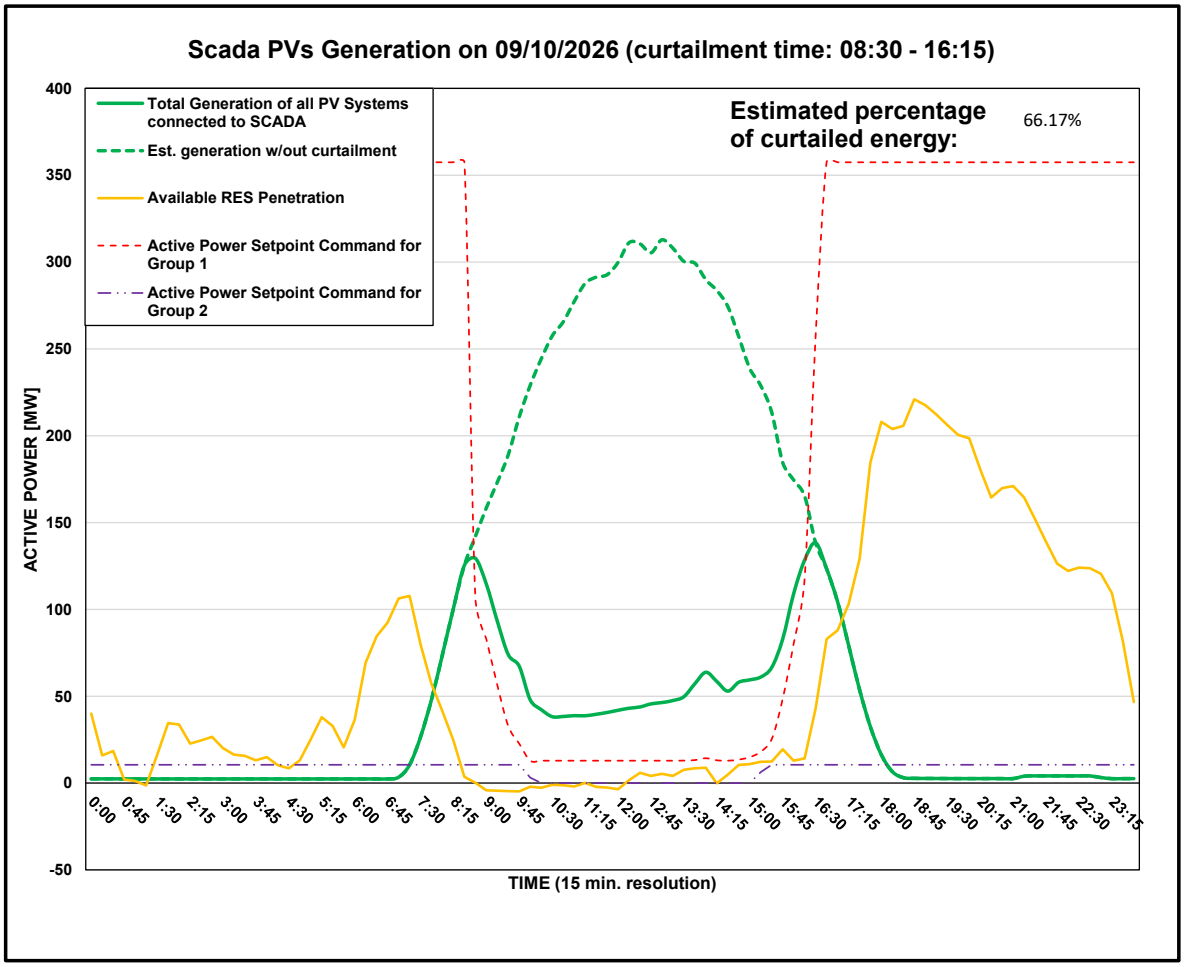


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**10/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:30**	
Start of Curtailment (G2 - Priority)	**9:45**	Cut-off areas using RIPPLE: NIC 3, LAR 1, LIM 1, LIM 2 Cut-off areas using IoT: PV-NIC2, PV-NIC3, PV-NIC6, PV-LCA/FAM3, PV-LIM1, PV -ARTICLE 102, PV -PROD 1, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:30**	
End of Curtailment (G2 - Priority)	**14:45**	
Instruction from TSOC	**YES**	Start of cut-off: 09:45 End of cut-off: 15:00
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1988.3 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 235.7MWh**
Total Estimated Curtailed Energy:	***1325.8 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 219.1MWh**
Percentage of Curtailed Energy:	***66.68%***	

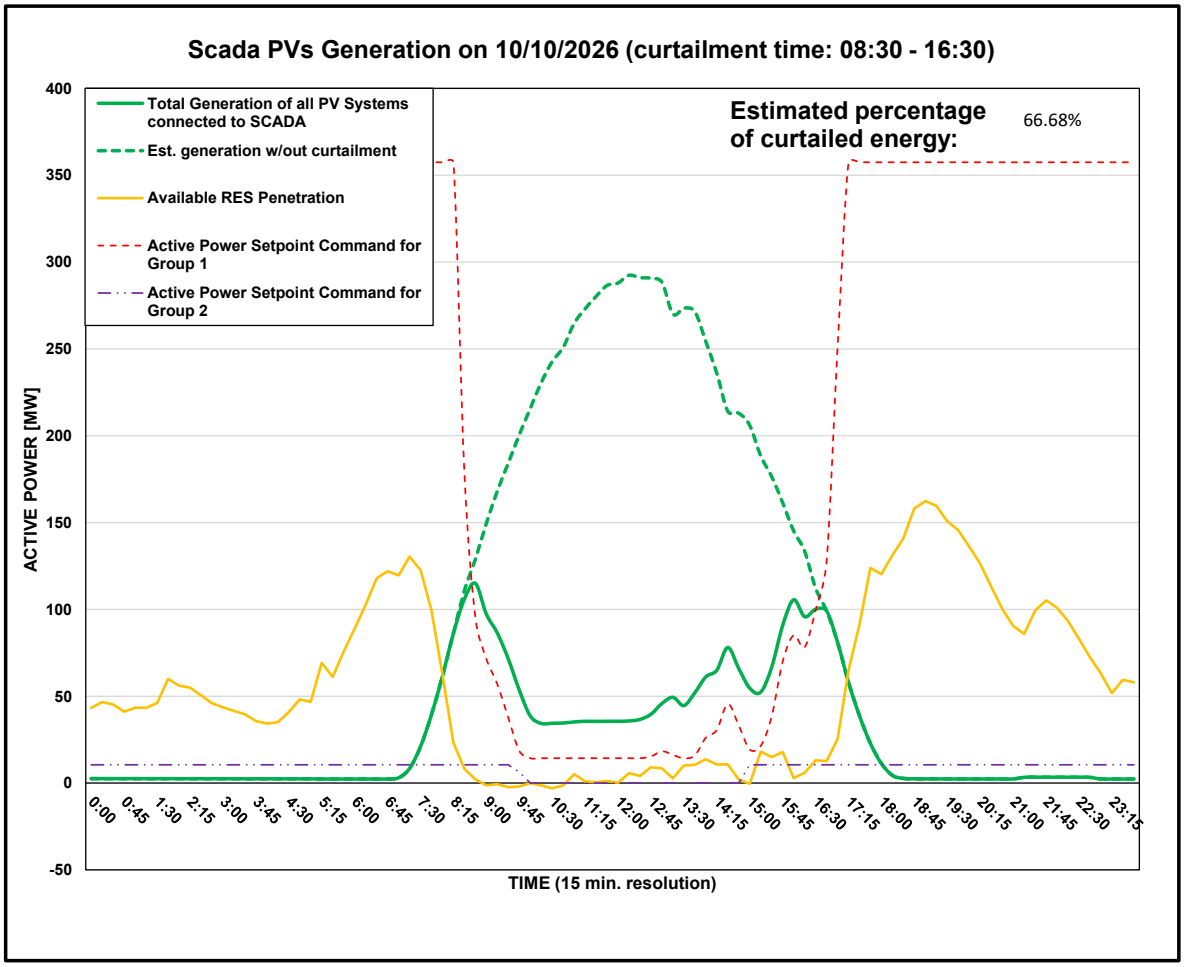


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**11/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:45**	
Start of Curtailment (G2 - Priority)	**10:45**	Cut-off areas using RIPPLE: PAF 1, PAF 2 Cut-off areas using IoT: PV-NIC7, PV-LCA/FAM1, PV-LCA/FAM2, PV-LIM2, PV-LIM4, PV-PAF2, PV-PAF3, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**15:45**	
End of Curtailment (G2 - Priority)	**15:15**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 16:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1692.6 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 43.2MWh**
Total Estimated Curtailed Energy:	***1095.7 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 155.9MWh**
Percentage of Curtailed Energy:	***64.73%***	

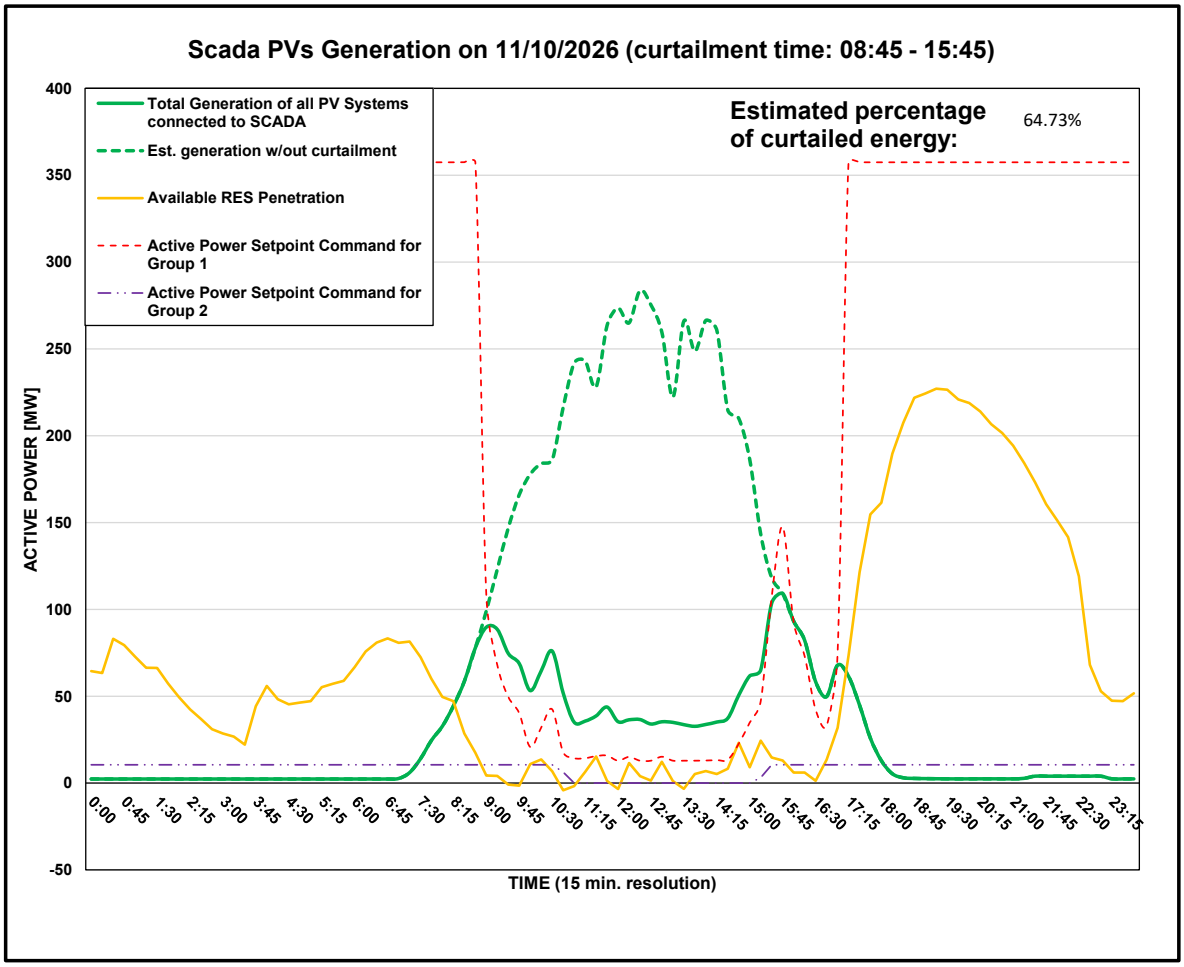


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**12/10/2026**	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	**9:15**	
Start of Curtailment (G2 - Priority)	**10:45**	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:00**	
End of Curtailment (G2 - Priority)	**12:30**	
Instruction from TSOC	**YES**	Start of cut-off: 11:00 End of cut-off: 14:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1746.9 MWh**	
Total Estimated Curtailed Energy:	***850.6 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 5.1MWh**
Percentage of Curtailed Energy:	***48.69%***	

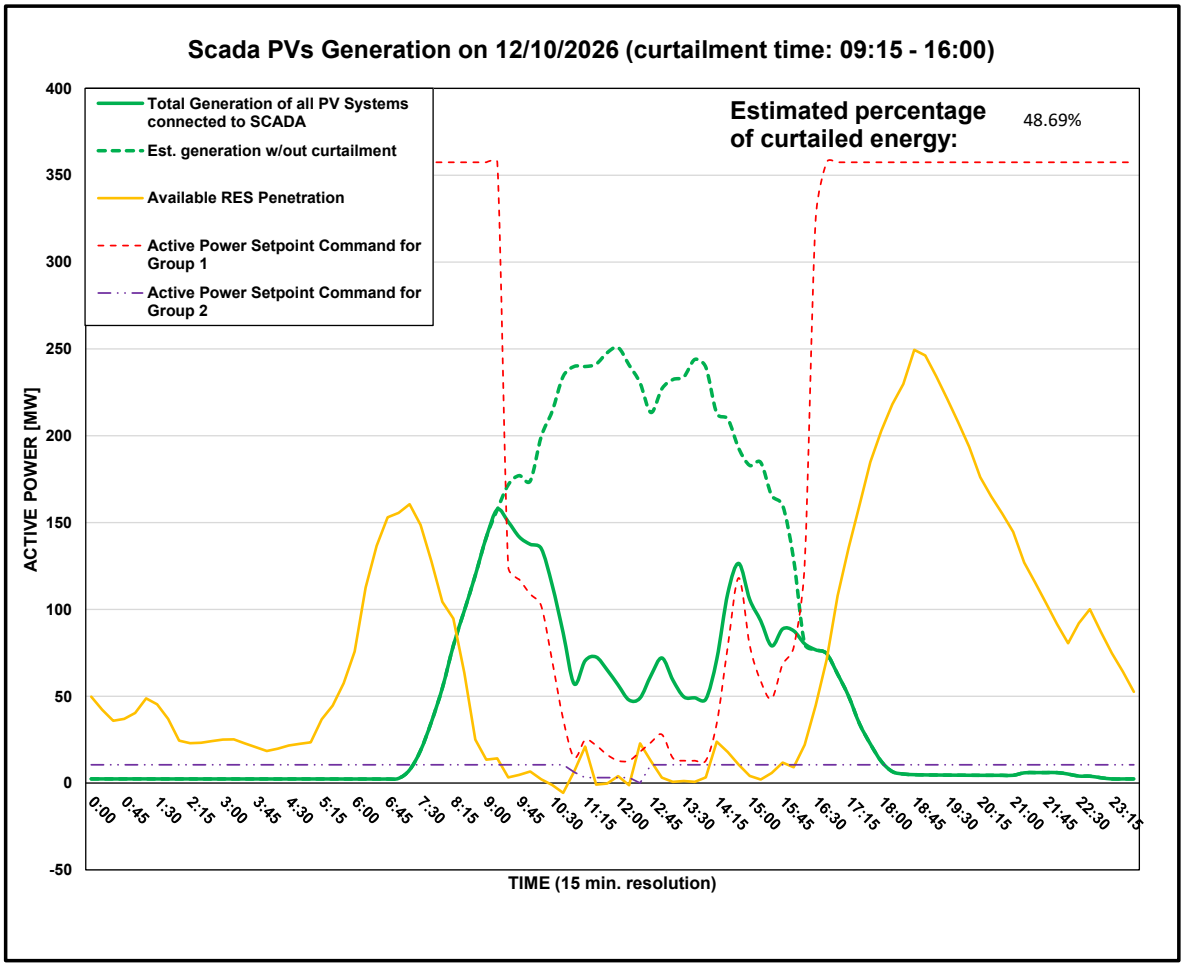


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**13/10/2026**	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	**8:45**	
Start of Curtailment (G2 - Priority)	**11:30**	Cut-off areas using IoT: PV-LIM3, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**15:30**	
End of Curtailment (G2 - Priority)	**13:45**	
Instruction from TSOC	**YES**	Start of cut-off: 11:30 End of cut-off: 14:00
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1622.5 MWh**	
Total Estimated Curtailed Energy:	***665.2 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 11.7MWh**
Percentage of Curtailed Energy:	***41%***	

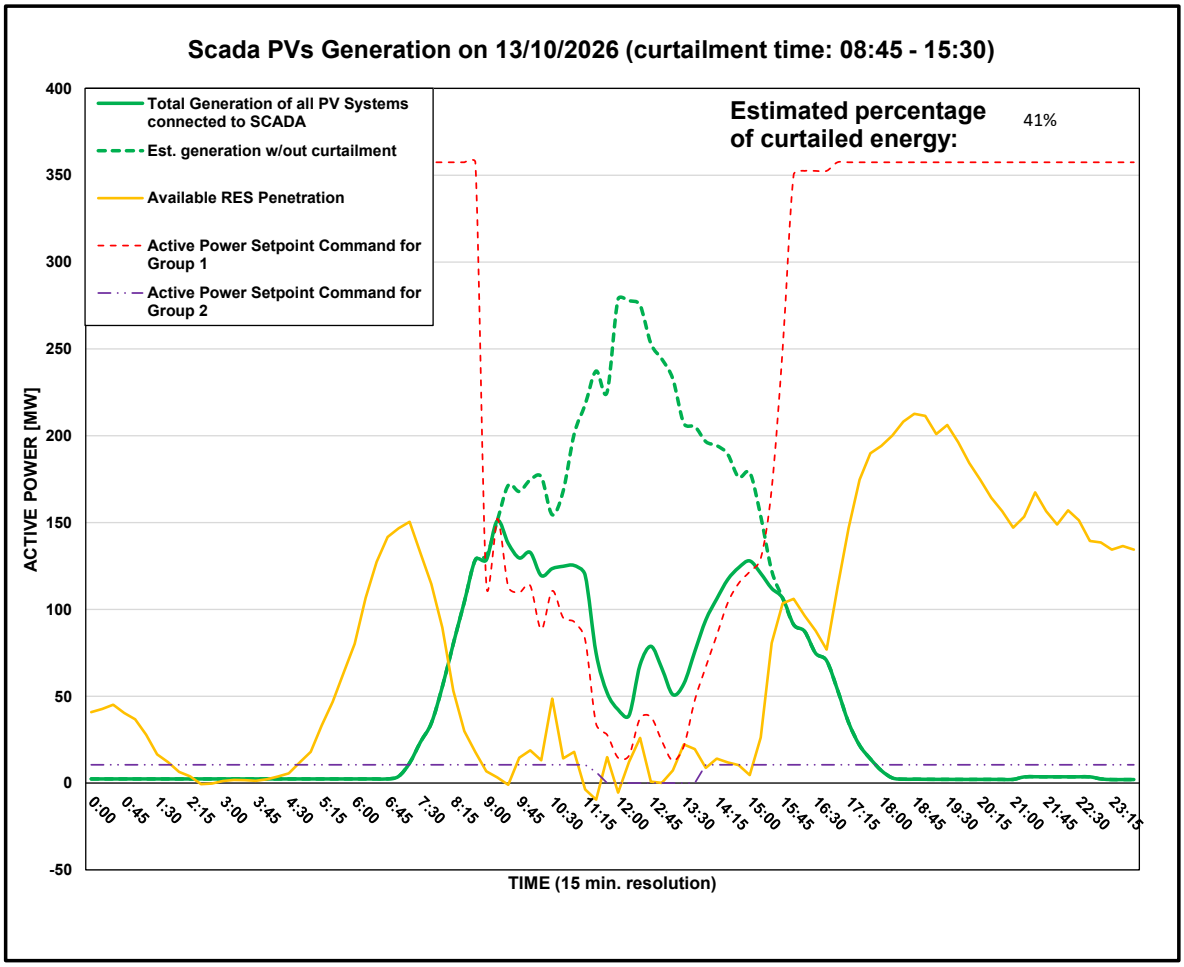


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**14/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**11:00**	
Start of Curtailment (G2 - Priority)	**11:30**	Cut-off areas using RIPPLE: NIC 1, NIC 2, LAR 2 Cut-off areas using IoT: PV-NIC1, PV-NIC4, PV-NIC7, PV-LCA/FAM1, PV-LCA/FAM4, PV-LIM2, PV-LIM4, PV-PAF2, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**15:45**	
End of Curtailment (G2 - Priority)	**15:00**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1221.9 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 53.9MWh**
Total Estimated Curtailed Energy:	***780.8 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 90.2MWh**
Percentage of Curtailed Energy:	***63.9%***	

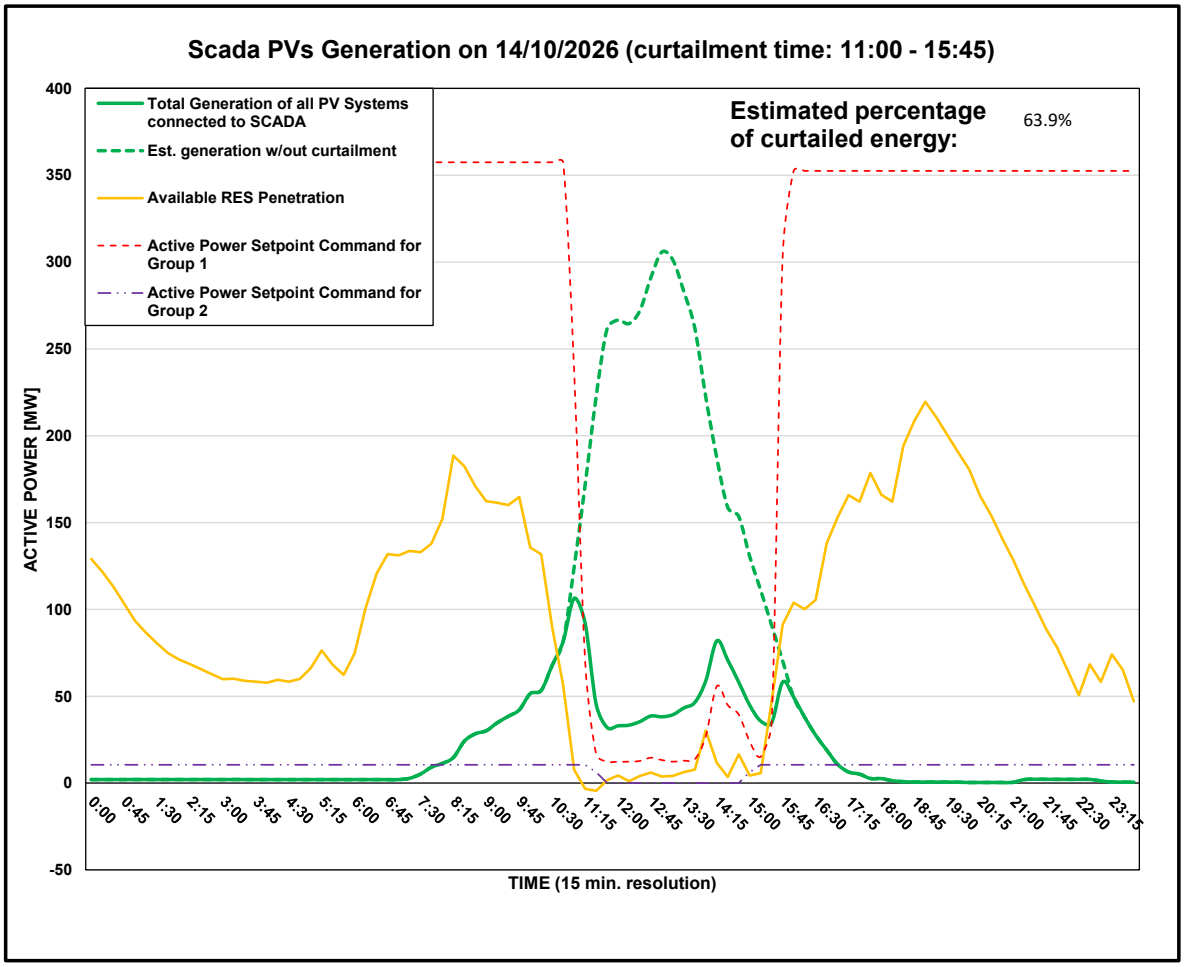


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**15/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**9:30**	
Start of Curtailment (G2 - Priority)	**10:45**	Cut-off areas using RIPPLE: LAR 1, LIM 2 Cut-off areas using IoT: PV-NIC1, PV-NIC2, PV-NIC3, PV-NIC4, PV-NIC5, PV-LCA/FAM2, PV-LCA/FAM3, PV-LIM1, PV-PAF1, PV -ARTICLE 102, PV -PROD 1, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**15:45**	
End of Curtailment (G2 - Priority)	**15:30**	
Instruction from TSOC	**YES**	Start of cut-off: 11:00 End of cut-off: 15:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1602.7 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 45.7MWh**
Total Estimated Curtailed Energy:	***923.8 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 96.9MWh**
Percentage of Curtailed Energy:	***57.64%***	

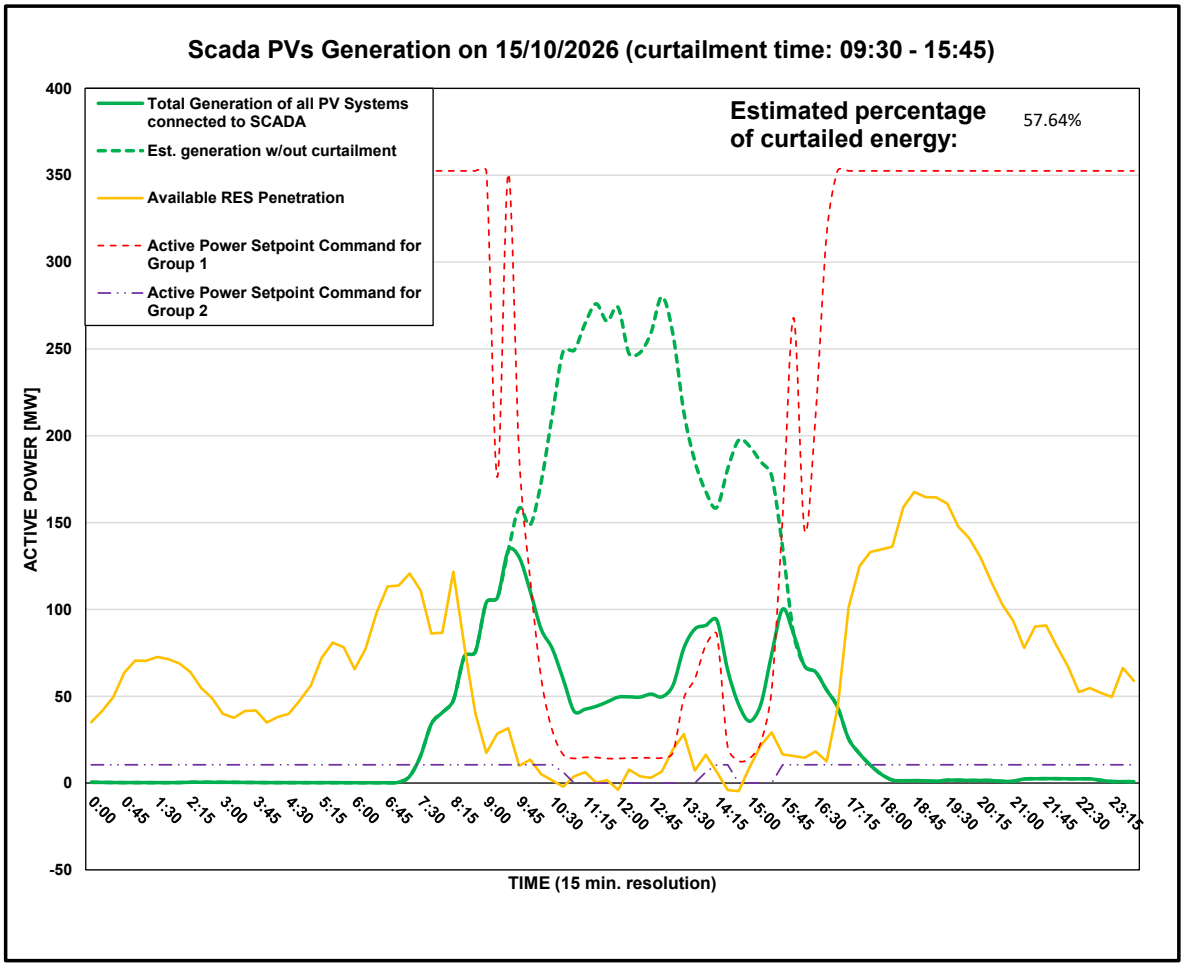


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**16/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:30**	
Start of Curtailment (G2 - Priority)	**10:00**	Cut-off areas using RIPPLE: NIC 3, LIM 1, PAF 1, PAF 2 Cut-off areas using IoT: PV-NIC6, PV-NIC7, PV-LCA/FAM1, PV-LIM2, PV-LIM3, PV-LIM4, PV-PAF2, PV-PAF3, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:45**	
End of Curtailment (G2 - Priority)	**14:30**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1771 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 113.6MWh**
Total Estimated Curtailed Energy:	***1204.7 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 123.5MWh**
Percentage of Curtailed Energy:	***68.02%***	

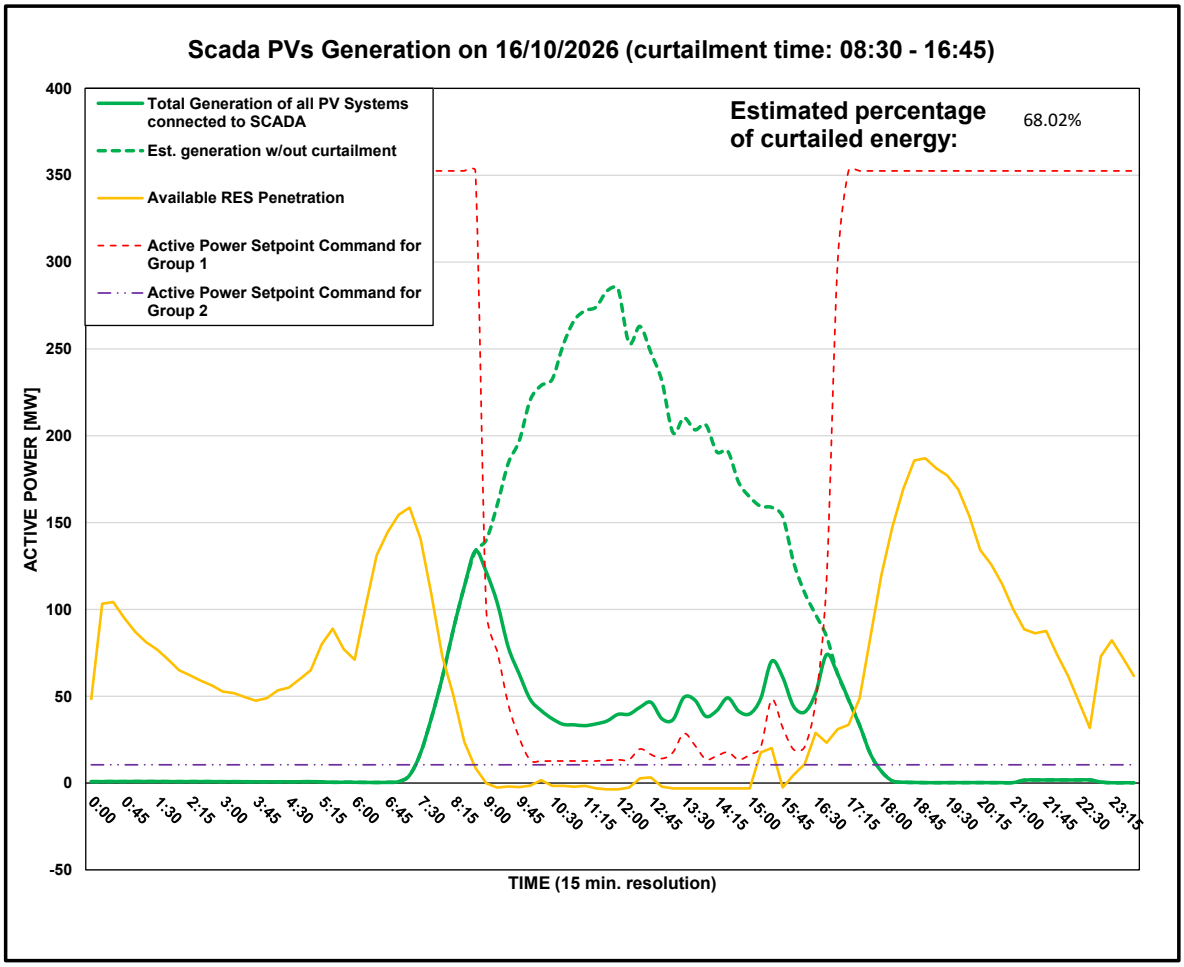


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**17/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:30**	
Start of Curtailment (G2 - Priority)	**10:30**	Cut-off areas using RIPPLE: NIC 1, NIC 2, LAR 2 Cut-off areas using IoT: PV-NIC1, PV-NIC4, PV-NIC5, PV-LCA/FAM4, PV-PAF1, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**17:15**	
End of Curtailment (G2 - Priority)	**15:00**	
Instruction from TSOC	**YES**	Start of cut-off: 10:30 End of cut-off: 15:00
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1661.7 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 89.9MWh**
Total Estimated Curtailed Energy:	***1091.8 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 86.8MWh**
Percentage of Curtailed Energy:	***65.7%***	

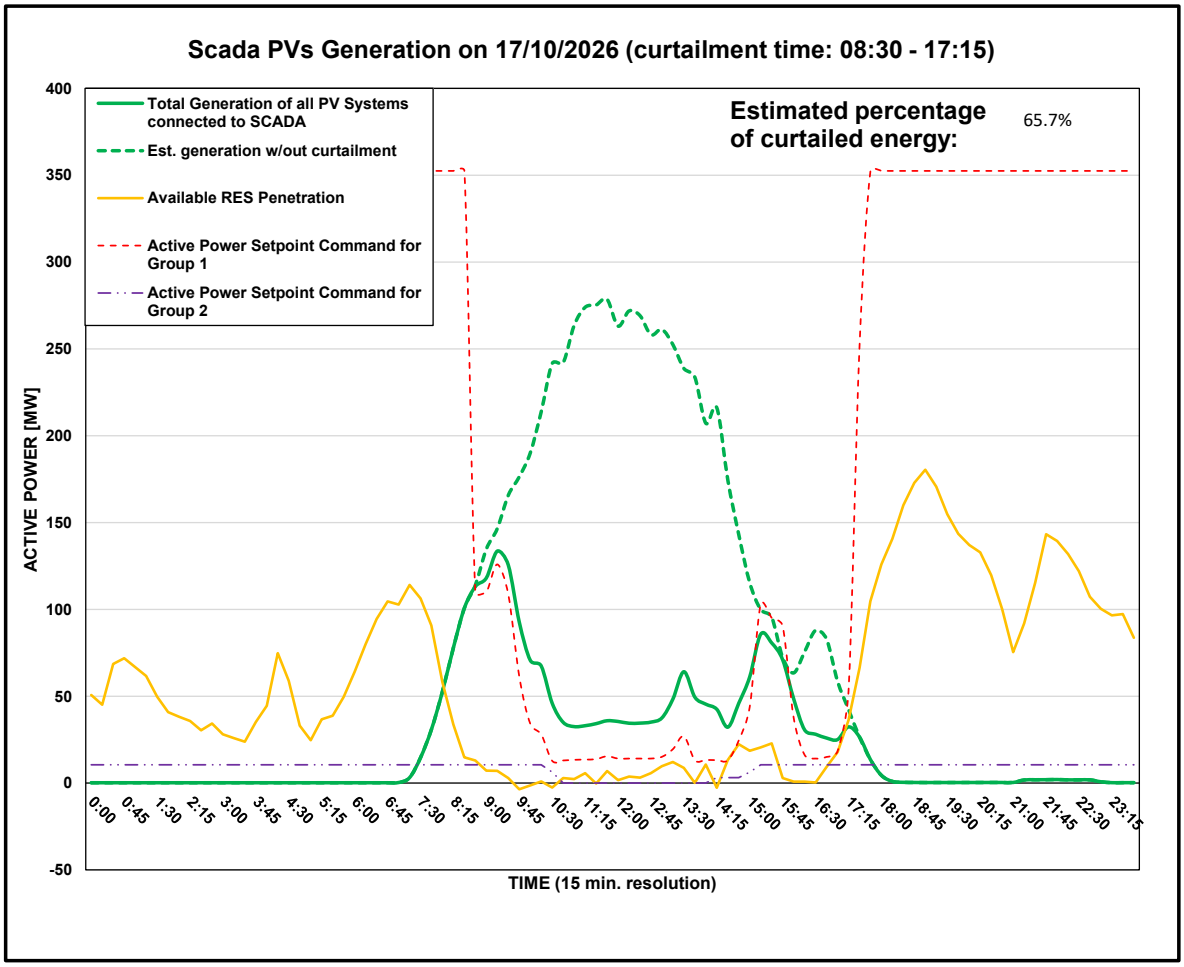


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**18/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:15**	
Start of Curtailment (G2 - Priority)	**9:15**	Cut-off areas using RIPPLE: NIC 3, LAR 1, LIM 1, LIM 2 Cut-off areas using IoT: PV-NIC2, PV-NIC3, PV-NIC6, PV-LCA/FAM2, PV-LCA/FAM3, PV-LIM1, PV -ARTICLE 102, PV -PROD 1, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**17:30**	
End of Curtailment (G2 - Priority)	**17:30**	
Instruction from TSOC	**YES**	Start of cut-off: 09:30 End of cut-off: 17:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**2070.4 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 369.7MWh**
Total Estimated Curtailed Energy:	***1700.9 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 415.6MWh**
Percentage of Curtailed Energy:	***82.15%***	

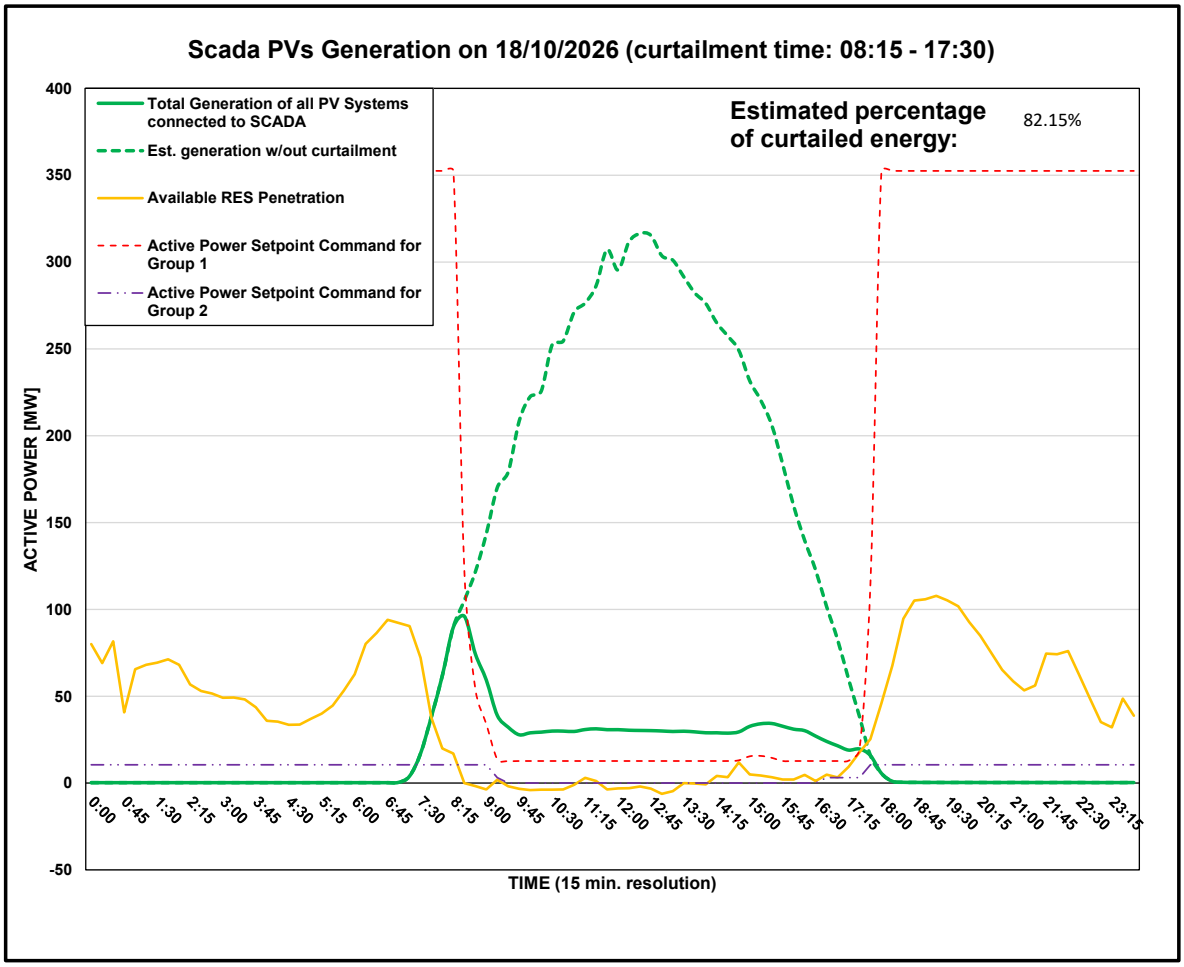


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**19/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:45**	
Start of Curtailment (G2 - Priority)	**9:45**	Cut-off areas using RIPPLE: NIC 1, NIC 2, LAR 2, PAF 1, PAF 2 Cut-off areas using IoT: PV-NIC1, PV-NIC4, PV-NIC7, PV-LCA/FAM1, PV-LCA/FAM4, PV-LIM2, PV-LIM3, PV-LIM4, PV-PAF2, PV-PAF3, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**17:00**	
End of Curtailment (G2 - Priority)	**16:30**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**2076.6 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 326.5MWh**
Total Estimated Curtailed Energy:	***1478.5 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 379.1MWh**
Percentage of Curtailed Energy:	***71.2%***	

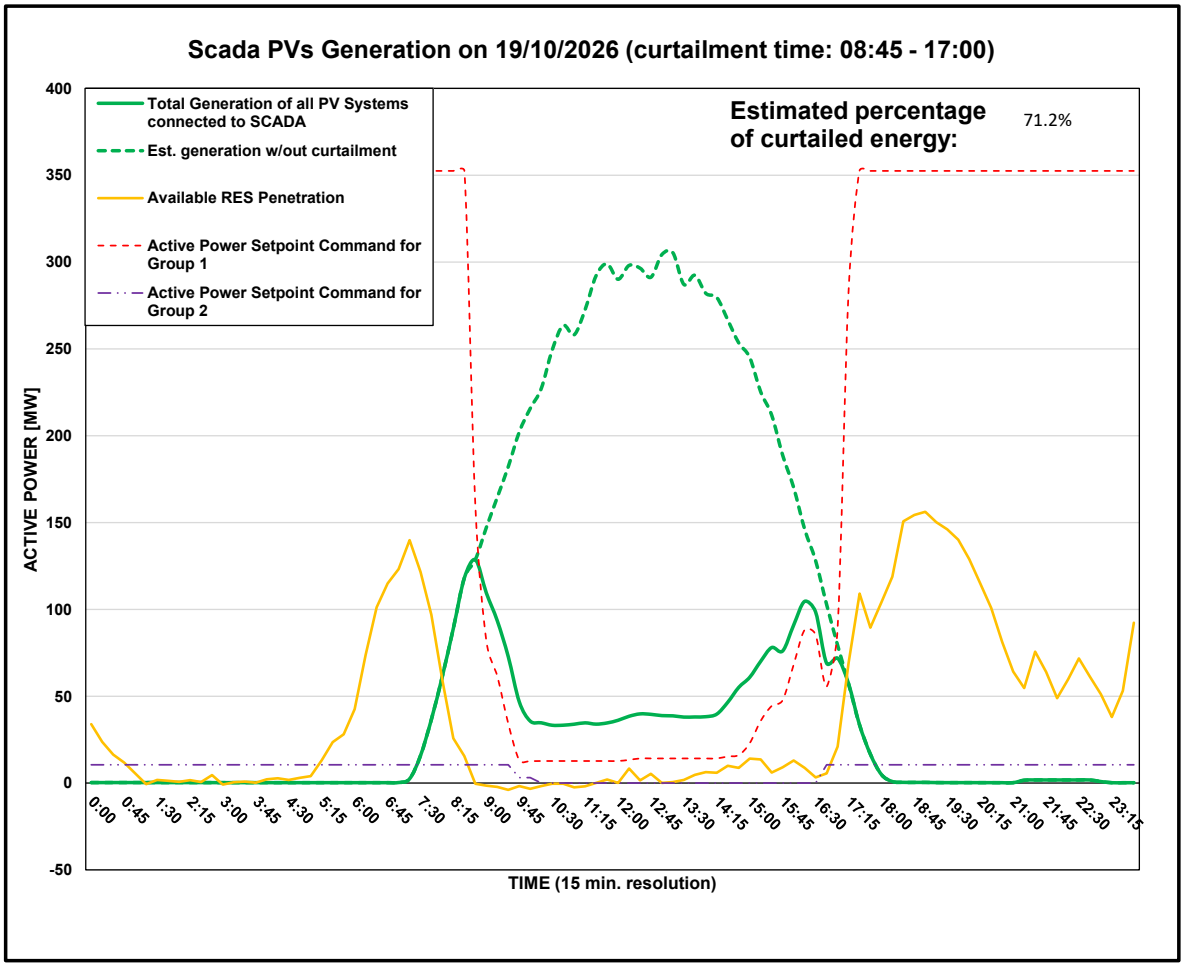


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**20/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:45**	
Start of Curtailment (G2 - Priority)	**10:00**	Cut-off areas using RIPPLE: LAR 1, LIM 2 Cut-off areas using IoT: PV-NIC5, PV-NIC7, PV-LCA/FAM1, PV-LCA/FAM3, PV-LIM2, PV-LIM4, PV-PAF1, PV-PAF2, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**17:00**	
End of Curtailment (G2 - Priority)	**15:30**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1901.3 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 97.7MWh**
Total Estimated Curtailed Energy:	***1281.8 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 184.5MWh**
Percentage of Curtailed Energy:	***67.42%***	

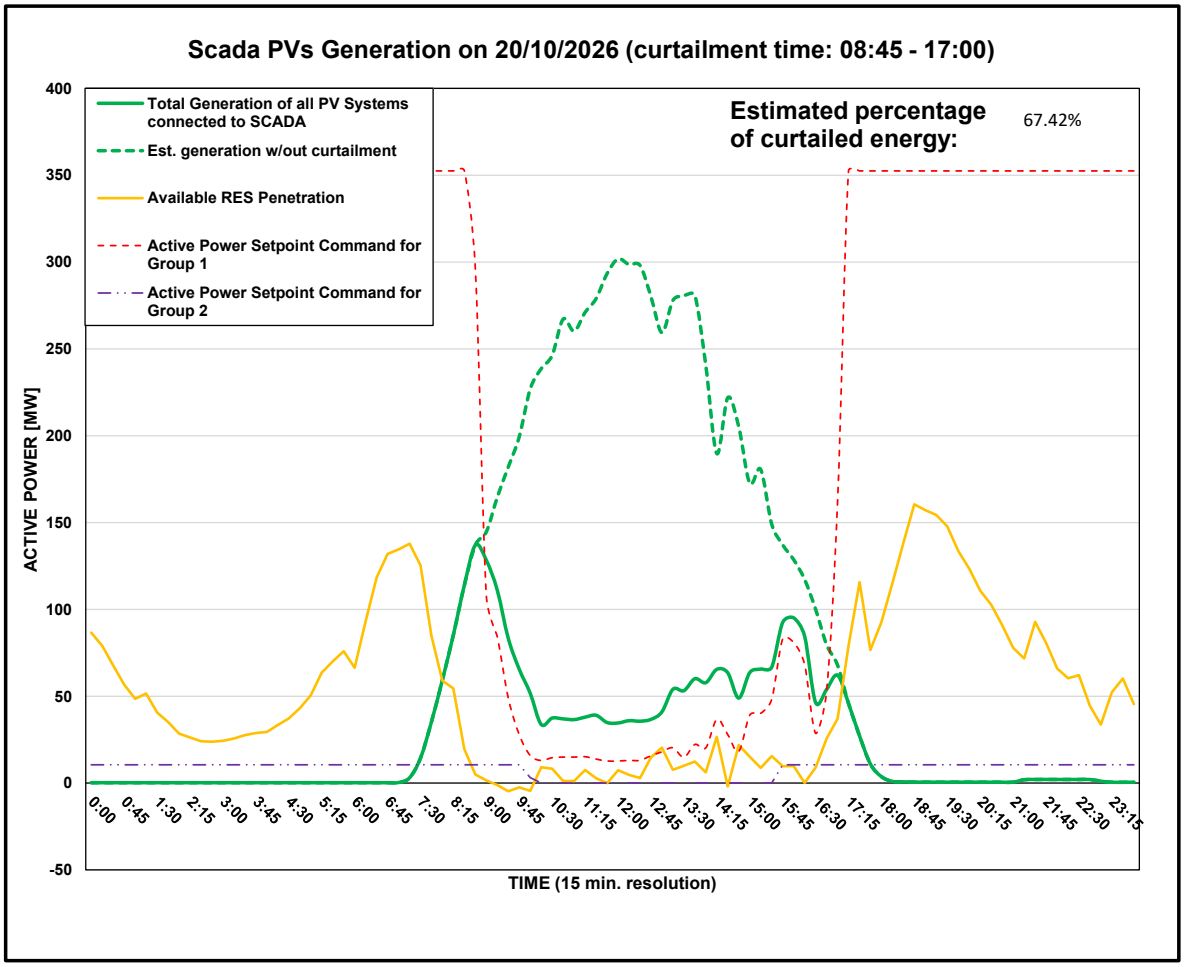


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**21/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:30**	
Start of Curtailment (G2 - Priority)	**9:15**	Cut-off areas using RIPPLE: NIC 3, LIM 1, PAF 2 Cut-off areas using IoT: PV-NIC2, PV-NIC3, PV-NIC6, PV-LCA/FAM2, PV-LCA/FAM3, PV-LIM1, PV-LIM3, PV-PAF3, PV -ARTICLE 102, PV -PROD 1, PV-NPZEX1
End of Curtailment (G1 - non Priority)	**16:15**	
End of Curtailment (G2 - Priority)	**15:45**	
Instruction from TSOC	**YES**	Start of cut-off: 10:00 End of cut-off: 16:45
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1914.6 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 196MWh**
Total Estimated Curtailed Energy:	***1371.5 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 391.9MWh**
Percentage of Curtailed Energy:	***71.64%***	

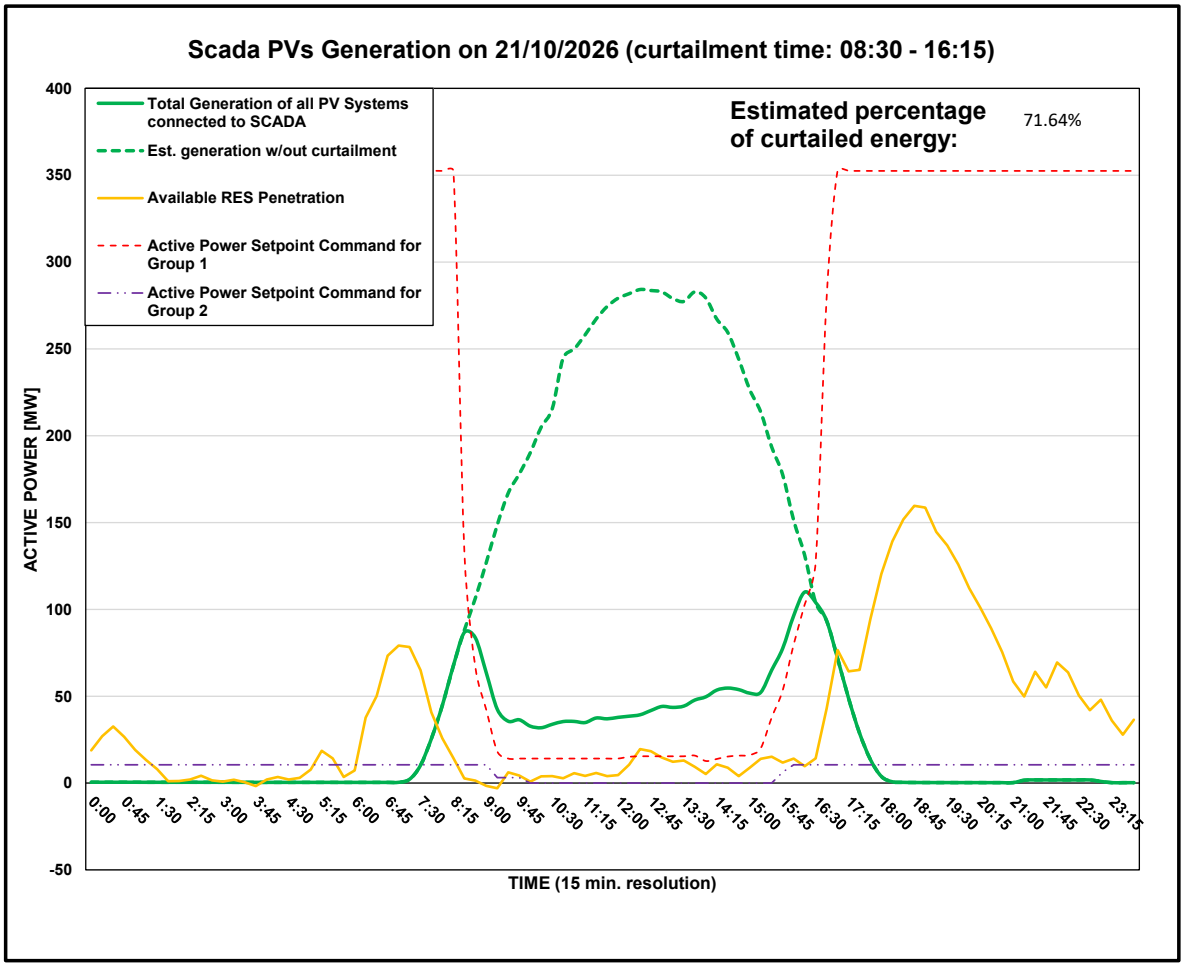


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**22/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:45**	
Start of Curtailment (G2 - Priority)	**10:15**	Cut-off areas using RIPPLE: PAF 1 Cut-off areas using IoT: PV-NIC7, PV-LCA/FAM1, PV-LIM1, PV-LIM2, PV-LIM4, PV-PAF1, PV-PAF2, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:00**	
End of Curtailment (G2 - Priority)	**15:00**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1922.9 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 49.5MWh**
Total Estimated Curtailed Energy:	***1253.7 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 180.2MWh**
Percentage of Curtailed Energy:	***65.2%***	

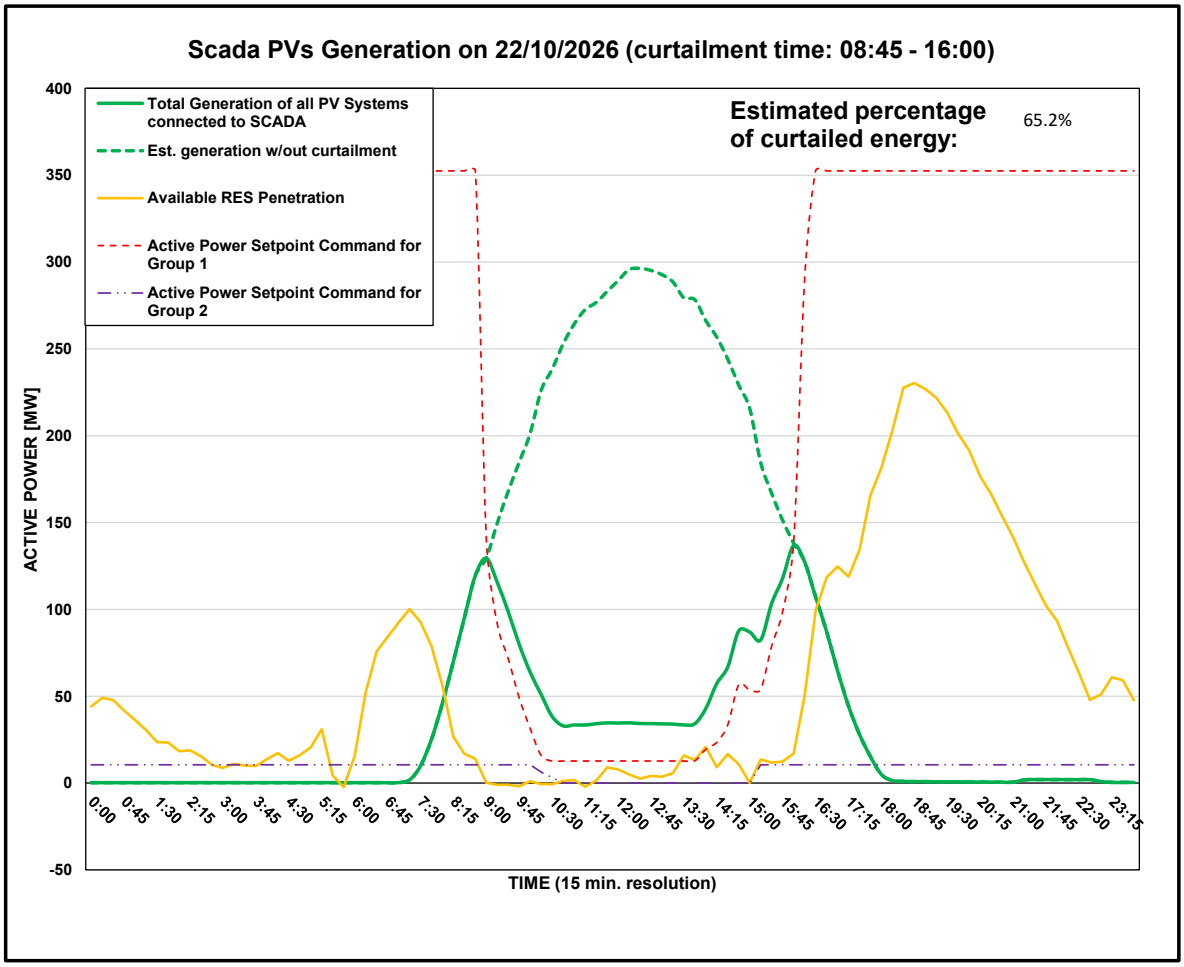


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**23/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**9:00**	
Start of Curtailment (G2 - Priority)	**10:30**	Cut-off areas using RIPPLE: NIC 1, NIC 2, LAR 2, PAF 2 Cut-off areas using IoT: PV-NIC1, PV-NIC4, PV-NIC5, PV-LCA/FAM4, PV-PAF3, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:45**	
End of Curtailment (G2 - Priority)	**15:30**	
Instruction from TSOC	**YES**	Start of cut-off: 10:30 End of cut-off: 15:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1963.1 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 141.1MWh**
Total Estimated Curtailed Energy:	***1267.9 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 107.6MWh**
Percentage of Curtailed Energy:	***64.59%***	

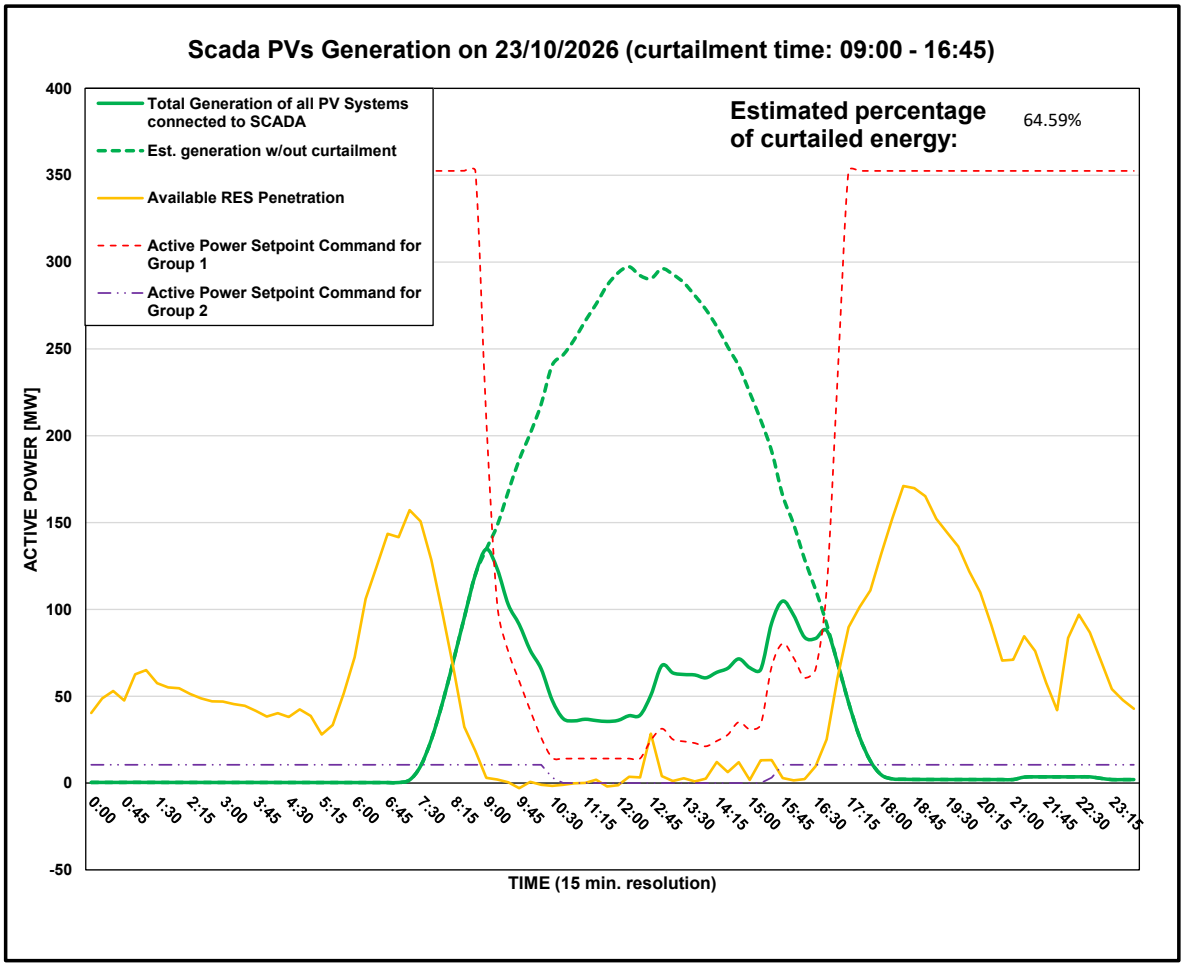


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**24/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:30**	
Start of Curtailment (G2 - Priority)	**9:45**	Cut-off areas using RIPPLE: NIC 3, LAR 1, LIM 1, LIM 2 Cut-off areas using IoT: PV-NIC2, PV-NIC3, PV-NIC6, PV-LCA/FAM2, PV-LCA/FAM3, PV-LIM1, PV -ARTICLE 102, PV -PROD 1, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:45**	
End of Curtailment (G2 - Priority)	**16:00**	
Instruction from TSOC	**YES**	Start of cut-off: 09:45 End of cut-off: 16:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**2039.1 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 232MWh**
Total Estimated Curtailed Energy:	***1466.1 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 337.5MWh**
Percentage of Curtailed Energy:	***71.9%***	

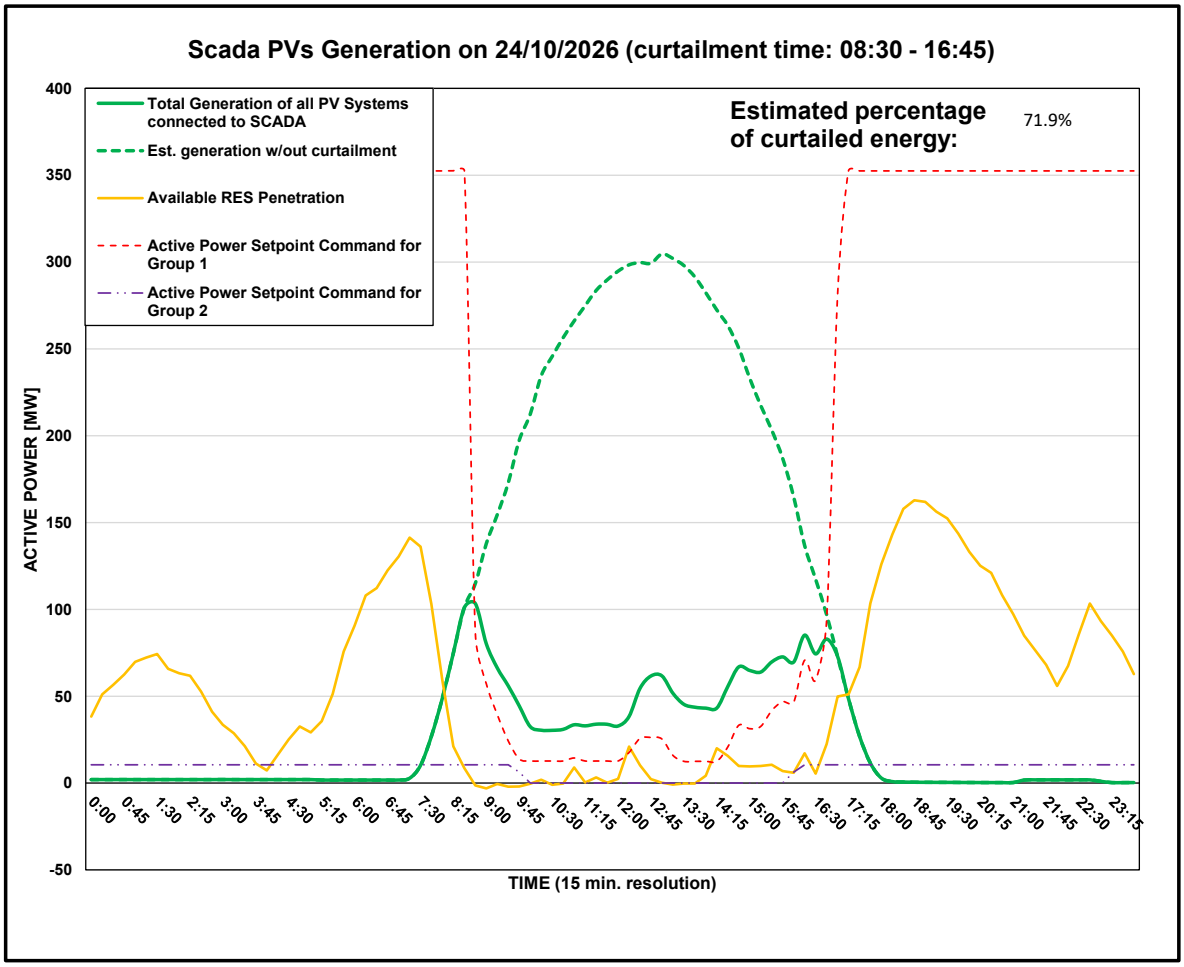


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**25/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**7:30**	
Start of Curtailment (G2 - Priority)	**8:30**	Cut-off areas using RIPPLE: NIC 1, NIC 2, PAF 1 Cut-off areas using IoT: PV-NIC5, PV-NIC7, PV-LCA/FAM1, PV-LCA/FAM4, PV-LIM2, PV-LIM3, PV-LIM4, PV-PAF1, PV-PAF2, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**15:30**	
End of Curtailment (G2 - Priority)	**14:30**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1958.2 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 157MWh**
Total Estimated Curtailed Energy:	***1467.4 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 283.3MWh**
Percentage of Curtailed Energy:	***74.94%***	

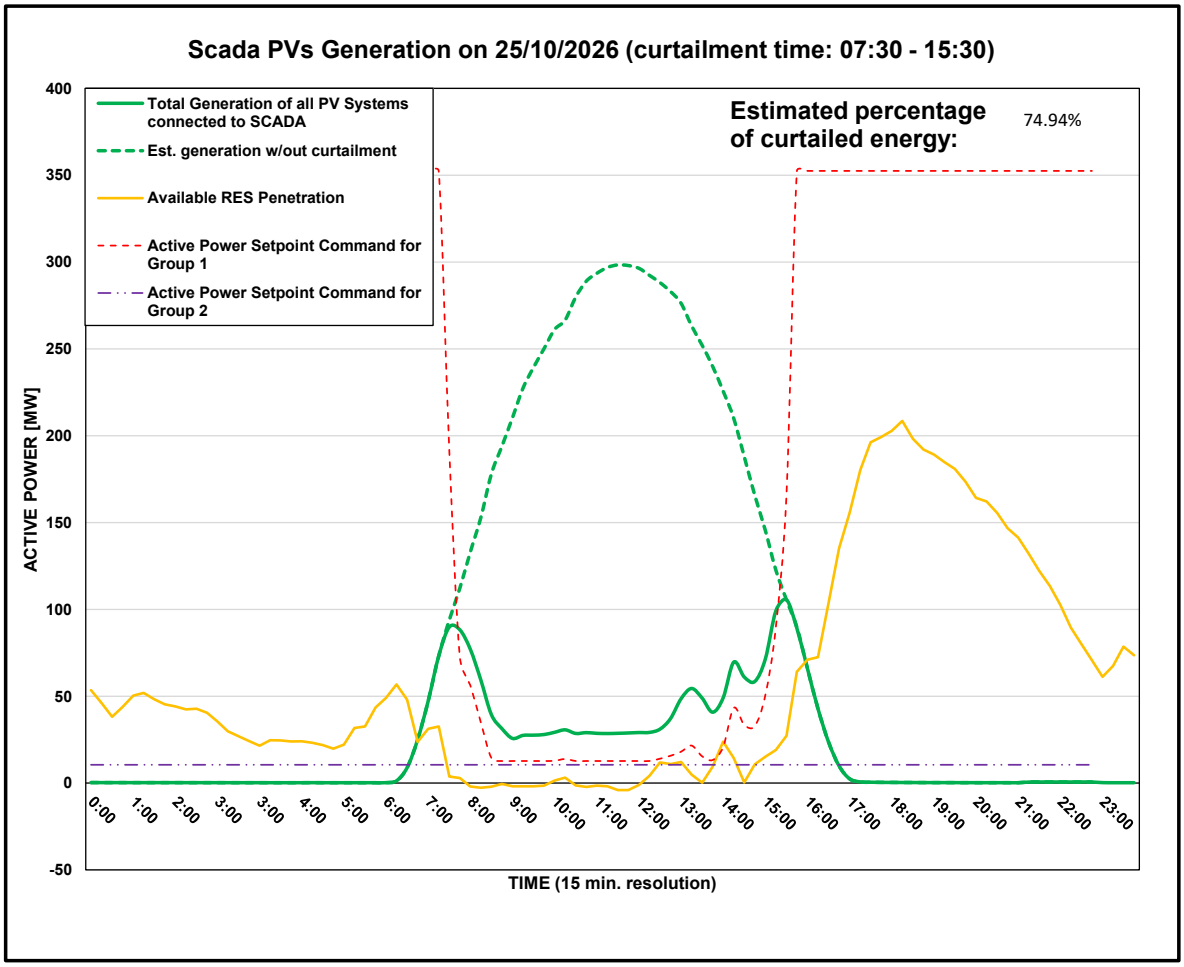


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**26/10/2026**	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	**7:45**	
Start of Curtailment (G2 - Priority)	**9:30**	Cut-off areas using IoT: PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**15:00**	
End of Curtailment (G2 - Priority)	**12:00**	
Instruction from TSOC	**YES**	Start of cut-off: 10:30 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1334.6 MWh**	
Total Estimated Curtailed Energy:	***557.7 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 5.1MWh**
Percentage of Curtailed Energy:	***41.79%***	

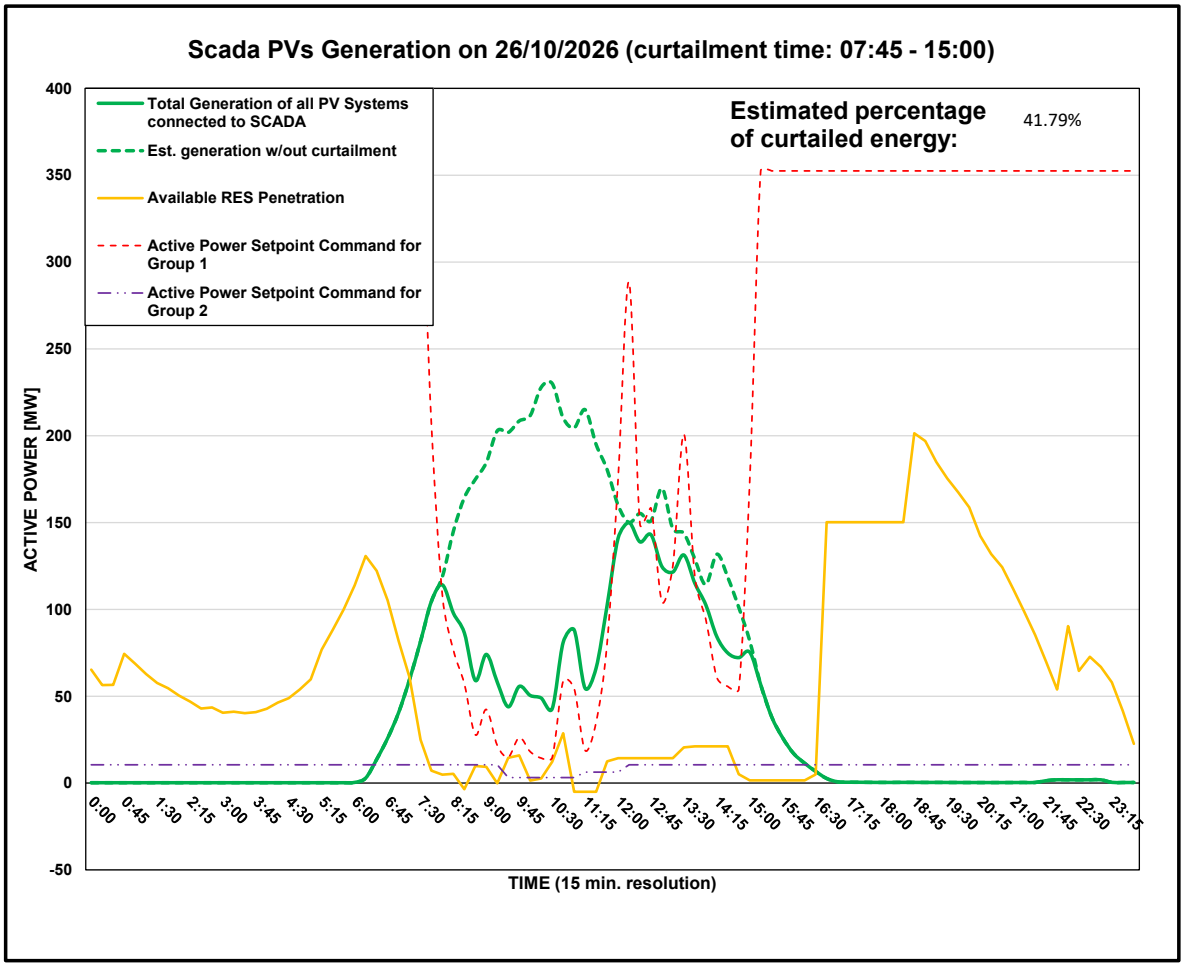


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**27/10/2026**	Cut-off of PV Systems using IoT:
Start of Curtailment (G1 - non Priority)	**7:45**	
Start of Curtailment (G2 - Priority)	**9:30**	Cut-off areas using IoT: PV-NIC2, PV-NIC3, PV-NIC6, PV-LCA/FAM2, PV-PAF1, PV -ARTICLE 102, PV -PROD 1, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**15:15**	
End of Curtailment (G2 - Priority)	**15:15**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 15:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1695.3 MWh**	
Total Estimated Curtailed Energy:	***1099.1 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 207.5MWh**
Percentage of Curtailed Energy:	***64.83%***	

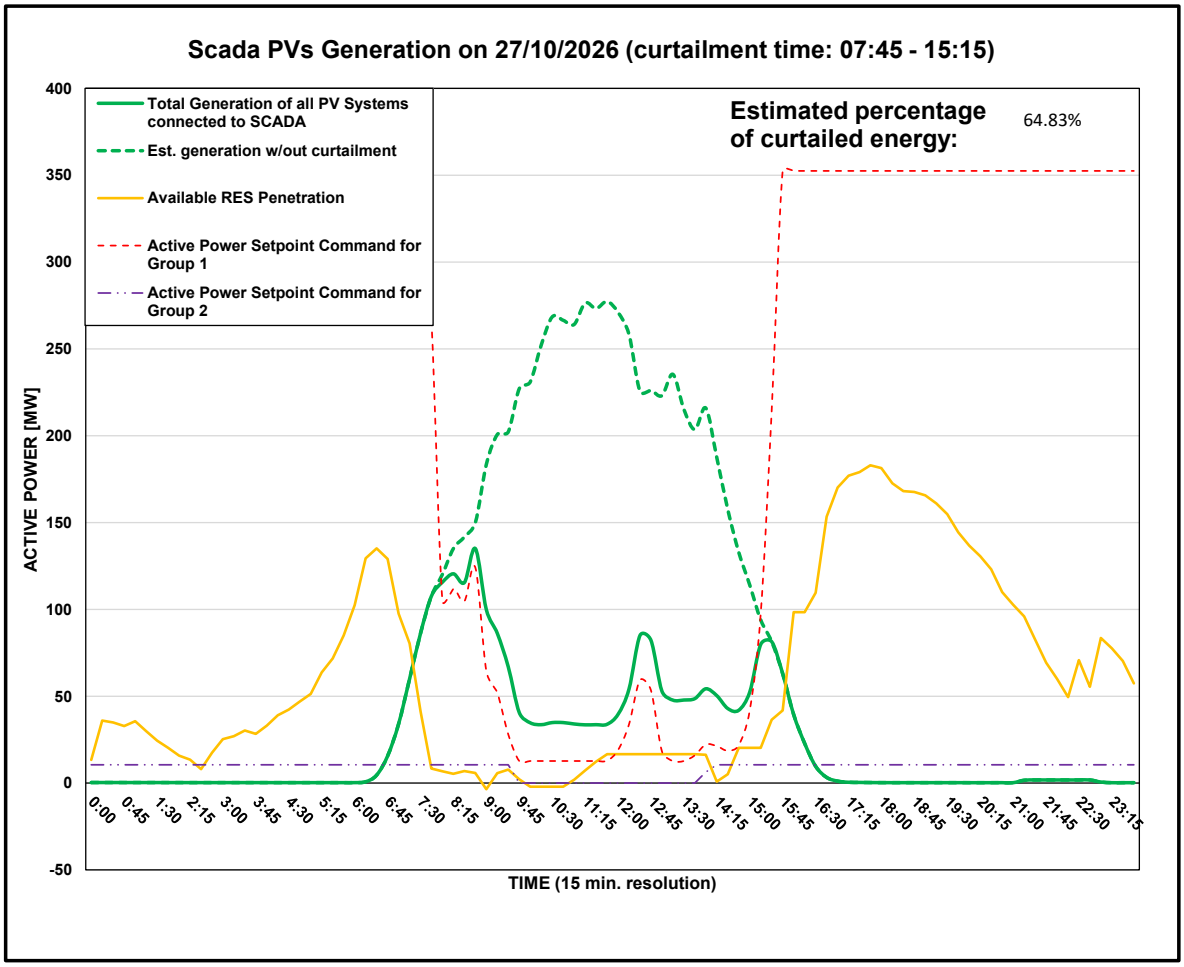


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**28/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**11:15**	
Start of Curtailment (G2 - Priority)	**12:30**	Cut-off areas using RIPPLE: NIC 3, LAR 1, LAR 2, LIM 1 Cut-off areas using IoT: PV-NIC1, PV-NIC4, PV-NIC5, PV-LCA/FAM1, PV-LCA/FAM3, PV-LIM1, PV-LIM2, PV-PAF2, PV-PAF3, PV -ARTICLE 102, PV-NPZEX1
End of Curtailment (G1 - non Priority)	**15:45**	
End of Curtailment (G2 - Priority)	**15:15**	
Instruction from TSOC	**YES**	Start of cut-off: 12:30 End of cut-off: 15:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1021.2 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 71.5MWh**
Total Estimated Curtailed Energy:	***464.8 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 81.1MWh**
Percentage of Curtailed Energy:	***45.51%***	

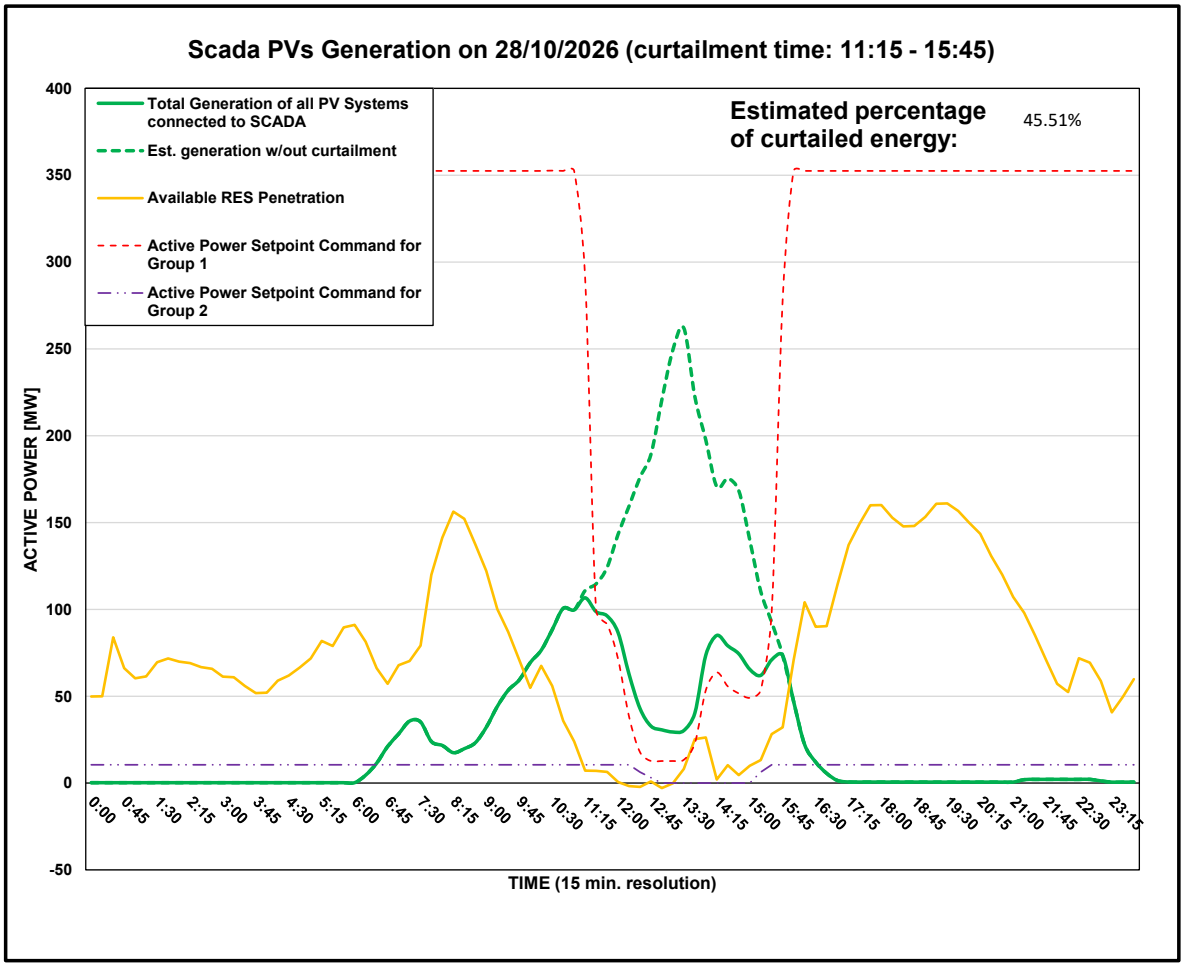


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**29/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**9:00**	
Start of Curtailment (G2 - Priority)	**11:00**	Cut-off areas using RIPPLE: NIC 3, LAR 1, LIM 1, LIM 2, PAF 2 Cut-off areas using IoT: PV-NIC1, PV-NIC4, PV-NIC6, PV-NIC7, PV-LCA/FAM3, PV-LCA/FAM4, PV-LIM1, PV-LIM3, PV-LIM4, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**16:30**	
End of Curtailment (G2 - Priority)	**14:30**	
Instruction from TSOC	**YES**	Start of cut-off: 07:15 End of cut-off: 18:15
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**922.4 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 95.1MWh**
Total Estimated Curtailed Energy:	***505.9 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 89.2MWh**
Percentage of Curtailed Energy:	***54.85%***	

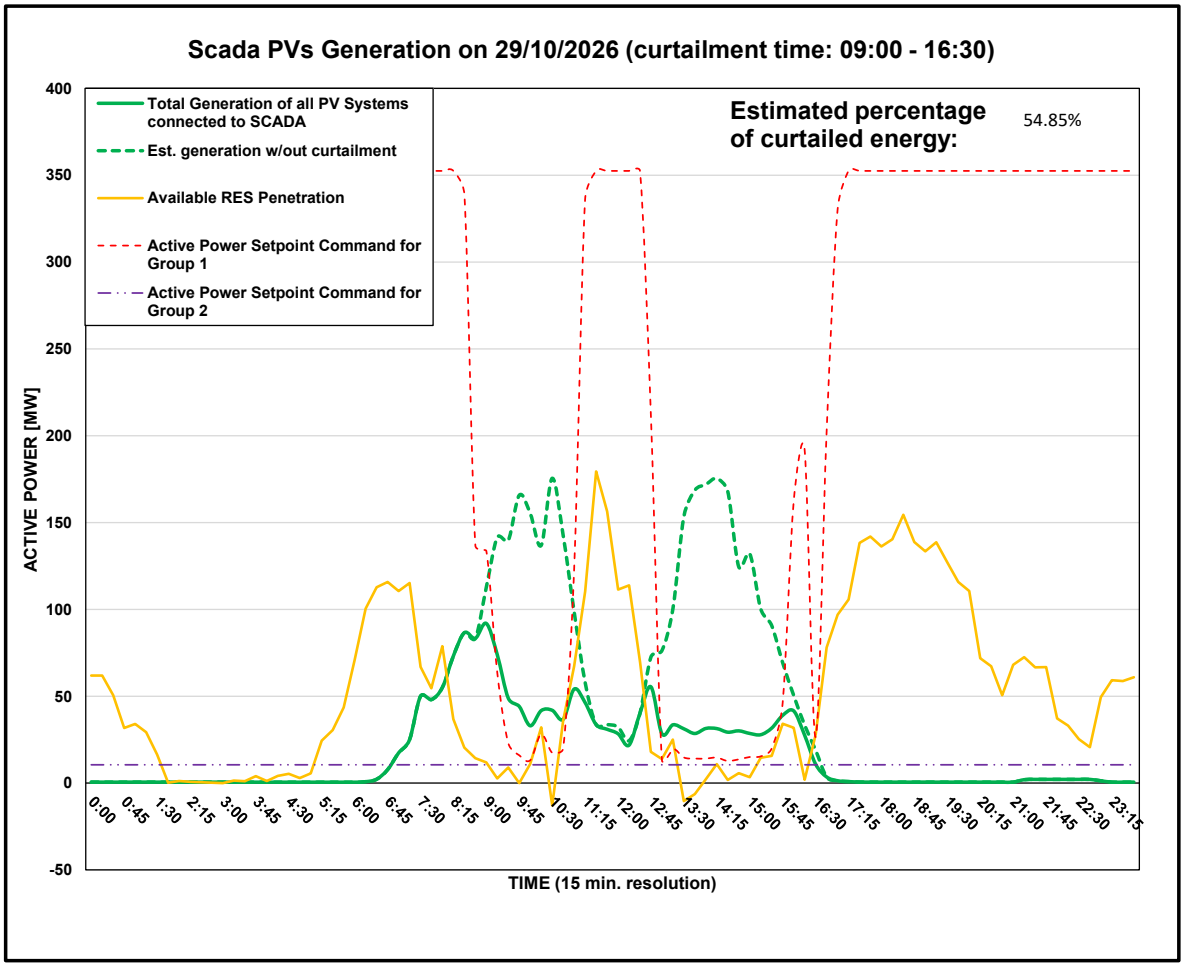


DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**30/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**7:30**	
Start of Curtailment (G2 - Priority)	**8:30**	Cut-off areas using RIPPLE: LAR 2 Cut-off areas using IoT: PV-NIC1, PV-NIC2, PV-NIC3, PV-NIC4, PV-NIC5, PV-LCA/FAM1, PV-LCA/FAM2, PV-LIM2, PV-PAF2, PV-PAF3, PV -ARTICLE 102, PV -PROD 1, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**14:45**	
End of Curtailment (G2 - Priority)	**13:45**	
Instruction from TSOC	**YES**	Start of cut-off: 08:30 End of cut-off: 14:00

Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1655.4 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 52.1MWh**
Total Estimated Curtailed Energy:	***1171.7 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 366MWh**
Percentage of Curtailed Energy:	***70.83%***	

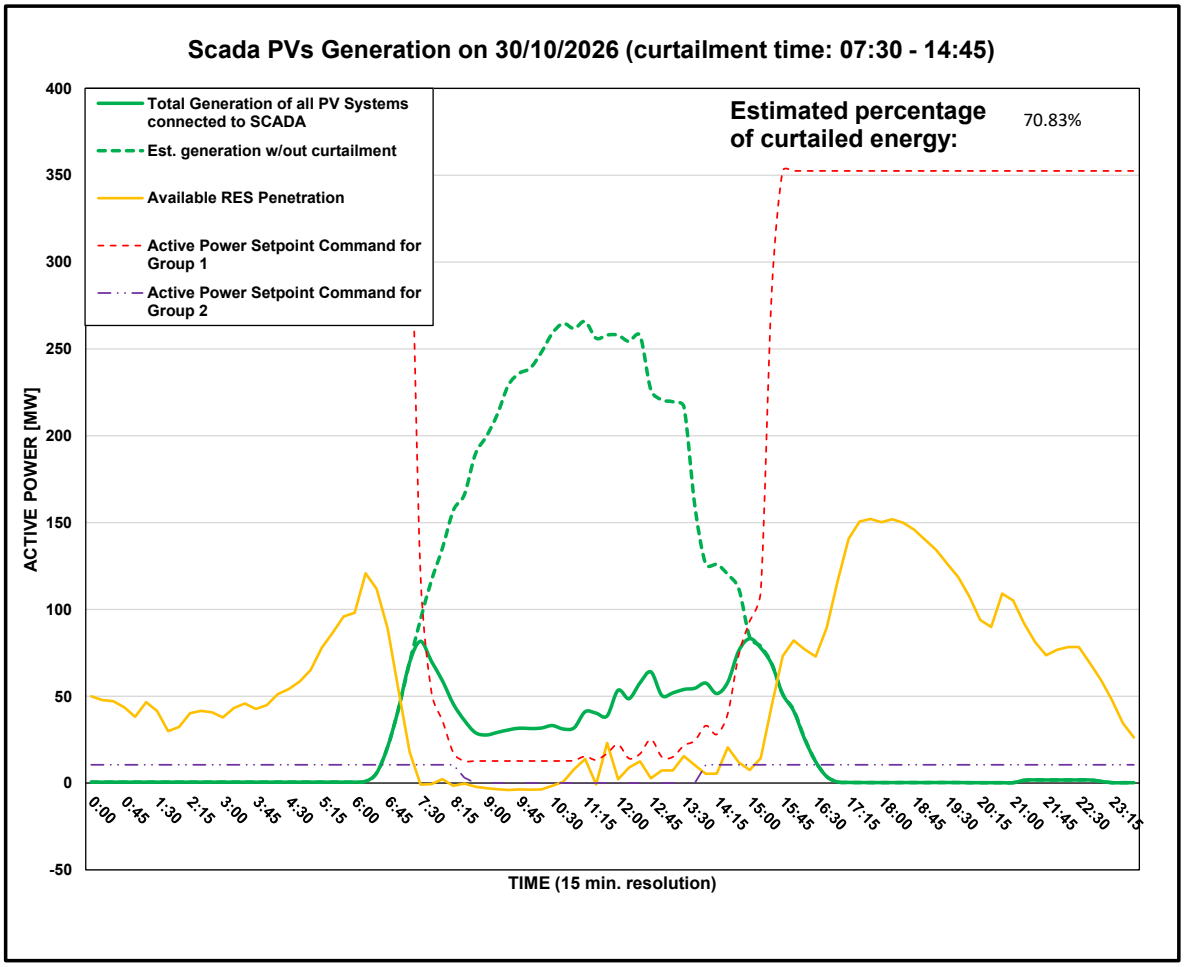

DISTRIBUTION SYSTEM OPERATOR
SYSTEM OPERATION

Αρχή Ηλεκτρισμού Κύπρου
Διανομή

PV Generation Curtailment Report

Date of Curtailment:	**31/10/2026**	Cut-off of PV Systems using RIPPLE and IoT:
Start of Curtailment (G1 - non Priority)	**8:15**	
Start of Curtailment (G2 - Priority)	**9:00**	Cut-off areas using RIPPLE: NIC 1, NIC 2, NIC 3, LAR 1, LIM 1, LIM 2, PAF 1, PAF 2 Cut-off areas using IoT: PV-LCA/FAM3, PV-LCA/FAM4, PV-LIM1, PV-LIM3, PV-LIM4, PV-PAF1, PV -ARTICLE 102, PV- NPZEX1
End of Curtailment (G1 - non Priority)	**15:30**	
End of Curtailment (G2 - Priority)	**15:30**	
Instruction from TSOC	**YES**	Start of cut-off: 09:00 End of cut-off: 15:30
Reason of Curtailment:	RES-E Generation Restriction due to low loading of the electrical system	
Total Estimated Energy of the day:	**1438.8 MWh**	**Total Est. Energy of the cut-off PV systems using RIPPLE: 388.2MWh**
Total Estimated Curtailed Energy:	***1015.5 MWh***	**Total Est. Energy of the cut-off PV systems using IoT: 195MWh**
Percentage of Curtailed Energy:	***70.58%***	

